



e-FILING REPORT COVER SHEET

COMPANY NAME:

DOES REPORT CONTAIN CONFIDENTIAL INFORMATION? No Yes If yes, submit a redacted public version (or a cover letter) by email. Submit the confidential information as directed in OAR 860-001-0070 or the terms of an applicable protective order.

Select report type: RE (Electric) RG (Gas) RW (Water) RT (Telecommunications)
 RO (Other, for example, industry safety information)

Did you previously file a similar report? No Yes, report docket number:

Report is required by: OAR

Statute

Order

Note: A one-time submission required by an order is a compliance filing and not a report (file compliance in the applicable docket)

Other

(For example, federal regulations, or requested by Staff)

Is this report associated with a specific docket/case? No Yes, docket number:

List Key Words for this report. We use these to improve search results.

Send the completed Cover Sheet and the Report in an email addressed to PUC.FilingCenter@state.or.us

Send confidential information, voluminous reports, or energy utility Results of Operations Reports to PUC Filing Center, PO Box 1088, Salem, OR 97308-1088 or by delivery service to 201 High Street SE Suite 100, Salem, OR 97301.



LISA D. NORDSTROM
Lead Counsel
lnordstrom@idahopower.com

April 29, 2021

VIA ELECTRONIC FILING

puc.FilingCenter@puc.oregon.gov

Re: RE90 - Idaho Power Company's Electric Service Reliability Annual Report for the Year 2020

Filing Center:

Pursuant to OAR 860-023-0151, Idaho Power Company transmits for electronic filing its Electric Service Reliability Annual Report for the Year 2020.


If you have any substantive questions, please call Doug Dockter at 208-388-2741.

Very truly yours,

A handwritten signature in black ink that reads "Lisa D. Nordstrom".

Lisa D. Nordstrom

LDN:slb
Enclosure

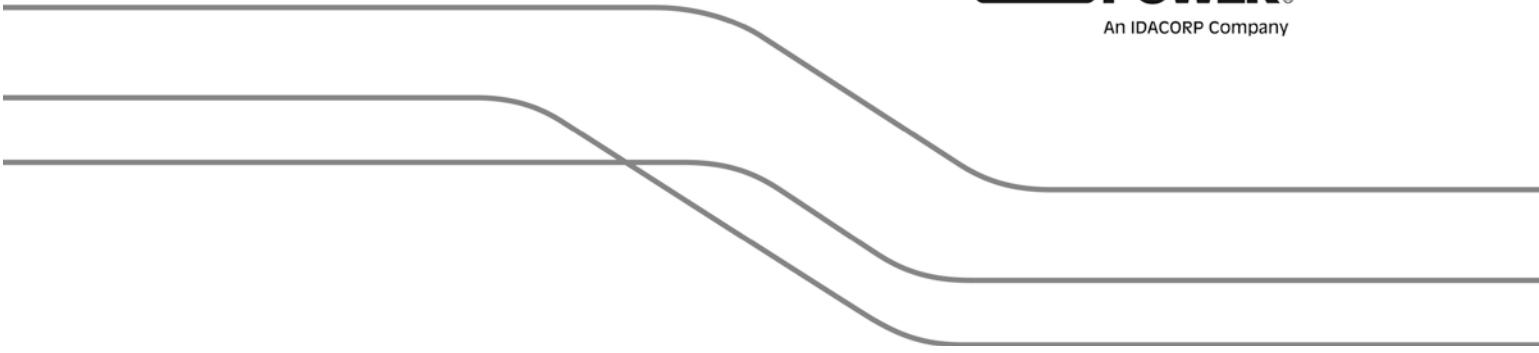

The background of the page features a large, abstract graphic element consisting of several thin, dark gray horizontal lines. One prominent line curves from the top left towards the center, while others are more horizontal or form smaller loops, creating a sense of depth and movement.

Idaho Power Company 2020 Electric Service Reliability Annual Report

May 2021
2021 Idaho Power

CONTENTS

Figures.....	ii
Tables	iii
Executive Summary	1
Definitions.....	3
System SAIDI, SAIFI and MAIFI _E	5
System SAIDI.....	5
System SAIFI.....	6
System MAIFI _E	7
Sustained Interruption Event Causes	9
Circuit SAIDI, SAIFI and MAIFI _E	13
Five Years of Circuit SAIDI.....	13
Five Years of Circuit SAIFI.....	25
Five Years of Circuit MAIFI _E	37
2020 Descending Indices by Circuit	49
Appendix.....	53
Circuit Reference Information	53
Five Years of System Pole and Trench Miles.....	54
2020 Major Event Day System Summary	55
2020 Major Event Day Feeder Summary	55
Five Years of Major Event Days	55
Cause Category Translation.....	56
Maps.....	57

FIGURES

Figure 1 Five Years of System SAIDI.....	5
Figure 2 Five Years of System SAIFI.....	6
Figure 3 Five Years of System MAIFI _E	7
Figure 4 Five Years of Sustained Interruption Events by Cause	10
Figure 5 2020 Ranking of Sustained Interruption Event Causes.....	12
Figure 6 Five Years of Circuit SAIDI.....	24
Figure 7 Five Years of Circuit SAIFI	36
Figure 8 Five Years of Circuit MAIFI _E	48
Figure 9 2020 Descending SAIDI by Circuit	50
Figure 10 2020 Descending SAIFI by Circuit	51
Figure 11 2020 Descending MAIFI _E by Circuit	52
Figure 12 Five Years of MEDs	55

TABLES

Table 1 Five Years of System SAIDI	5
Table 2 Five Years of System SAIFI.....	6
Table 3 Five Years of System MAIFI _E	7
Table 4 Five Years of Sustained Interruption Event Causes	9
Table 5 2020 Sustained Interruption Event Cause Ranking	11
Table 6 Five Years of Circuit SAIDI.....	13
Table 7 Five Years of Circuit SAIFI.....	25
Table 8 Five Years of Circuit MAIFI _E	37
Table 9 2020 Descending Indices by Circuit.....	49
Table 10 Circuit Reference Information	53
Table 11 Five Years of System Pole and Trench Miles.....	54
Table 12 2020 MED System Summary	55
Table 13 2020 MED Feeder Summary	55
Table 14 Cause Category Translation.....	56

EXECUTIVE SUMMARY

The information in this document presents Idaho Power's 2020 Electric Service Reliability Annual Report in accordance with OAR 860-023-0151. The report discusses the performance of Idaho Power's Oregon electric service through a narrative summary and includes several tables and figures.

At year-end 2020, Idaho Power served 19,380 customers from 63 distribution circuits served by 30 substations in the far central-eastern portion of Oregon. The composite performance of the circuits in 2020 included the following:

- 699 sustained (greater than five minutes) interruption events
- 18,735 customer interruptions
- 59,845 customer hours out
- System Average Interruption Frequency Index (SAIFI) of 0.97
- System Average Interruption Duration Index (SAIDI) of 3.09 hours
- Momentary Average Interruption Event Frequency Index (MAIFI_E) of 2.07

Idaho Power used the calculation of a threshold for major event days (MEDs) as defined in the Institute of Electrical and Electronic Engineers (IEEE) Standard 1366 and monitored its Oregon service area for MED occurrences. All the indices at the circuit and system levels in this report are shown with and without MED events for years 2016-2020. Idaho Power's 2020 threshold in Oregon for a major event day (T_{MED}) per the IEEE 1366 definition was a daily SAIDI of 11.87 minutes per customer. With the additional criterion of a daily customer average interruption duration index (CAIDI) of 5 hours (300 minutes) per OAR 860-023-0161, Idaho Power experienced 1 major event day in its Oregon service area in 2020. Idaho Power's calculated T_{MED} for 2021 in Oregon is 10.19 minutes per customer. The calculation of the T_{MED} and identification of major event days is done while considering all of Idaho Power's Oregon customers.

Compared to 2019, Idaho Power's Oregon service area SAIFI increased by 0.34 interruptions per customer from 0.63 in 2019 to 0.97 in 2020. Excluding major events, SAIFI increased by 0.31 from 0.63 in 2019 to 0.94 in 2020. The average duration of sustained outages also increased compared to last year; SAIDI increased by 1.08 hours per customer from 2.01 in 2019 to 3.09 in 2020. The increase also occurred when excluding major events, as 2020 saw an increase of 1.17 hours per customer over 2019 (1.70 to 2.87). Finally, MAIFI_E decreased in 2020 compared to 2019 by 0.21 momentary interruption events per customer from 2.28 in 2019 to 2.07 in 2020.

The attached charts and tables show Idaho Power's Oregon system performance over the previous five years for SAIFI, SAIDI and MAIFI_E at the system and circuit level in accordance with OAR 860-023-0151 (2)(a). In addition to the reliability indices, a summary of sustained interruption causes is shown at the system level in accordance with OAR 860-023-0151 (2)(b). A table translating Idaho Power's cause categories to the cause categories listed in OAR 860-023-151 (2)(b) can be found in the Appendix. The Appendix also includes supplemental information such as substation, voltage, operating area and customers connected for each distribution circuit in accordance with OAR 860-023-0151 (2)(h). A map is also provided which shows the distribution circuits in Idaho Power's service area with Oregon customers in accordance with OAR 860-023-0151 (2)(g).

Idaho Power continues to collect detailed outage information for all sustained outage events through its Outage Management System (OMS). Historical data from the OMS is stored and circuit performance is analyzed for the prioritization of capital projects to improve reliability. Idaho Power also continues to utilize data from its Smart Grid Monitoring system to calculate MAIFI_E as it has in past years.

Idaho Power continues to implement programs and projects to improve customer service and electric service reliability. Company programs related to electric service reliability include the annual Oregon safety inspection/reliability patrols, the line clearing and vegetation management program, the pole inspection and treatment program, and annual maintenance and capital projects that replace aging assets and improve reliability.

DEFINITIONS

CAIDI – Customer Average Interruption Duration Index; the average duration that a customer experienced per sustained outage (greater than 5 minutes).

CHO – Customer Hours Out; CMI divided by 60.

CI – Customer Interruptions; the total number of customer interruptions from sustained outages (greater than 5 minutes).

CMI – Customer Minutes of Interruption; the total number of customer minutes of interruption from sustained outages (greater than 5 minutes). This is calculated as the product of customer interruptions and outage duration in minutes.

IEEE – The Institute of Electrical and Electronic Engineers.

IEEE 1366 – The Institute of Electrical and Electronic Engineers (IEEE) Standard 1366 entitled *IEEE Guide for Electric Power Distribution Reliability Indices* (the 2012 edition), approved on May 14, 2012 by IEEE-SA Standards Board.

MAIFI_E – Momentary Average Interruption Event Frequency Index; the average number of momentary interruption events per customer (less than or equal to 5 minutes).

Major Event – An event that exceeds the reasonable design and/or operational limits of the electric power system. A major event includes at least one major event day (MED).

MED – Major Event Day; a day when the daily SAIDI exceeds a predefined threshold value.

MedEx – Major Event Day Excluded; this suffix is used after a reliability index to indicate major event days are excluded. For example, SAIFI MedEx is SAIFI excluding major event days.

OMS – Outage Management System; refers to Idaho Power's system for distribution system mobile workforce, switching and outage event tracking.

Operating Area – Idaho Power's customers in Oregon are split into two operating areas: 1) the Jordan Valley region of the reporting area served by the Canyon Operations Center in Caldwell, ID and 2) the rest of the reporting area served by the Western Operations Center in Payette, ID. Approximately 97% of Idaho Power's customers in Oregon are within the Western operating area, while the remaining 3% of Idaho Power's customers in Oregon are within the Canyon operating area.

Reporting Area – Idaho Power's entire service area in Oregon.

SAIDI – System Average Interruption Duration Index; the average duration from all sustained outages that a customer experienced per year (greater than 5 minutes).

SAIFI – System Average Interruption Frequency Index; the average frequency of sustained outages that a customer experienced per year (greater than 5 minutes).

SGM – Smart Grid Monitor; refers to Idaho Power's system for monitoring momentary interruption events on its distribution network.

T_{MED} – A major event day threshold value.

SYSTEM SAIDI, SAIFI AND MAIFI_E

System SAIDI

Year	2016	2017	2018	2019	2020
SAIDI	2.88	3.66	2.47	2.01	3.09
SAIDI MedEx	2.88	3.34	2.47	1.70	2.87

Table 1 Five Years of System SAIDI

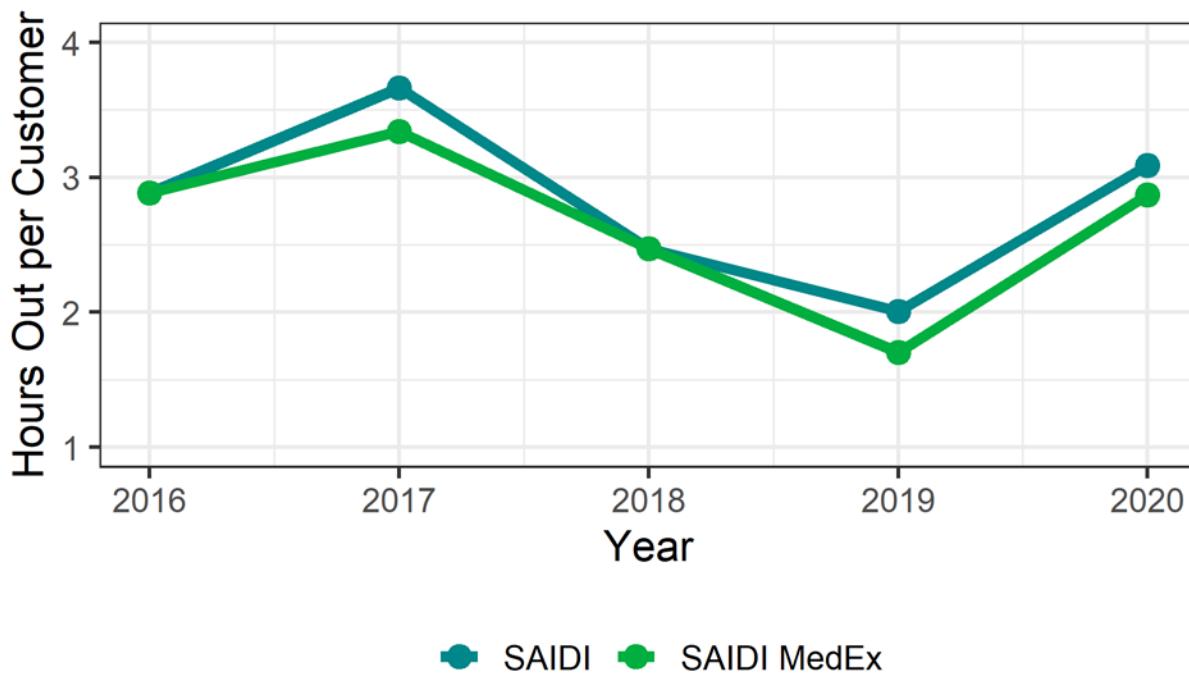


Figure 1 Five Years of System SAIDI

System SAIFI

Year	2016	2017	2018	2019	2020
SAIFI	1.06	1.22	0.95	0.63	0.97
SAIFI MedEx	1.06	1.16	0.95	0.63	0.94

Table 2 Five Years of System SAIFI

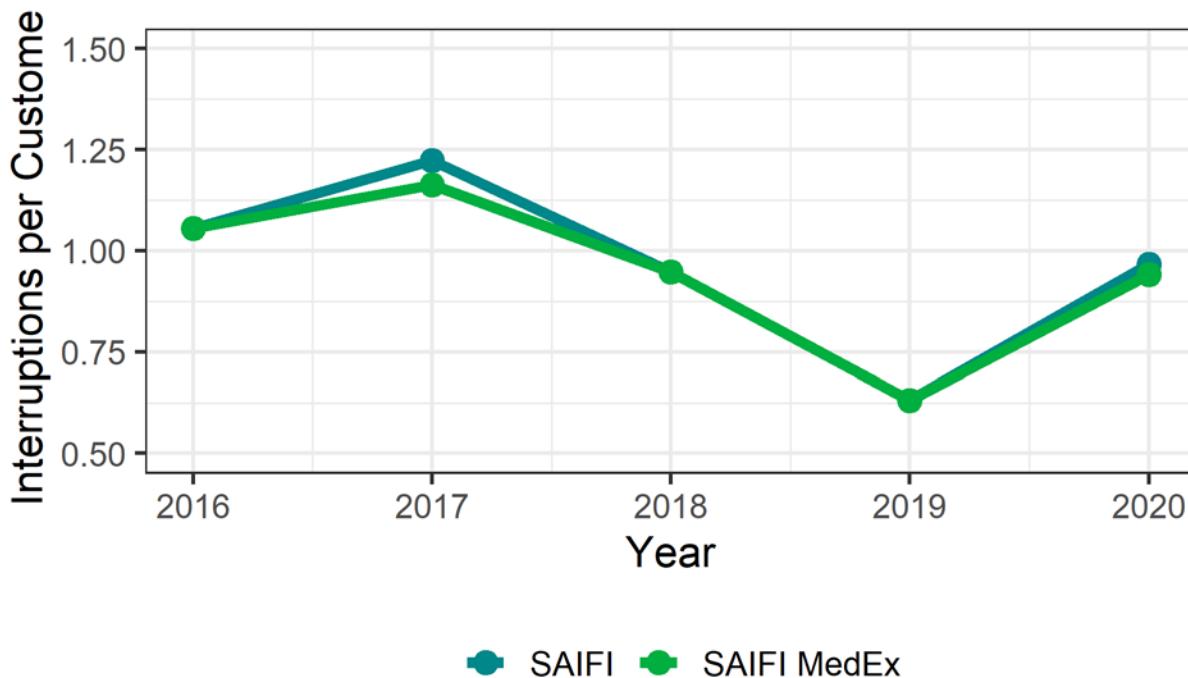
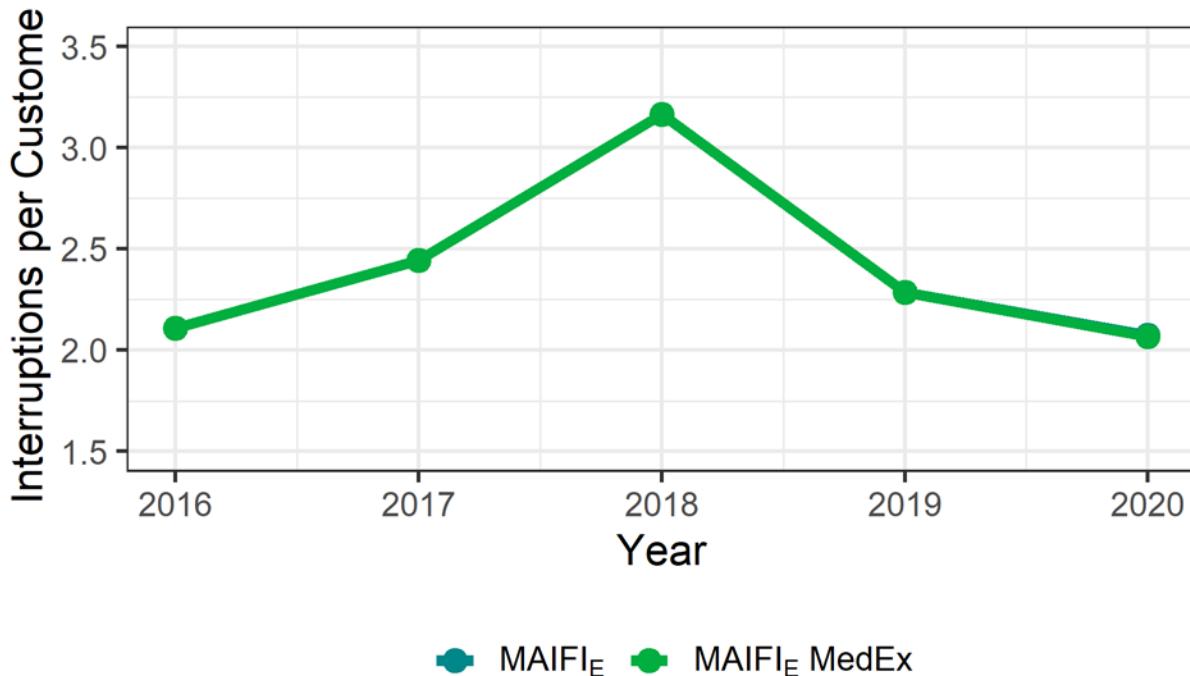


Figure 2 Five Years of System SAIFI

System MAIFI_E

Year	2016	2017	2018	2019	2020
MAIFI _E	2.11	2.44	3.16	2.28	2.07
MAIFI _E MedEx	2.11	2.44	3.16	2.28	2.07

Table 3 Five Years of System MAIFI_EFigure 3 Five Years of System MAIFI_E

Sustained Interruption Event Causes

Cause	Number of Sustained Interruption Events					Percent of Total Sustained Interruption Events				
	2016	2017	2018	2019	2020	2016	2017	2018	2019	2020
Distribution – Equipment	163	277	159	172	150	23.7%	27.5%	24.4%	25.2%	21.5%
Distribution – Lightning	14	17	10	23	8	2.0%	1.7%	1.5%	3.4%	1.1%
Distribution – Other	41	63	46	46	41	6.0%	6.3%	7.1%	6.7%	5.9%
Distribution – Planned	148	114	91	119	133	21.5%	11.3%	14.0%	17.4%	19.0%
Distribution – Public	66	77	59	54	54	9.6%	7.6%	9.1%	7.9%	7.7%
Distribution – Unknown	67	97	72	62	99	9.8%	9.6%	11.1%	9.1%	14.2%
Distribution – Vegetation	28	118	79	91	120	4.1%	11.7%	12.1%	13.3%	17.2%
Distribution – Weather (Non-Lightning)	4	70	16	25	17	0.6%	7.0%	2.5%	3.7%	2.4%
Distribution – Wildlife	111	127	93	82	55	16.2%	12.6%	14.3%	12.0%	7.9%
Loss of Supply – Substation	8	11	7	3	2	1.2%	1.1%	1.1%	0.4%	0.3%
Loss of Supply – Transmission	37	36	19	6	20	5.4%	3.6%	2.9%	0.9%	2.9%
Total	687	1,007	651	683	699	100.0%	100.0%	100.0%	100.0%	100.0%

Table 4 Five Years of Sustained Interruption Event Causes

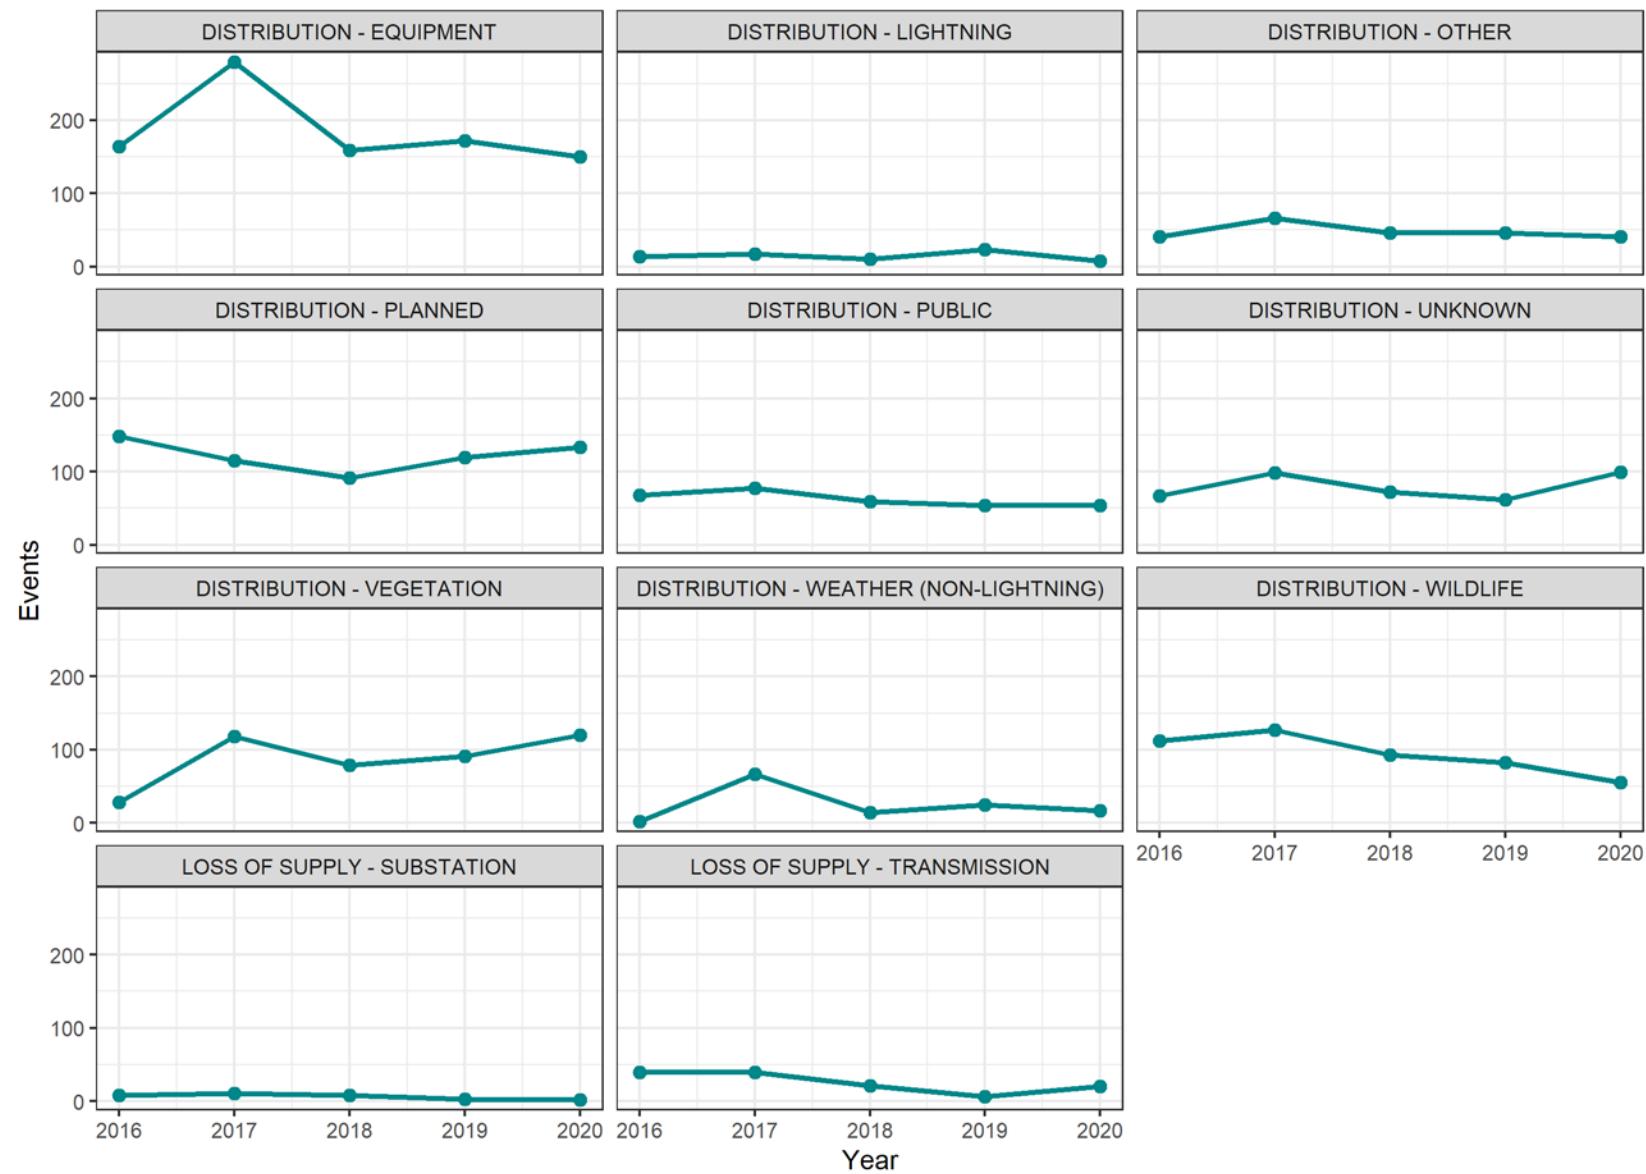


Figure 4 Five Years of Sustained Interruption Events by Cause

Cause	Events	Hours Out	Event Ranking	Hours Out Ranking
Distribution – Equipment	150	545	1	2
Distribution – Lightning	8	32	10	10
Distribution – Other	41	90	7	8
Distribution – Planned	133	532	2	3
Distribution – Public	54	210	6	5
Distribution – Unknown	99	3,304	4	1
Distribution – Vegetation	120	505	3	4
Distribution – Weather (non-Lightning)	17	72	9	9
Distribution – Wildlife	55	147	5	6
Loss of Supply – Substation	2	0	11	11
Loss of Supply – Transmission	20	134	8	7
Total	699	5,572		

Table 5 2020 Sustained Interruption Event Cause Ranking

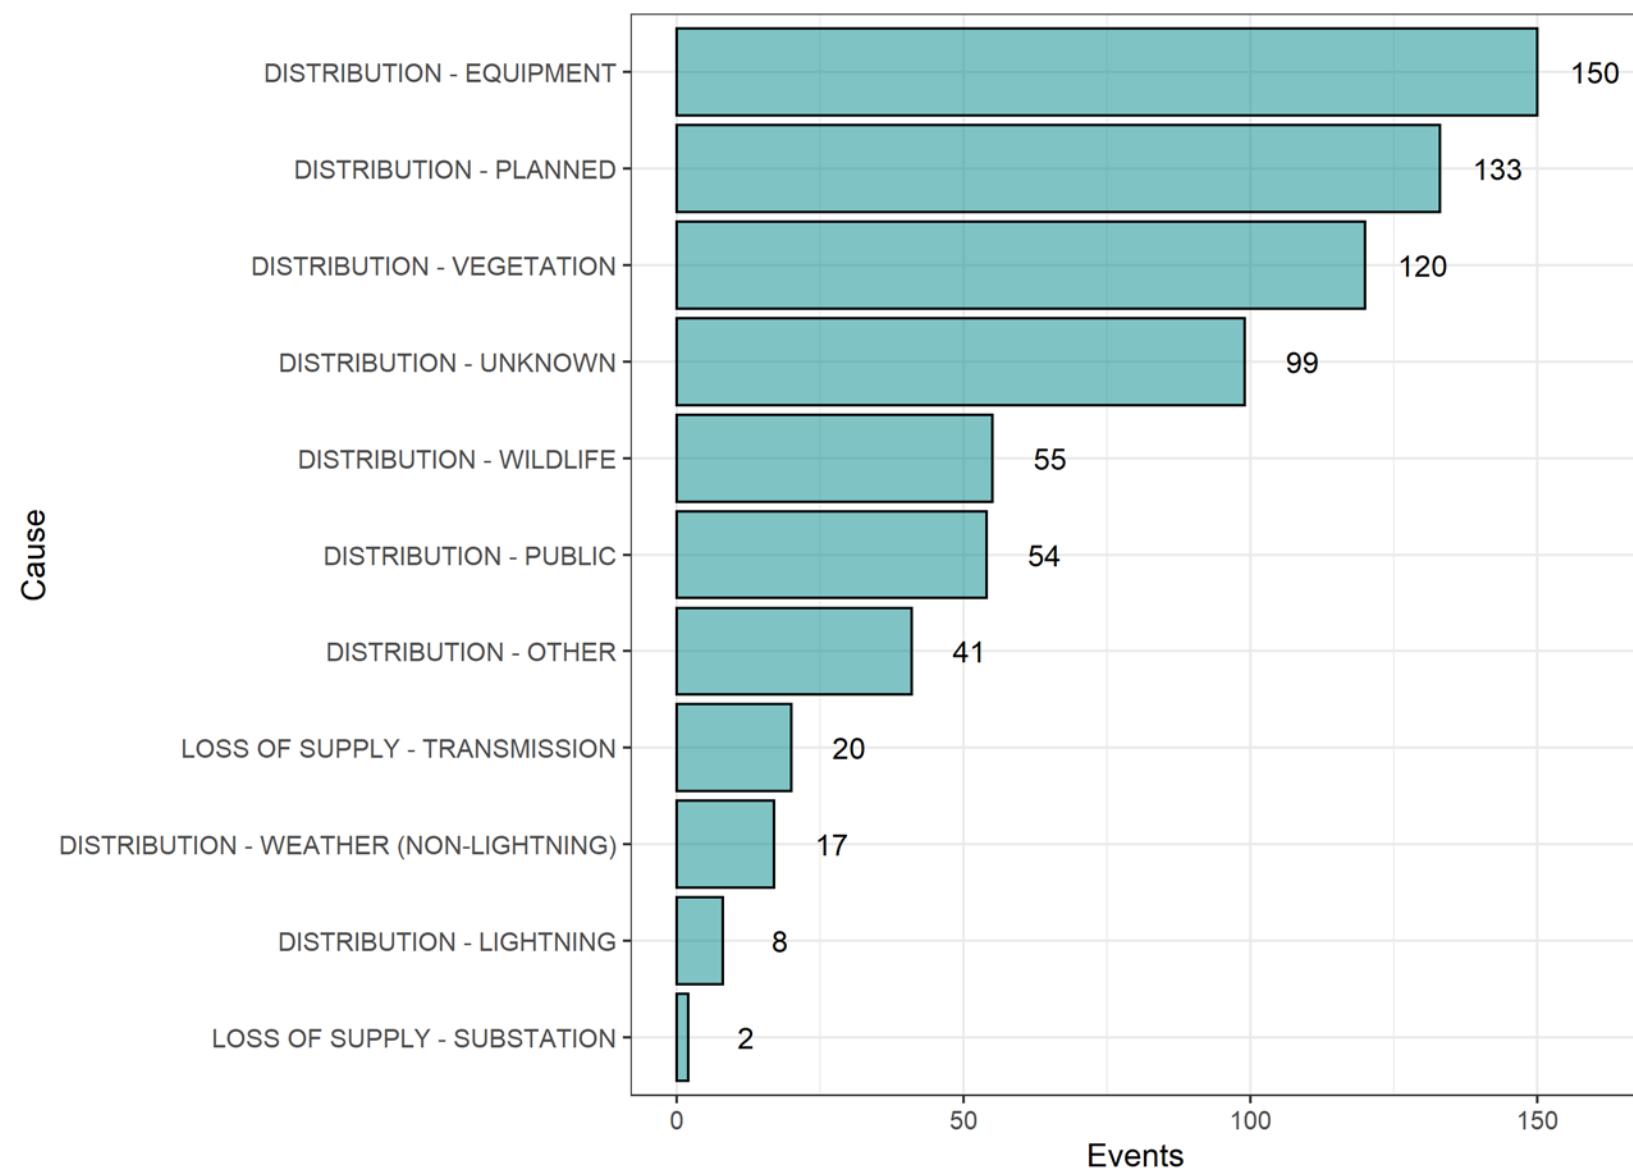



Figure 5 2020 Ranking of Sustained Interruption Event Causes







CIRCUIT SAIDI, SAIFI AND MAIFI_E


Five Years of Circuit SAIDI







Circuit	2016	2017	2018	2019	2020	2020 MedEx
ADRN11	3.22	8.60	0.83	0.99	3.68	3.68
ADRN12	1.12	17.14	0.41	0.19	2.19	2.19
CARO11	1.83	1.49	2.70	0.28	3.89	3.89
CARO12	0.23	1.56	0.99	0.65	0.66	0.66
CARO13	0.00	0.17	0.13	0.16	0.86	0.86
CWVY11	0.95	0.74	16.00	5.93	11.00	11.00
CWVY12	1.26	7.78	10.77	59.83	10.99	10.99
DRKE11	0.61	8.44	0.48	3.70	2.93	2.93
DUKE11	0.00	1.34	1.90	0.11	0.00	0.00
DWSY11	10.16	15.18	15.68	1.94	13.44	13.44
ESTN11	21.72	13.21	15.40	1.27	11.40	11.40
HCSU11	0.00	0.00	0.00	0.00	0.00	0.00
HFWY11	2.14	2.94	2.60	6.70	7.36	7.36
HFWY12	2.42	4.50	7.87	6.20	7.84	0.29
HGTN11	1.66	0.21	0.01	6.00	3.88	3.88
HGTN12	0.21	0.47	0.03	0.13	3.06	3.06
HMDL12	7.82	2.32	1.67	12.11	1.43	1.43
HOLY11	3.85	1.23	0.09	0.43	0.86	0.86
HOLY12	1.58	7.60	0.41	1.72	0.92	0.92
HOLY13	1.68	0.19	1.35	3.69	1.08	1.08
HOLY14	NA	NA	NA	1.33	0.00	0.00
HOPE11	4.93	1.87	3.32	1.36	6.11	6.11
HRPR11	6.18	8.10	2.03	3.66	14.32	14.32
HRPR12	12.11	21.23	6.02	4.54	9.70	9.70
JMSN11	0.82	0.60	2.24	6.41	3.50	3.50
JMSN12	1.35	2.07	1.10	1.18	2.15	2.15
JNTA11	8.95	6.65	3.93	1.31	10.89	10.89
JNTA12	12.95	7.56	4.73	1.33	12.08	12.08
JNVY11	35.11	11.30	2.59	0.17	17.02	17.02
JNVY12	7.75	10.75	1.70	0.10	16.29	16.29
JNVY31	24.13	14.50	3.37	6.40	19.07	19.07
LIME11	3.84	27.62	5.65	1.47	6.87	6.87
MRBT41	0.67	11.96	2.78	2.61	4.15	4.15
MRBT42	0.29	1.54	2.65	1.78	0.00	0.00
NYSA11	0.89	0.37	0.21	3.23	0.10	0.10
NYSA12	13.97	6.95	1.87	1.12	0.20	0.20
NYSA13	6.68	0.27	0.22	0.77	1.71	1.71
NYSA14	3.65	0.12	0.22	1.21	0.31	0.31
OBPR11	0.00	0.00	0.00	0.00	0.00	0.00
OIDA11	0.94	1.12	0.78	1.73	2.77	2.77
OIDA12	0.70	2.80	0.00	5.58	0.00	0.00
ONTO14	0.42	0.54	0.00	0.04	0.00	0.00
ONTO18	0.21	0.12	1.48	0.55	0.03	0.03
ONTO19	0.40	0.69	2.05	0.59	0.55	0.55
ONTO20	1.05	0.64	0.51	0.63	0.98	0.98
ONTO23	0.52	4.07	0.28	0.00	0.00	0.00
ONTO24	0.46	5.23	11.00	2.13	0.48	0.48
ONTO25	0.13	0.37	0.12	1.50	0.03	0.03
OYDM11	0.00	3.48	0.28	2.97	0.00	0.00
PNCK11	12.71	0.26	0.69	1.38	27.39	27.39
PNCK12	6.73	3.17	0.00	0.00	4.48	4.48
PRMA12	13.68	7.22	5.04	0.23	0.00	0.00
PRMA42	3.59	12.84	7.15	0.89	5.95	5.95
RKVL11	9.57	4.61	1.29	0.30	17.07	17.07
UNTY11	34.95	27.58	12.35	0.30	5.99	5.99
UNTY12	3.44	17.21	11.57	0.81	6.85	6.85
VALE11	0.17	1.09	0.92	0.33	0.10	0.10
VALE12	0.00	1.07	0.15	0.00	0.00	0.00
VALE13	0.52	3.68	0.69	0.34	3.42	3.42
VALE14	0.11	2.93	6.49	0.31	3.14	3.14
VALE15	4.94	1.82	2.72	0.26	0.48	0.48
WESR13	0.29	3.21	1.89	1.37	1.04	1.04
WESR14	0.85	12.55	6.98	1.62	1.71	1.71







Table 6 Five Years of Circuit SAIDI






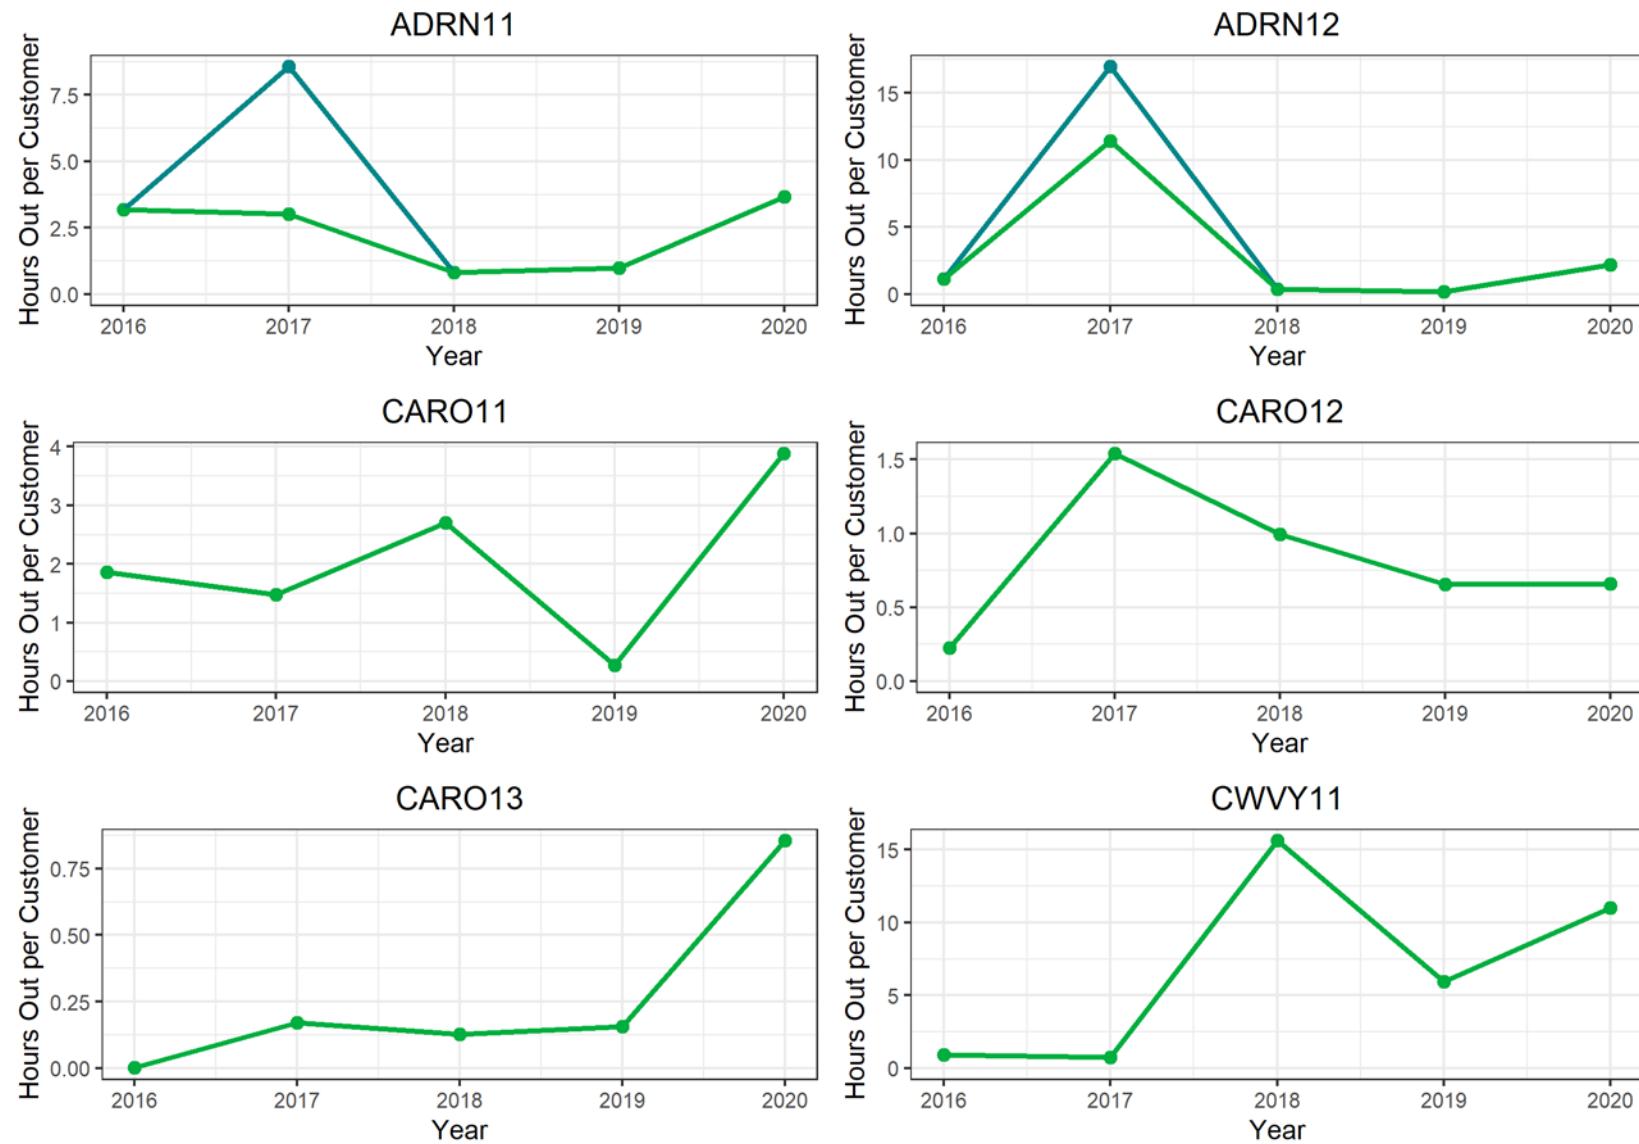


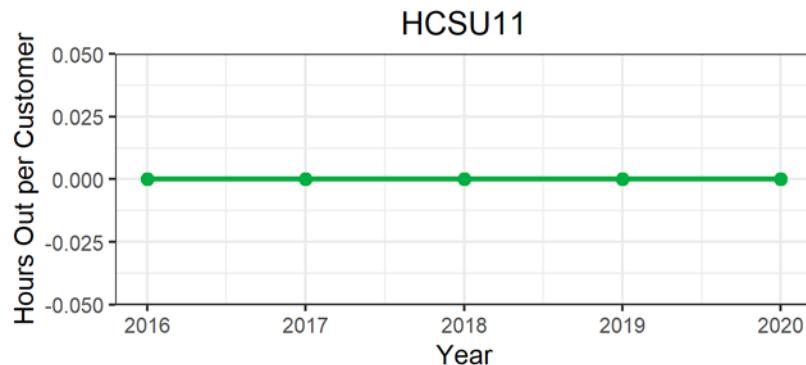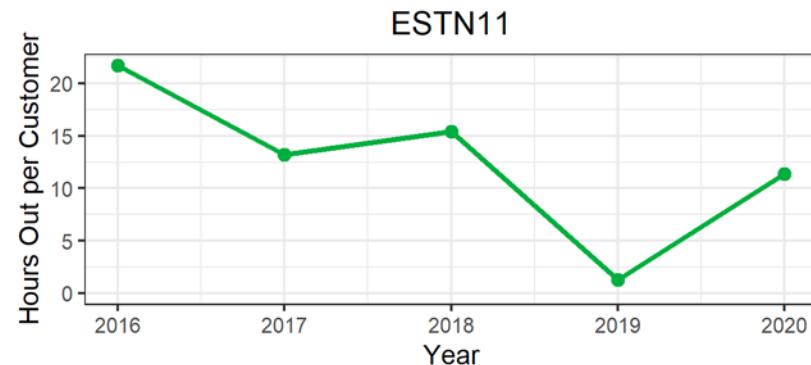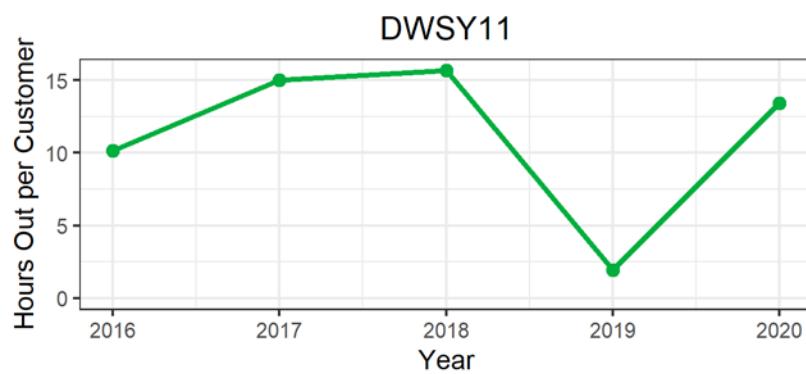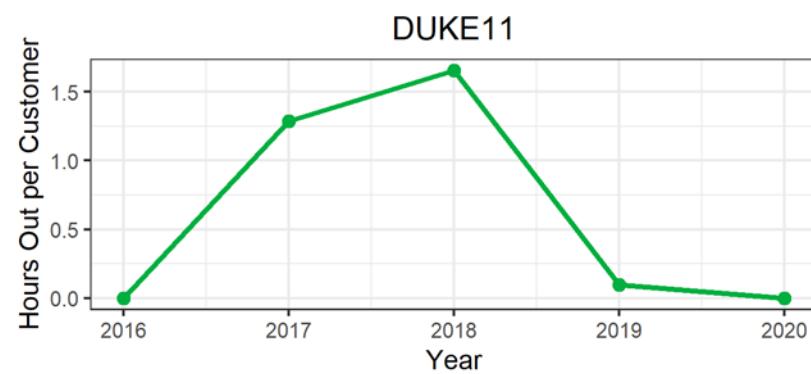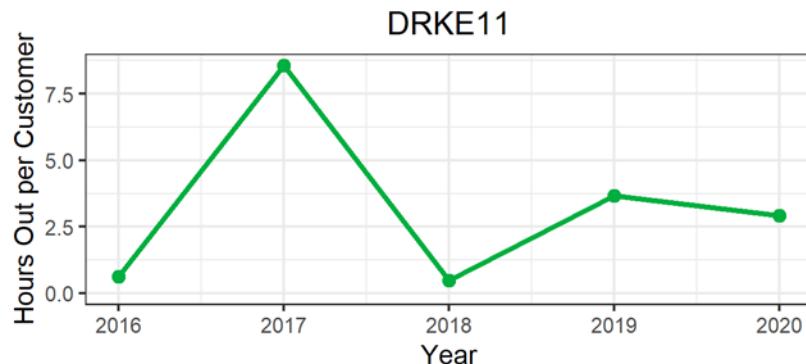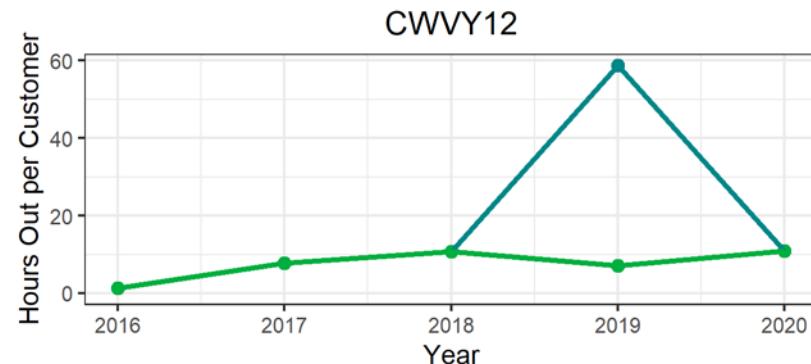







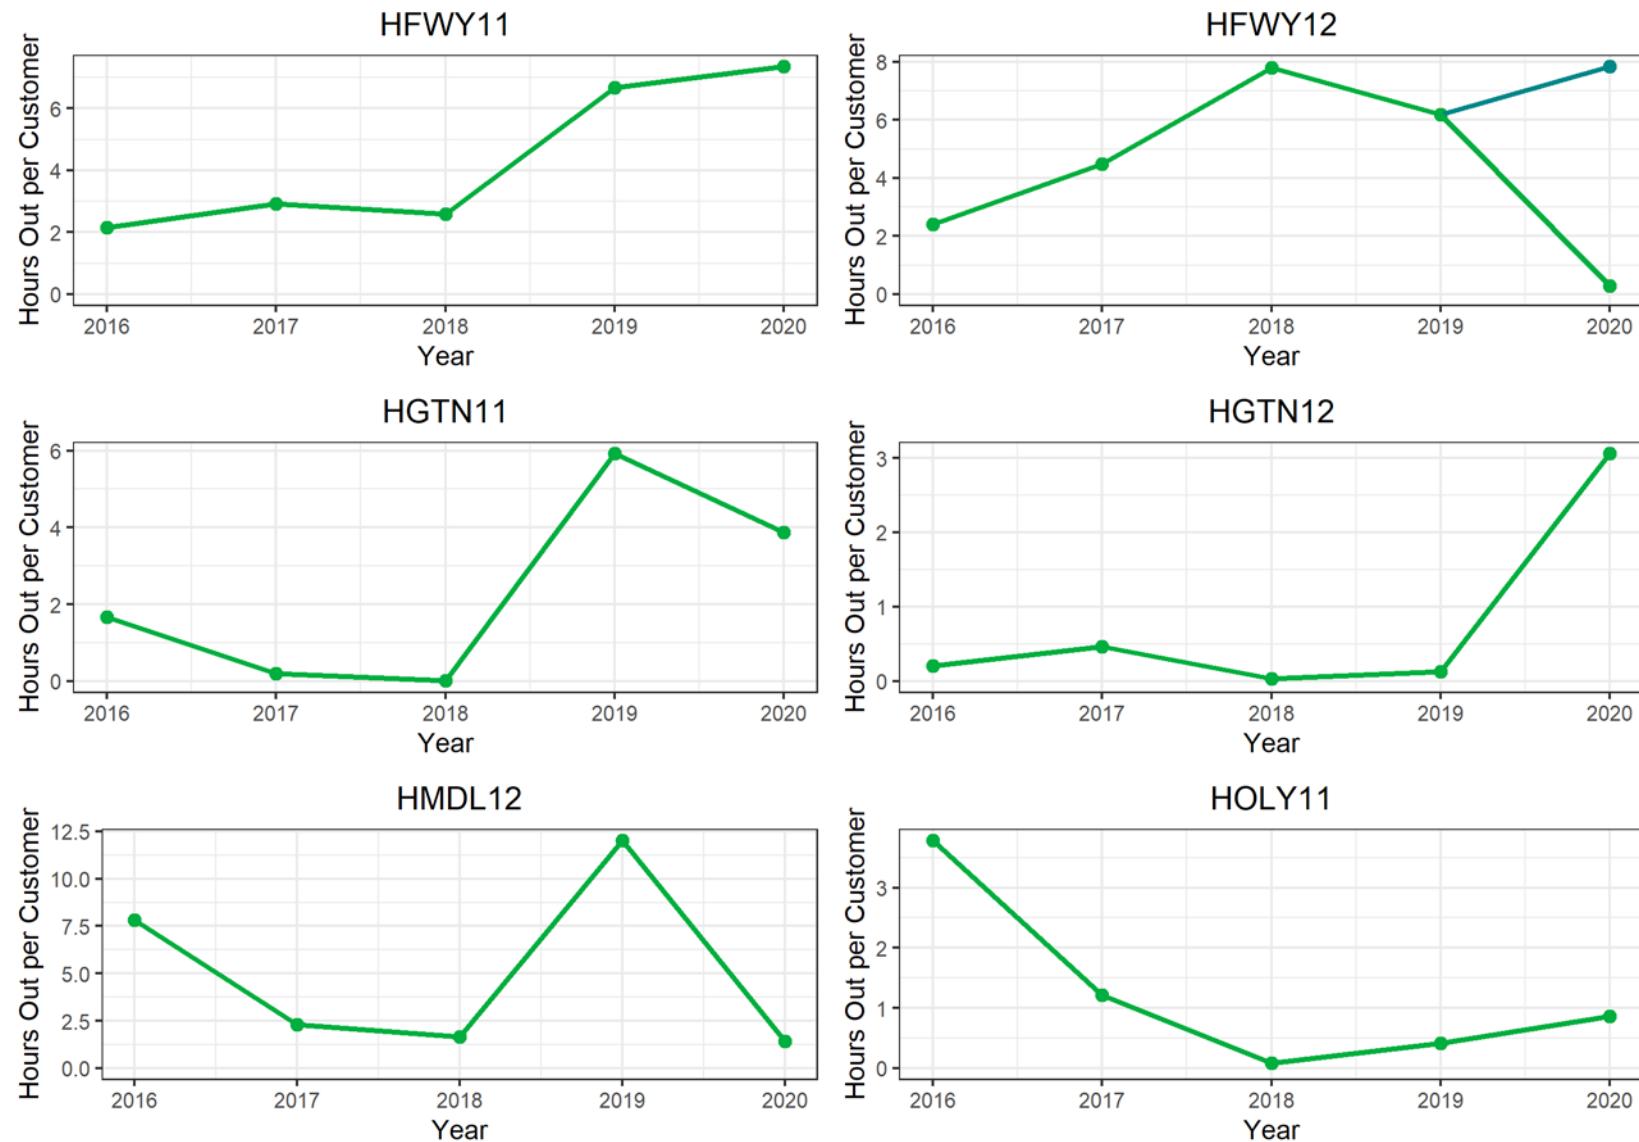


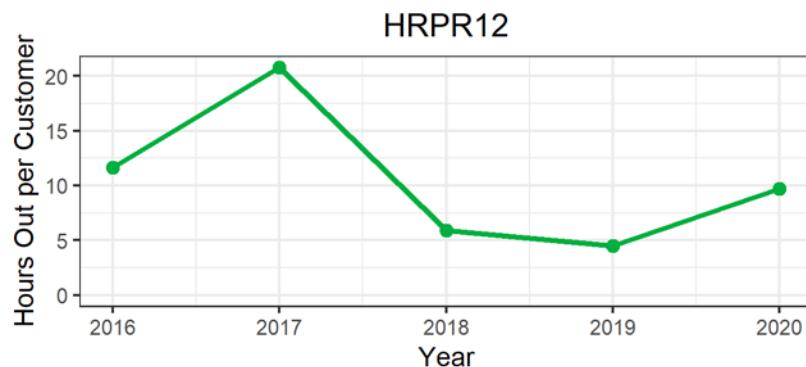
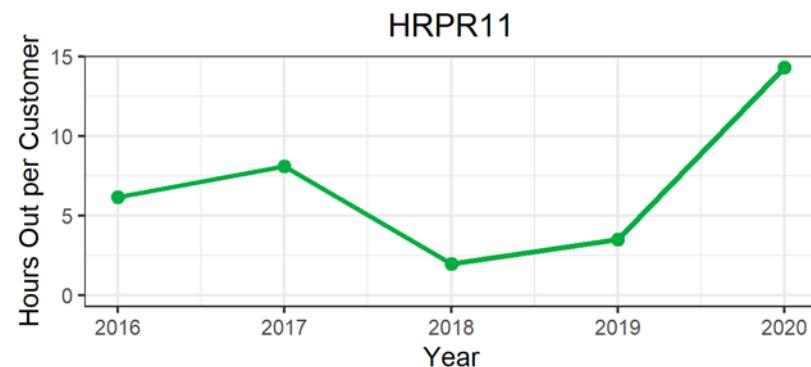
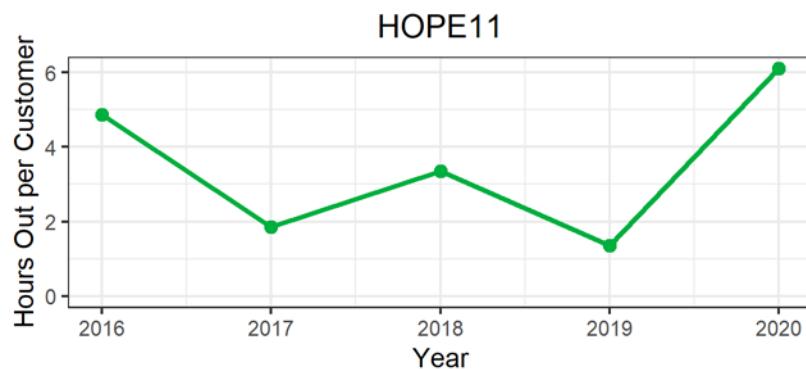
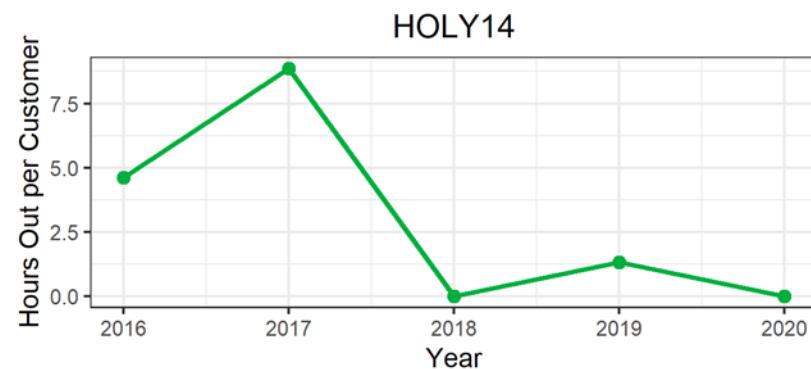
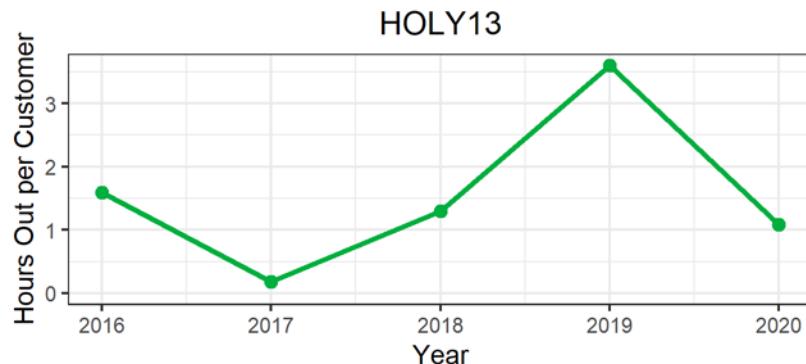
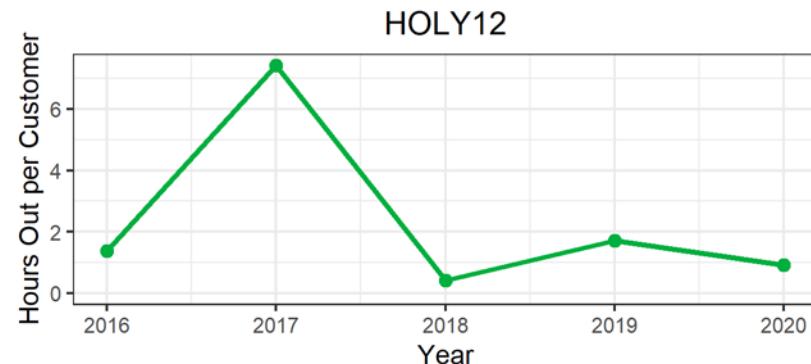


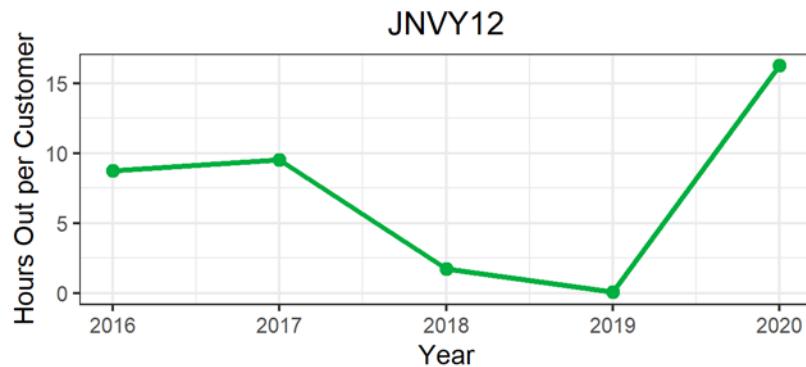
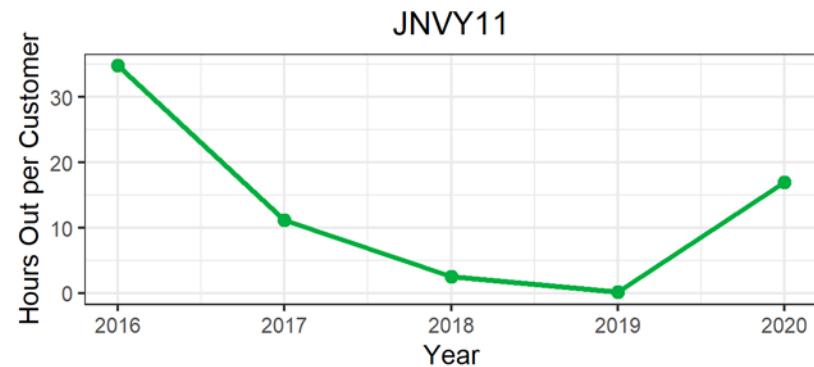
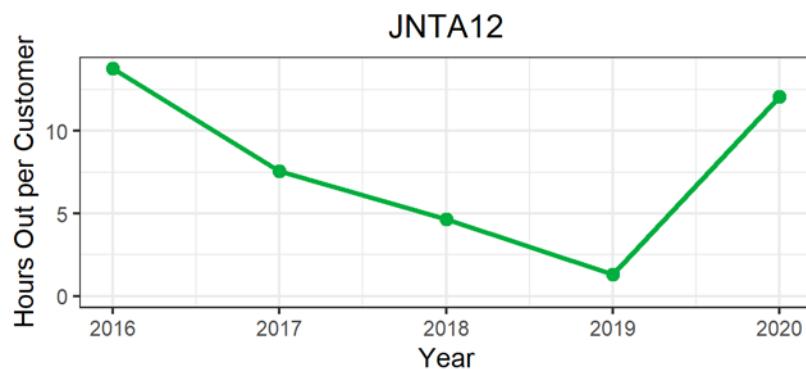
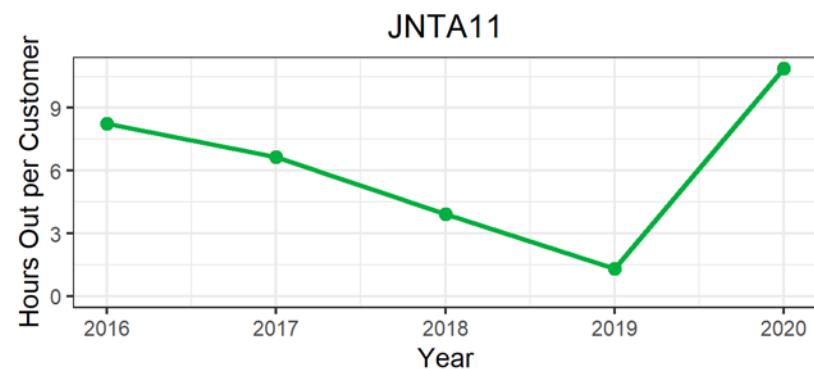
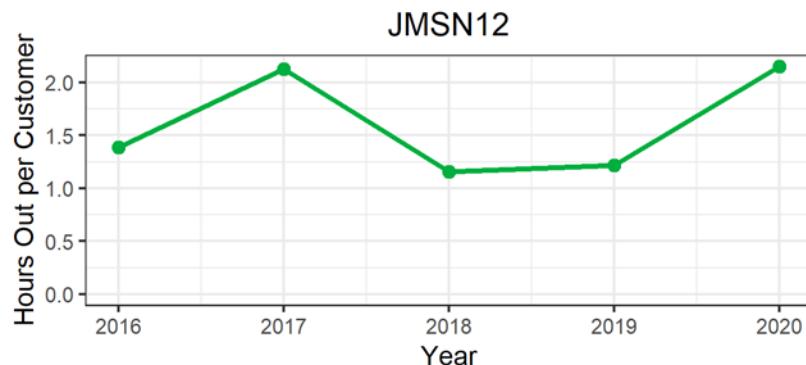
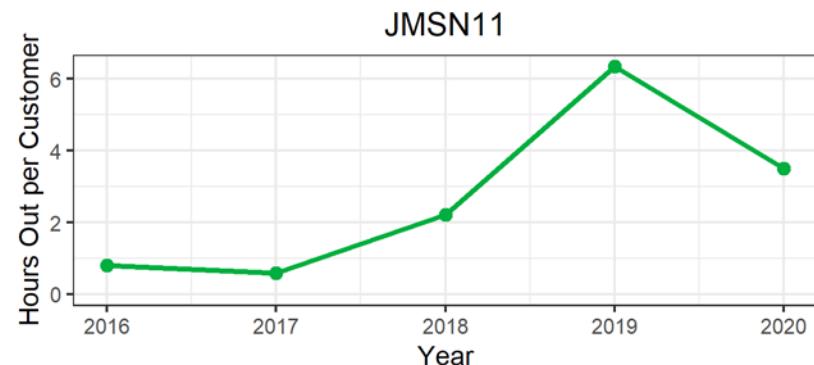


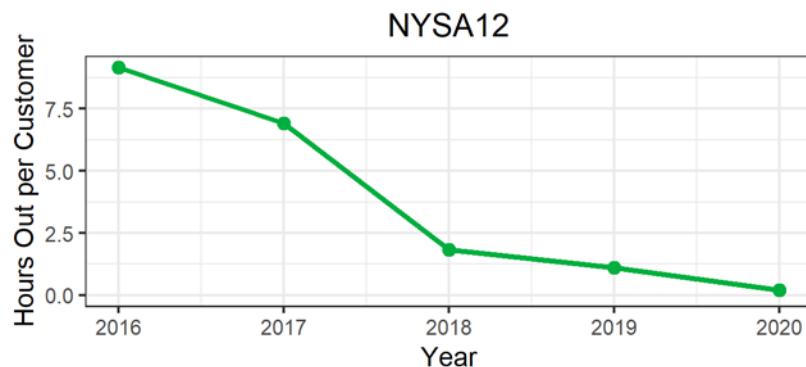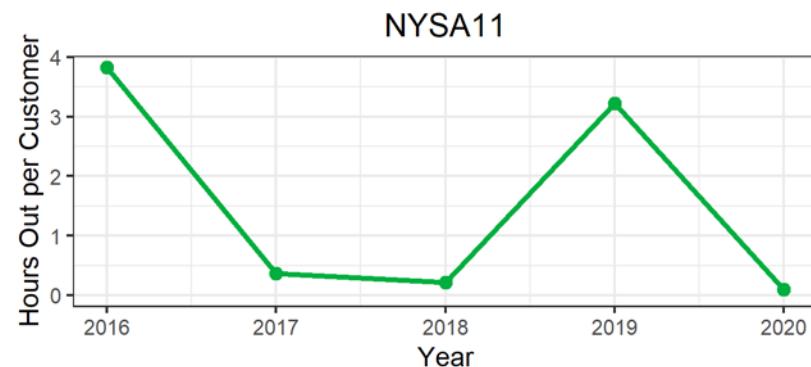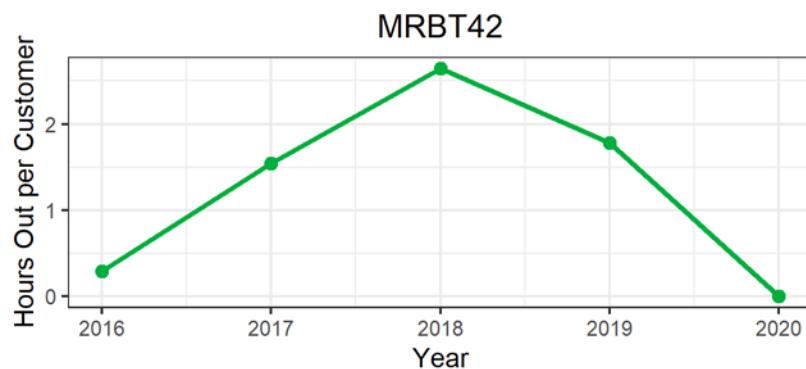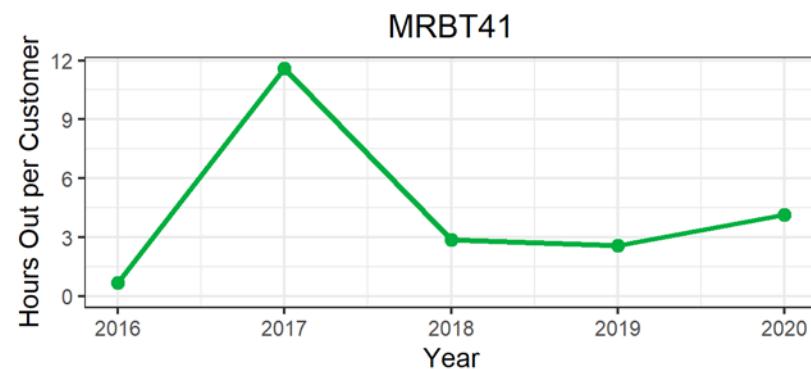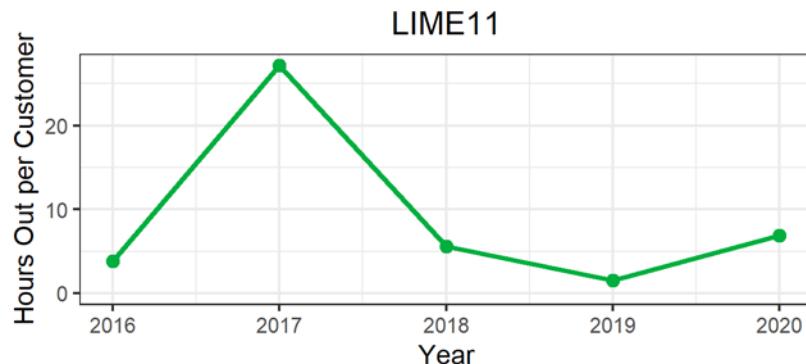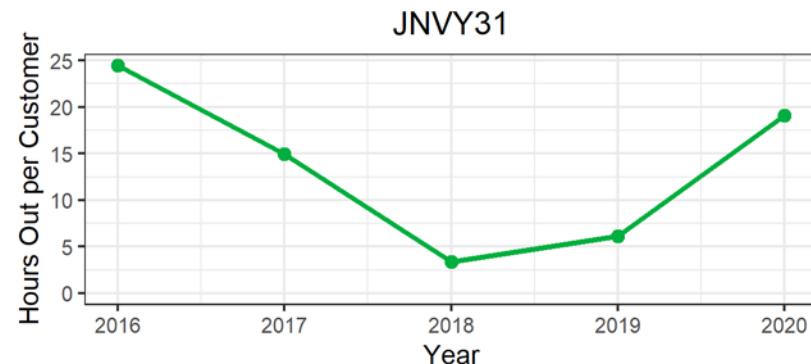

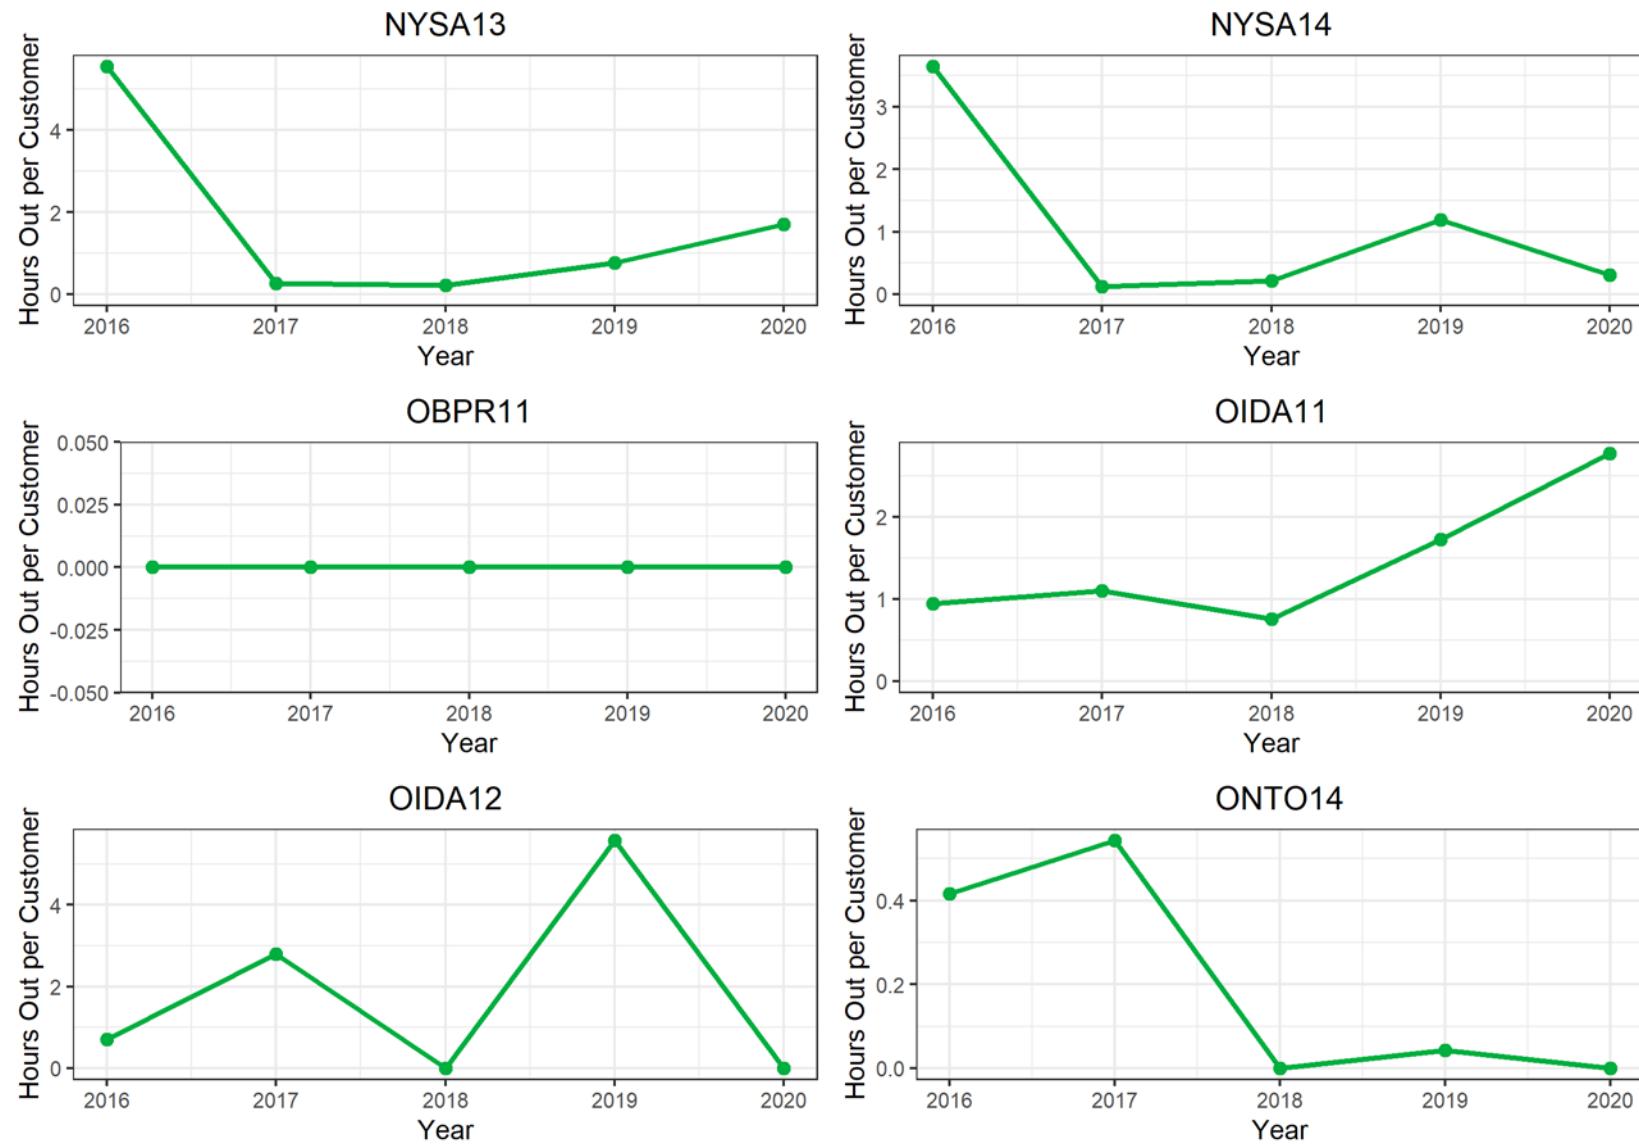

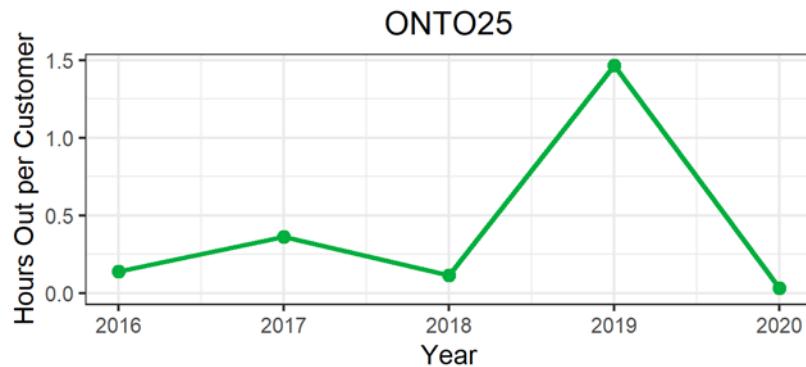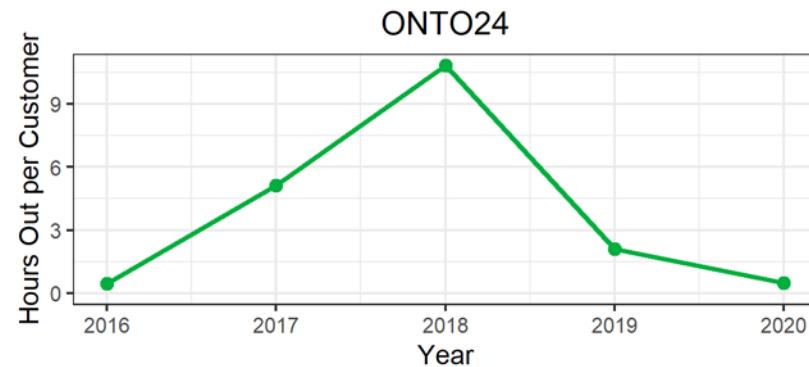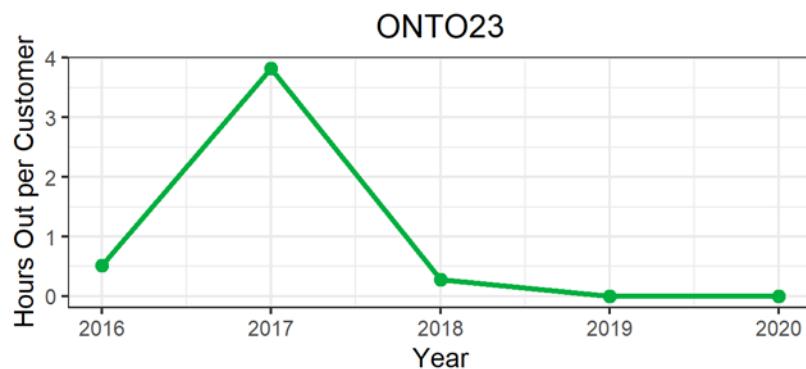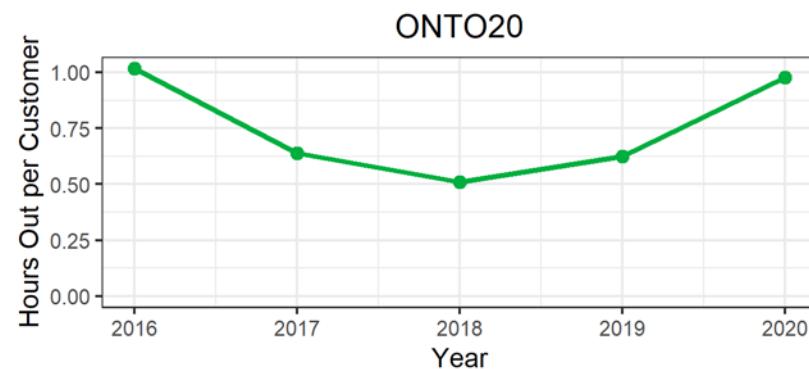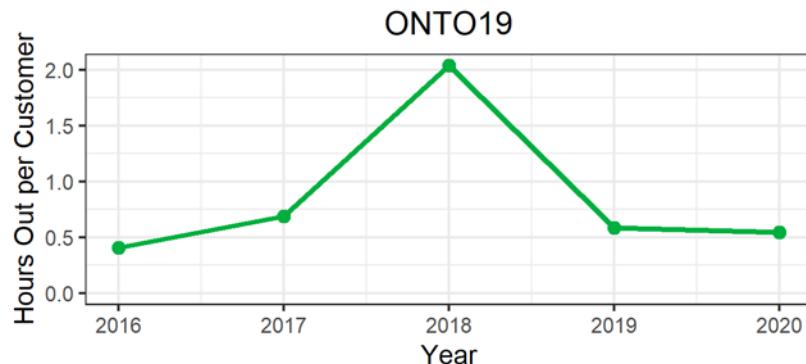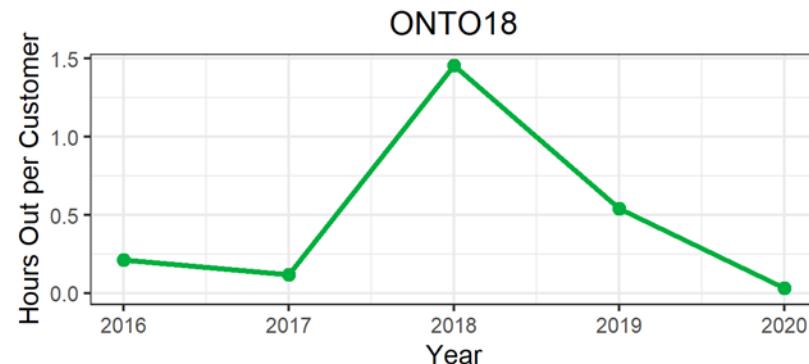

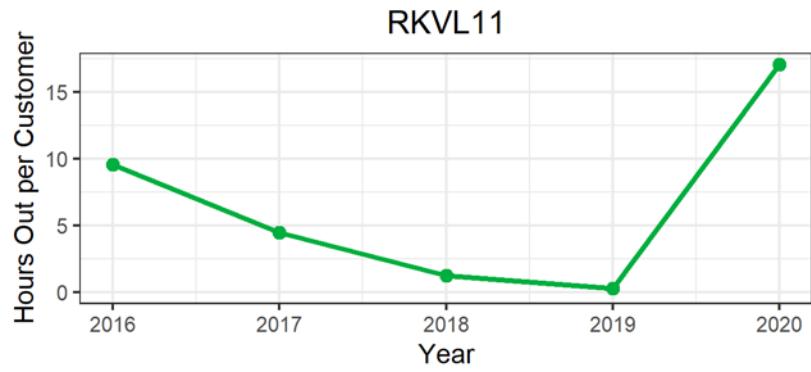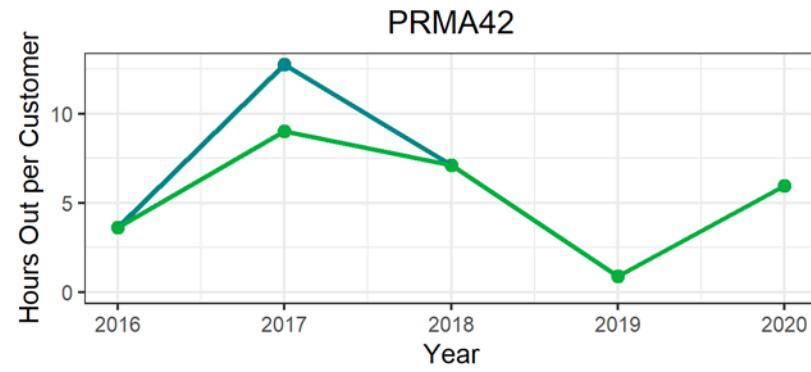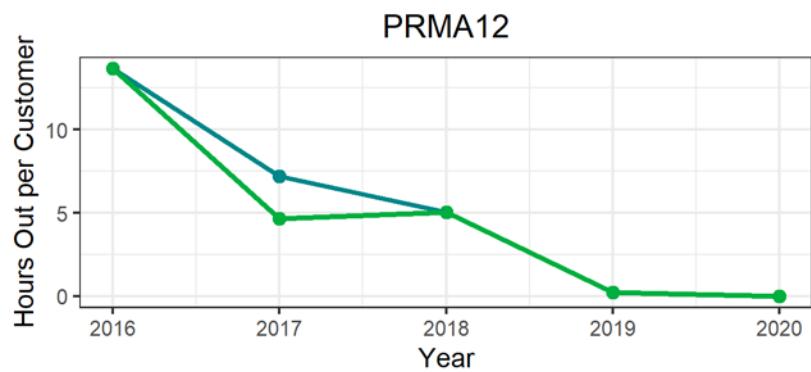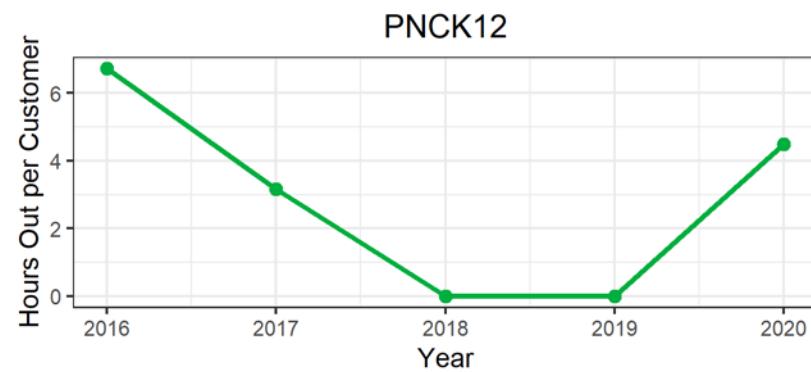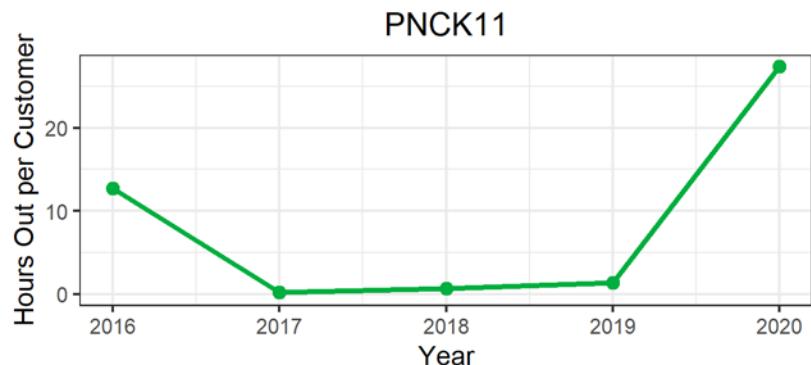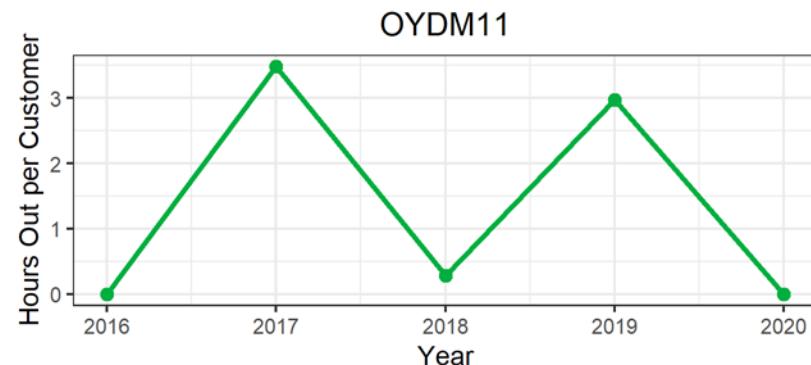

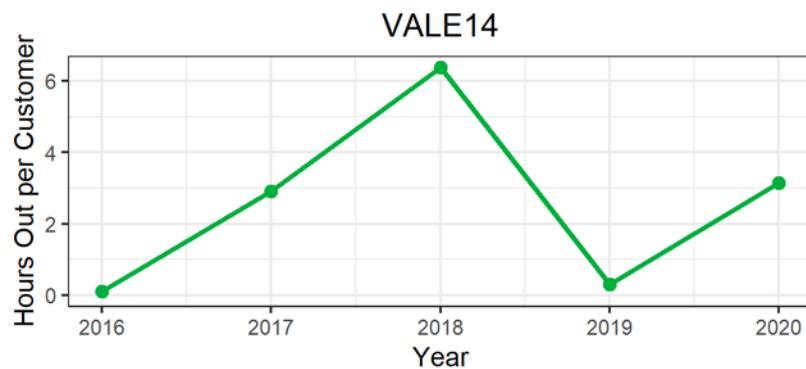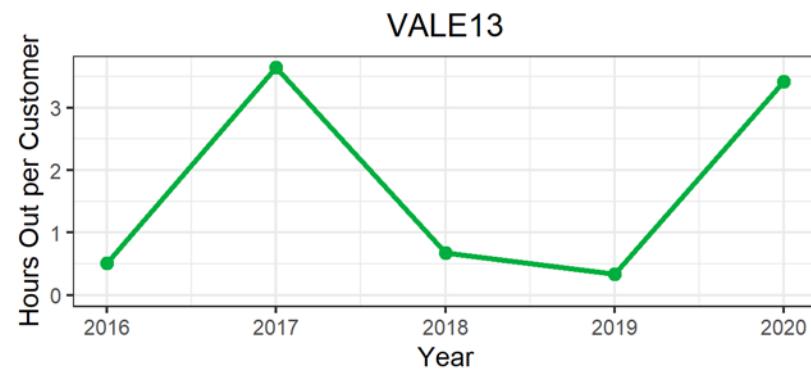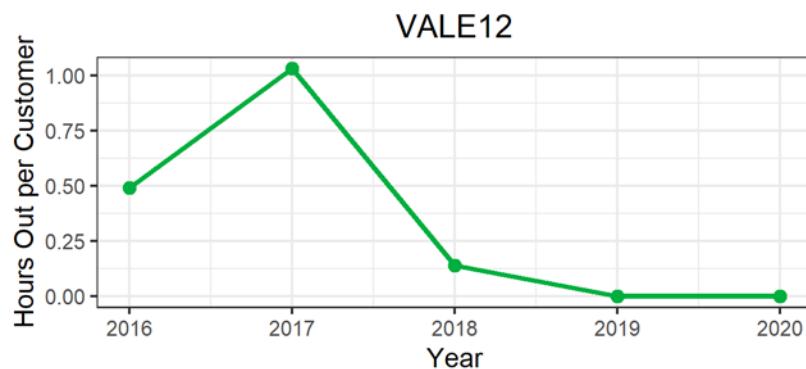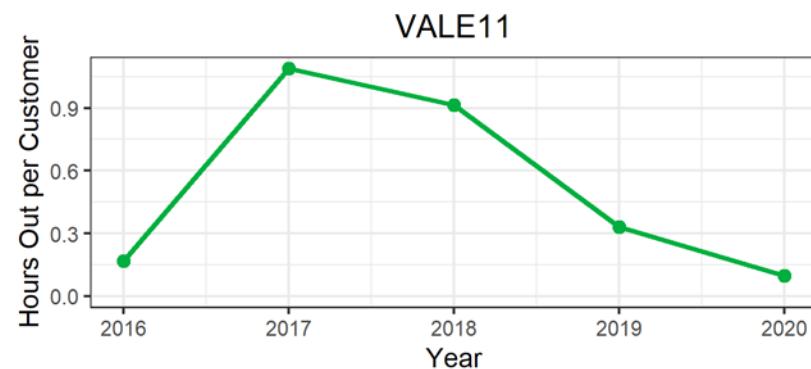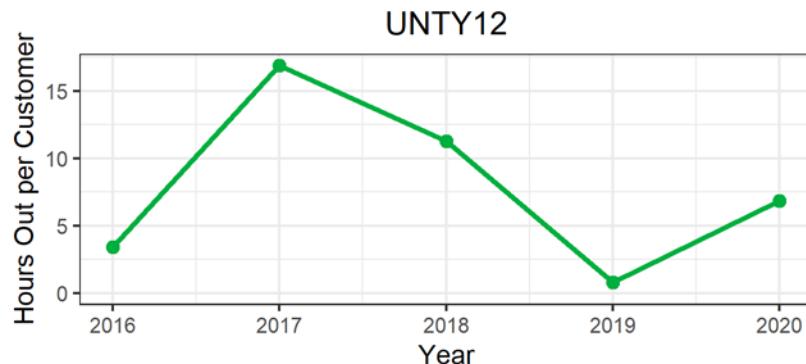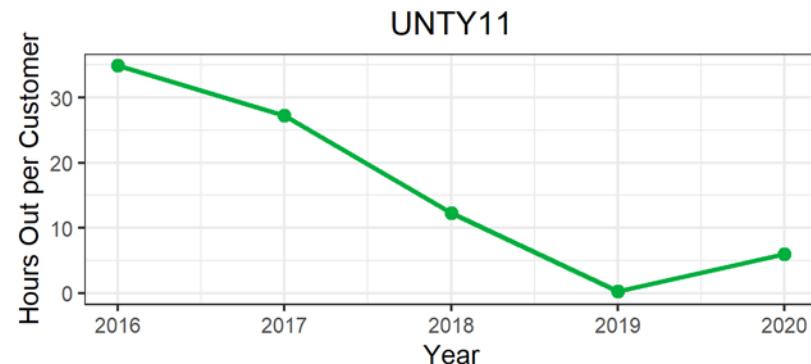

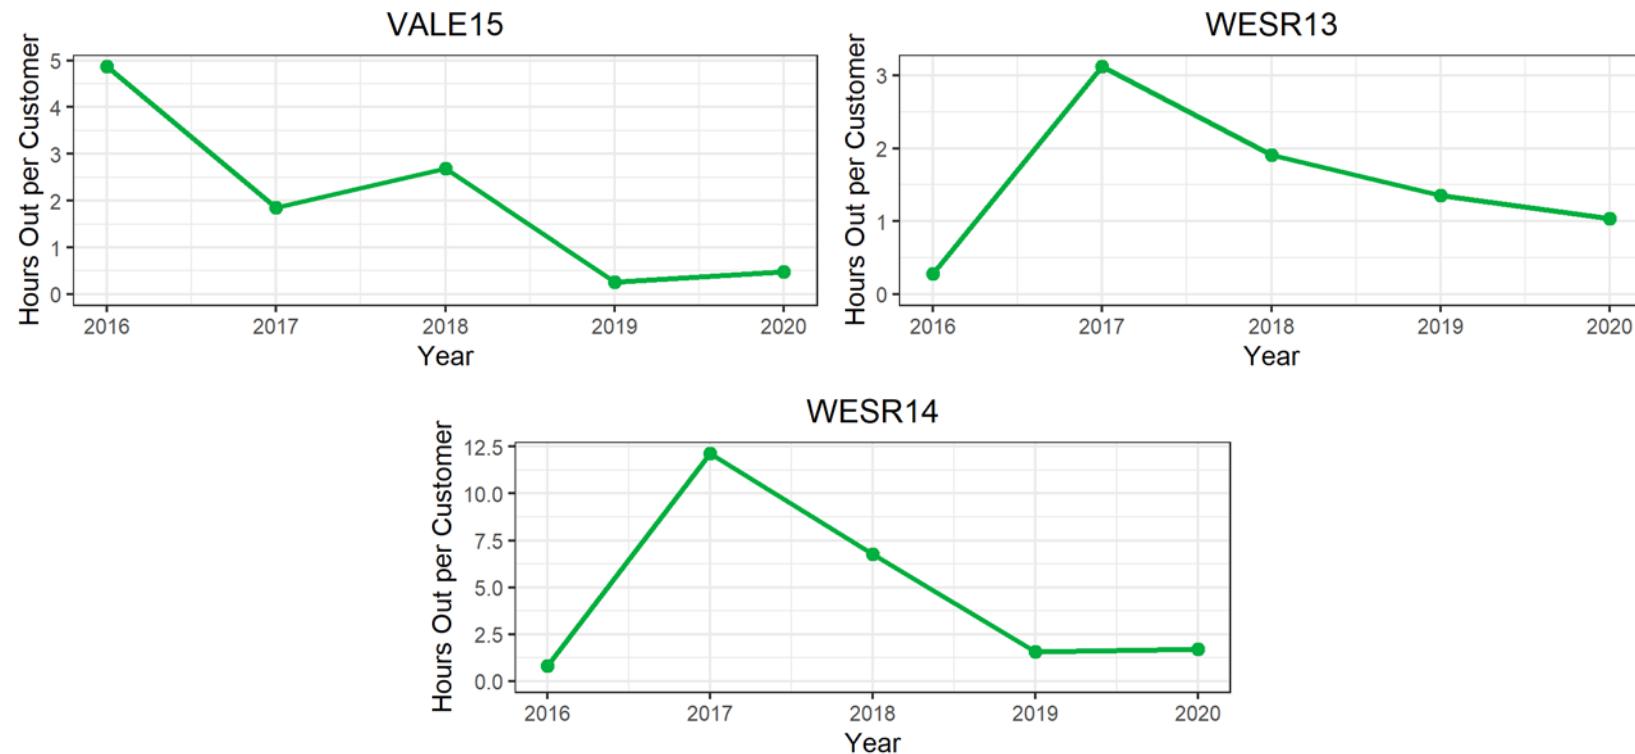








Figure 6 Five Years of Circuit SAIDI


Five Years of Circuit SAIFI







Circuit	2016	2017	2018	2019	2020	2020 MedEx
ADRN11	2.21	2.85	1.29	0.48	2.14	2.14
ADRN12	1.29	3.84	0.11	0.08	1.29	1.29
CARO11	0.79	0.62	0.30	0.27	0.57	0.57
CARO12	0.16	1.87	0.46	0.26	0.30	0.30
CARO13	0.00	0.11	0.06	0.10	1.04	1.04
CWVY11	0.42	1.20	2.14	1.02	2.17	2.17
CWVY12	0.20	1.27	1.13	1.74	2.15	2.15
DRKE11	0.20	2.46	0.18	1.27	1.25	1.25
DUKE11	0.00	1.48	1.04	0.04	0.00	0.00
DWSY11	3.10	2.87	4.63	1.16	4.06	4.06
ESTN11	5.33	4.67	5.00	1.00	4.00	4.00
HCSU11	0.00	0.00	0.00	0.00	0.00	0.00
HFwy11	1.08	1.71	1.23	1.46	1.39	1.39
HFwy12	1.17	2.36	2.32	1.46	1.13	0.21
HGTN11	1.00	0.34	0.01	1.65	1.06	1.06
HGTN12	0.19	0.24	0.01	0.08	1.06	1.06
HMDL12	3.13	1.64	1.13	4.89	1.17	1.17
HOLY11	1.27	0.26	0.08	0.17	0.47	0.47
HOLY12	1.18	1.43	0.24	1.10	0.38	0.38
HOLY13	1.09	0.11	1.37	0.30	0.61	0.61
HOLY14	NA	NA	NA	1.20	0.00	0.00
HOPE11	3.19	1.28	1.57	1.05	1.32	1.32
HRPR11	1.53	1.49	1.10	1.47	4.42	4.42
HRPR12	3.34	3.21	1.04	1.91	3.68	3.68
JMSN11	0.36	0.37	1.23	0.34	1.88	1.88
JMSN12	0.33	1.16	1.07	0.33	1.12	1.12
JNTA11	3.33	1.00	2.03	1.02	3.16	3.16
JNTA12	3.96	1.23	2.24	1.02	3.19	3.19
JNvy11	3.25	2.26	1.11	0.20	4.14	4.14
JNvy12	2.00	2.26	1.16	0.05	3.86	3.86
JNvy31	6.09	3.66	3.01	0.86	4.57	4.57
LIME11	0.77	2.44	1.46	0.53	2.33	2.33
MRBT41	0.50	1.22	2.15	1.59	2.03	2.03
MRBT42	0.22	1.00	3.00	1.55	0.00	0.00
NYSA11	1.36	0.19	0.18	1.44	0.05	0.05
NYSA12	4.42	3.21	1.33	1.24	1.02	1.02
NYSA13	2.36	0.16	0.15	0.34	0.78	0.78
NYSA14	1.47	0.05	0.14	1.29	0.23	0.23
OBPR11	0.00	0.00	0.00	0.00	0.00	0.00
OIDA11	0.24	0.74	0.29	1.15	1.63	1.63
OIDA12	1.00	2.00	0.00	2.00	0.00	0.00
ONTO14	1.00	1.09	0.00	0.06	0.00	0.00
ONTO18	0.12	0.06	1.12	0.30	0.02	0.02
ONTO19	0.14	0.29	1.22	0.31	0.19	0.19
ONTO20	1.22	0.17	0.32	0.35	0.49	0.49
ONTO23	0.13	2.17	0.21	0.00	0.00	0.00
ONTO24	0.44	1.69	2.85	1.39	0.38	0.38
ONTO25	0.19	0.13	0.17	1.08	0.04	0.04
OYDM11	0.00	0.93	0.13	0.93	0.00	0.00
PNCK11	2.91	0.96	0.25	0.35	4.82	4.82
PNCK12	1.00	1.00	0.00	0.00	1.00	1.00
PRMA12	8.00	3.00	2.33	1.00	0.00	0.00
PRMA42	1.66	4.60	2.64	0.30	2.15	2.15
RKVL11	2.52	2.25	1.00	0.03	5.22	5.22
UNTY11	1.17	6.21	2.15	0.16	2.10	2.10
UNTY12	0.90	6.81	2.06	0.21	1.65	1.65
VALE11	0.10	1.59	0.74	0.14	0.03	0.03
VALE12	0.00	0.50	0.14	0.00	0.00	0.00
VALE13	0.23	1.18	0.33	0.18	0.54	0.54
VALE14	0.05	0.91	1.59	0.12	1.67	1.67
VALE15	2.84	1.37	1.69	0.12	0.20	0.20
WESR13	0.19	2.34	1.08	0.78	0.61	0.61
WESR14	0.43	3.23	3.73	1.23	1.29	1.29







Table 7 Five Years of Circuit SAIFI









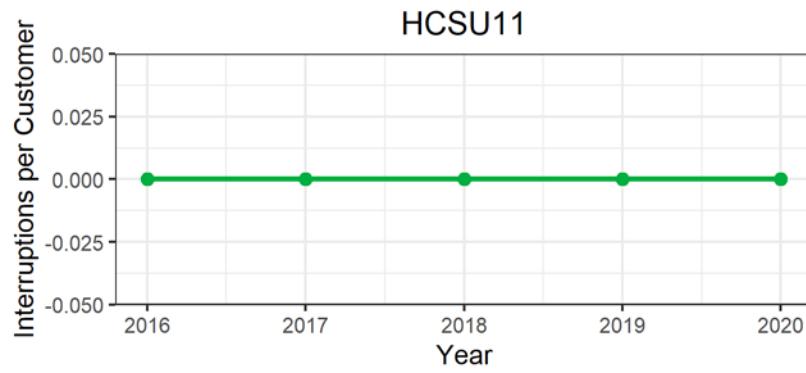
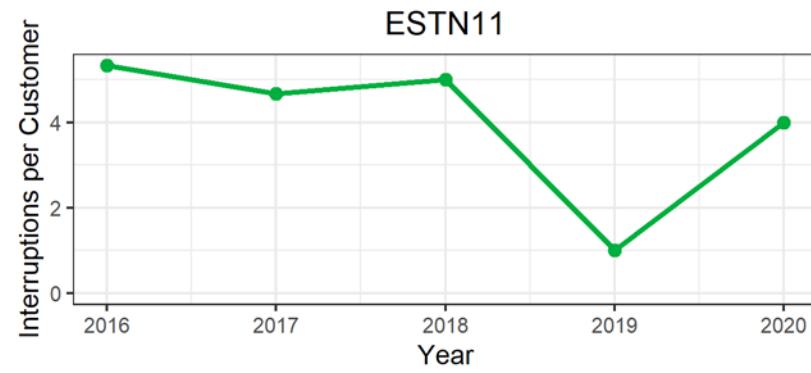
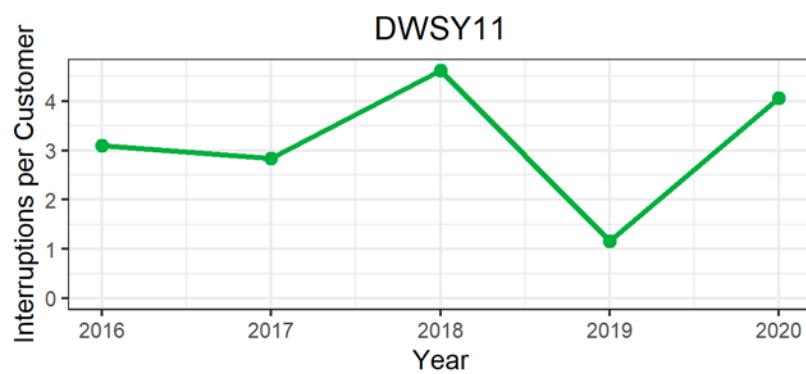
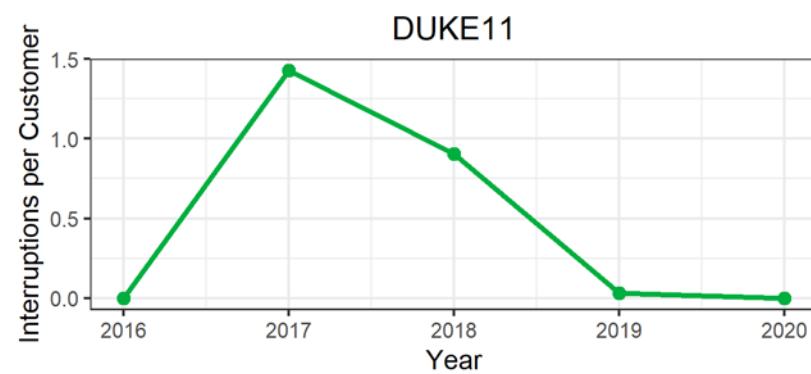
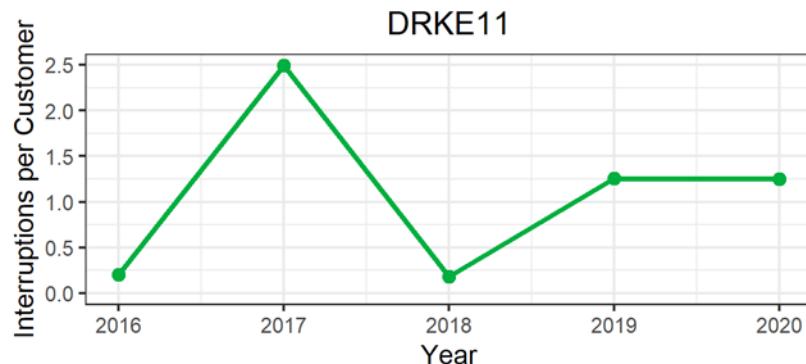
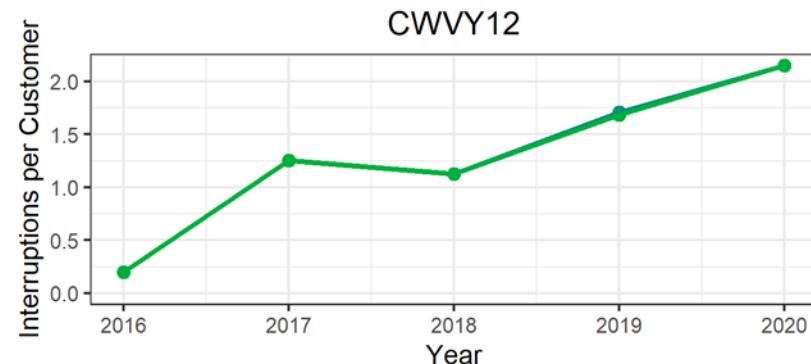







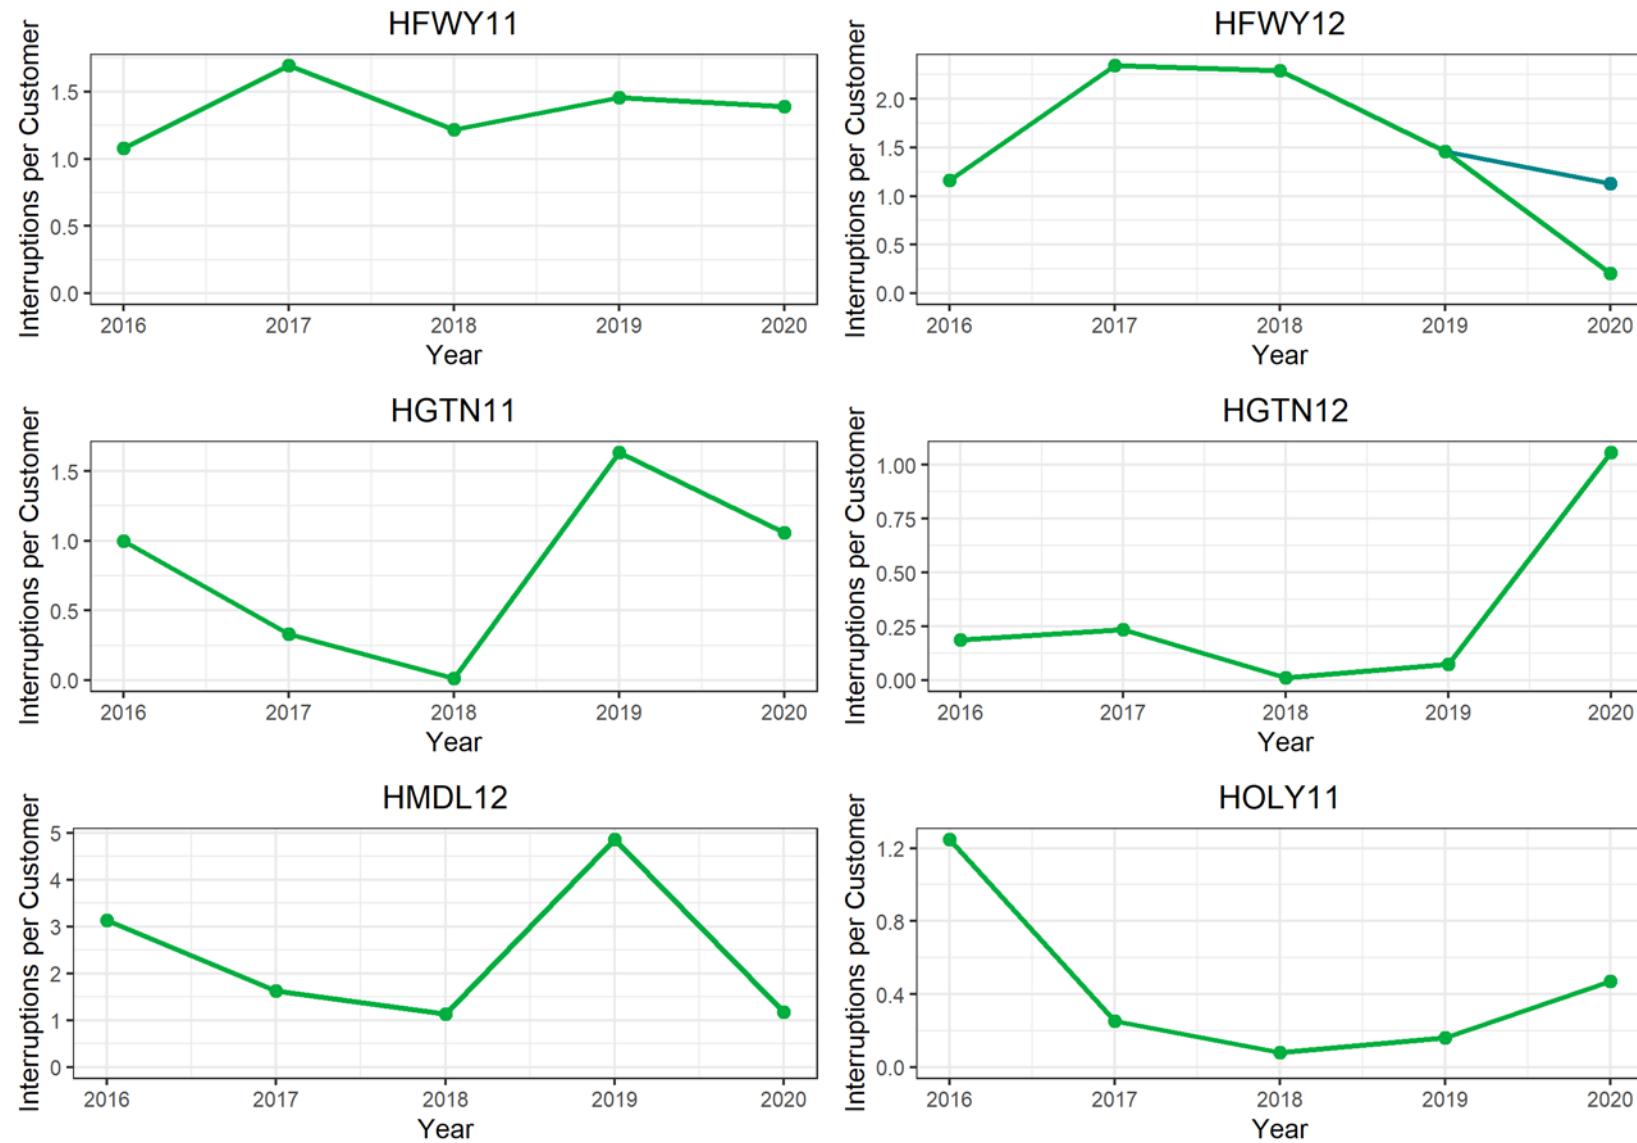


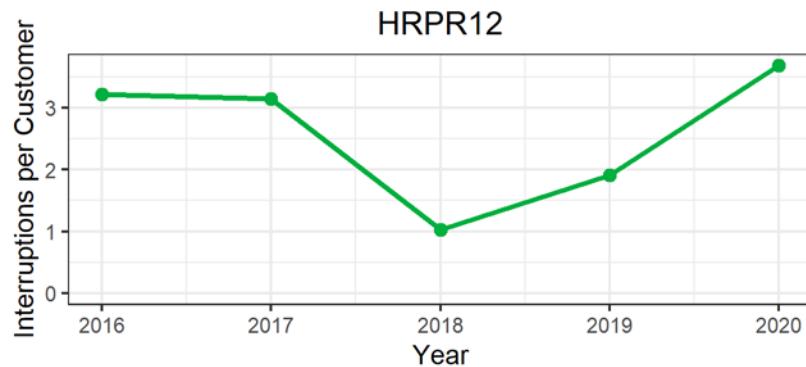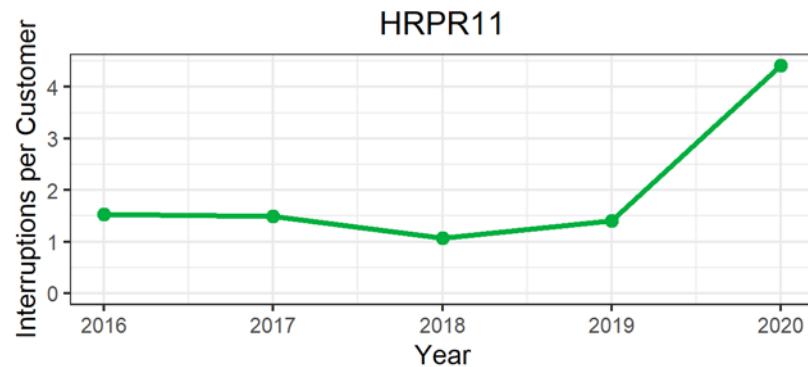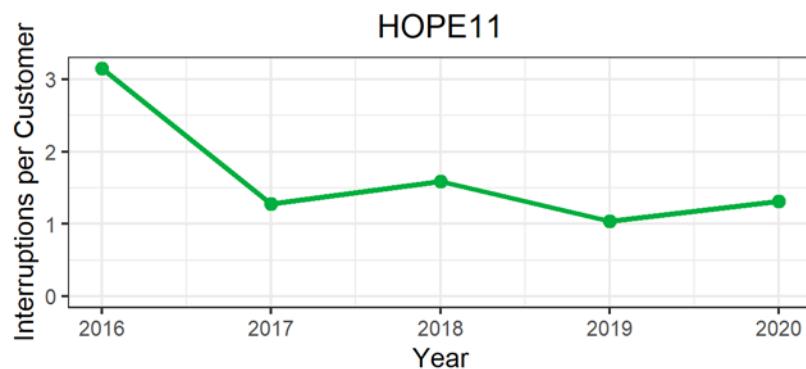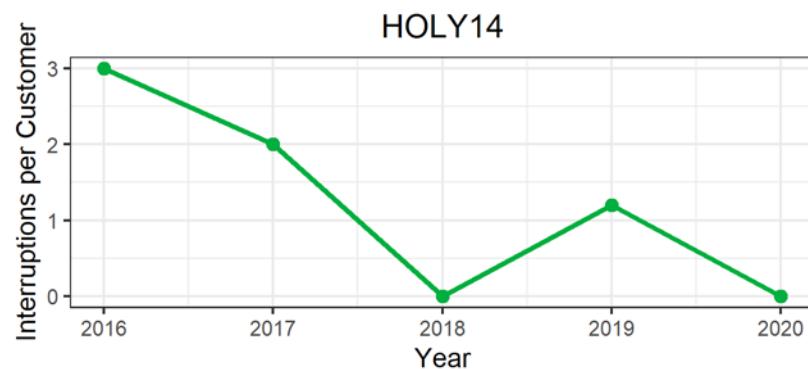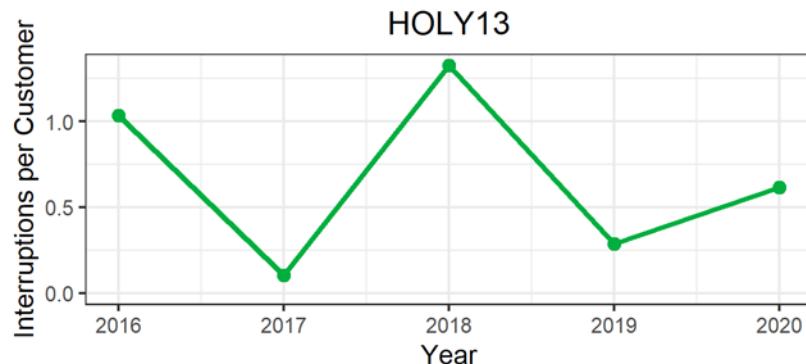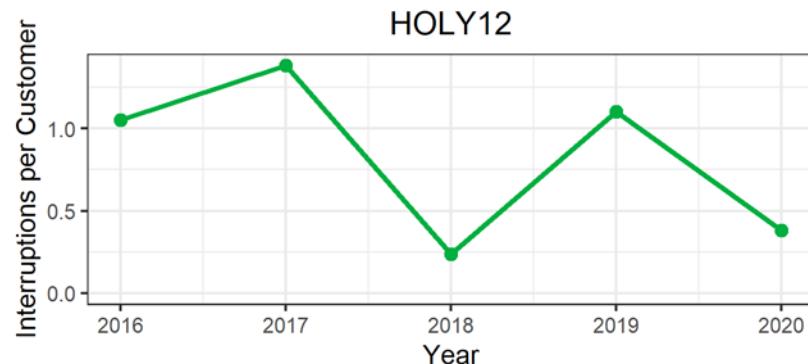


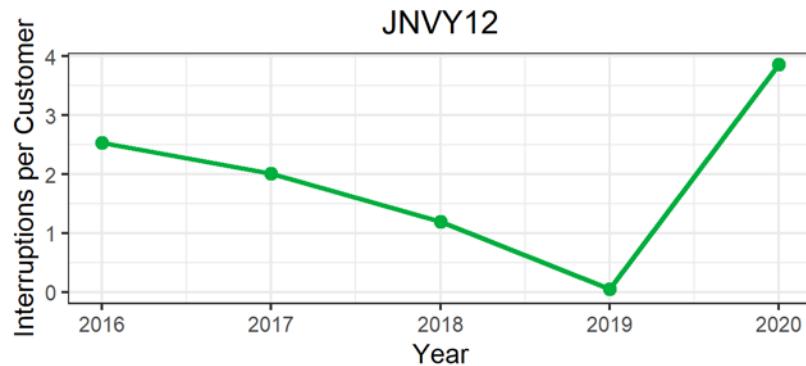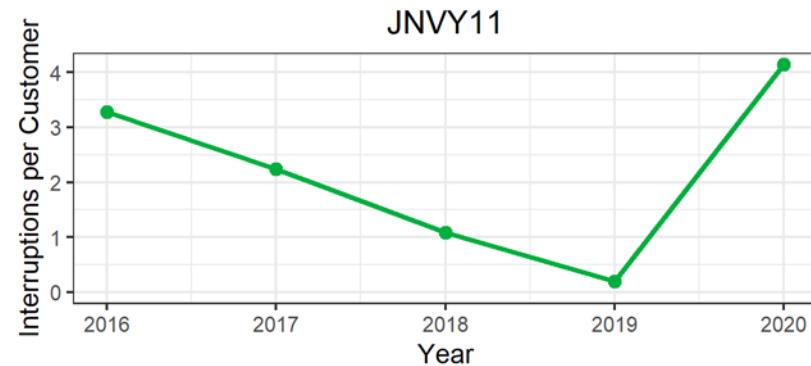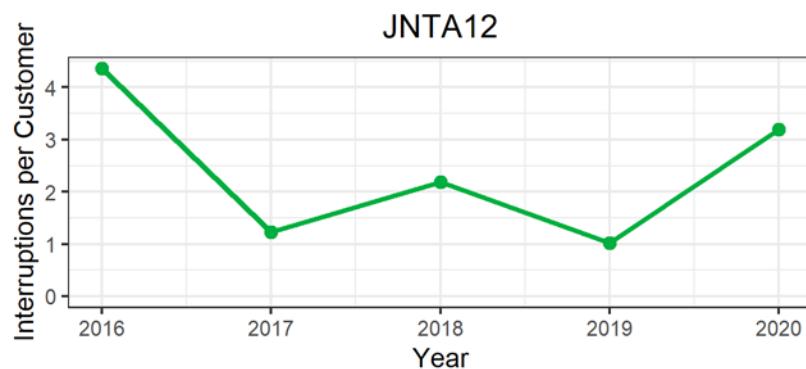
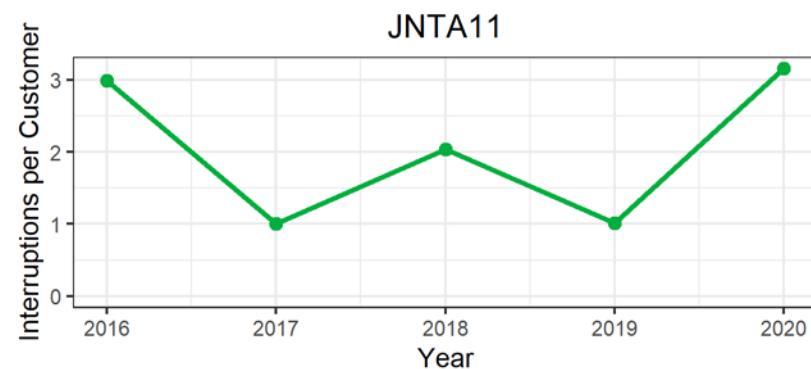
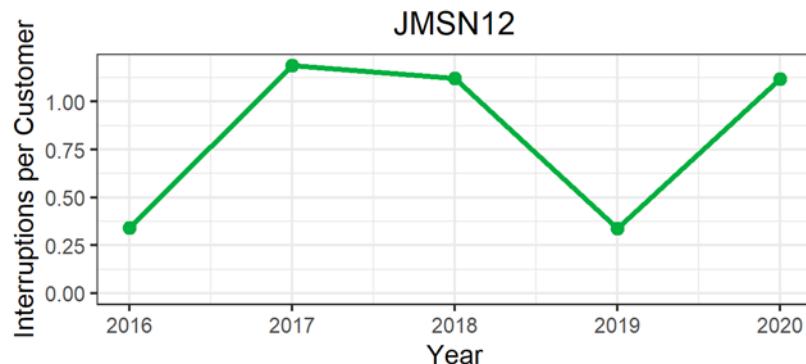
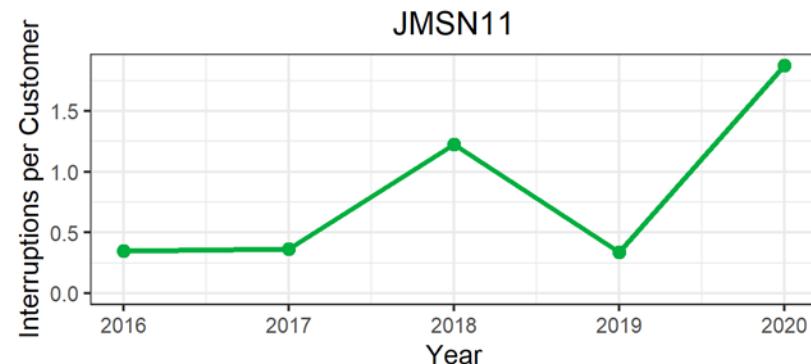


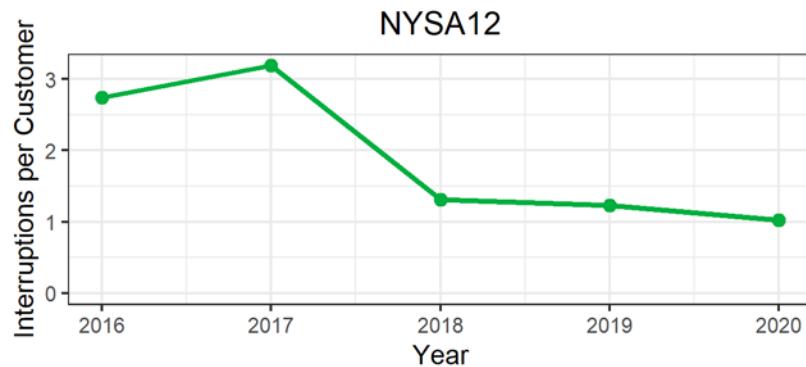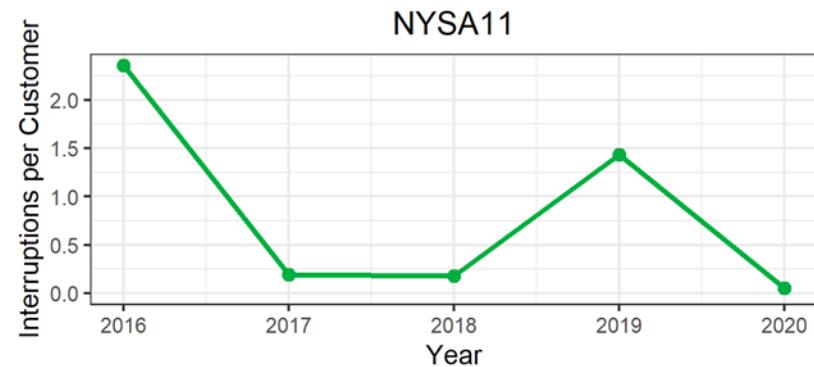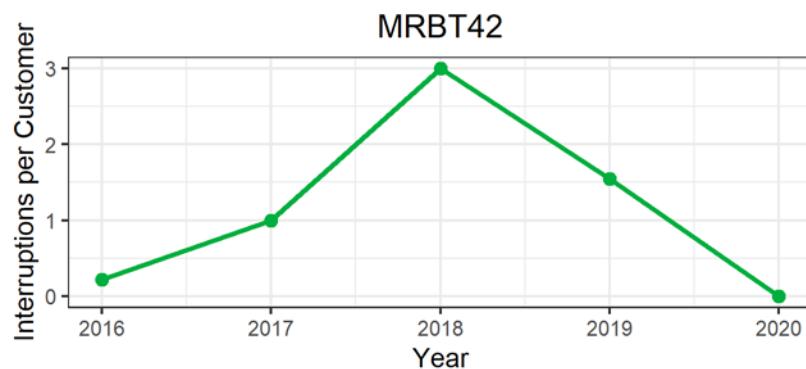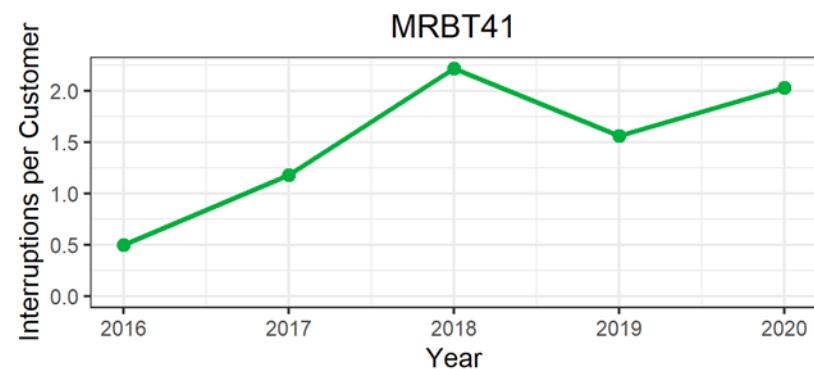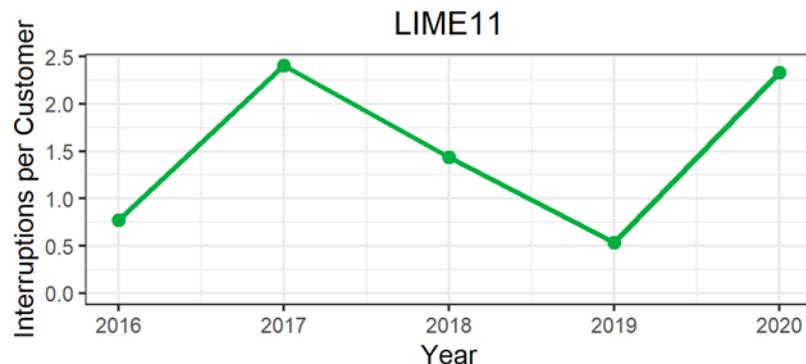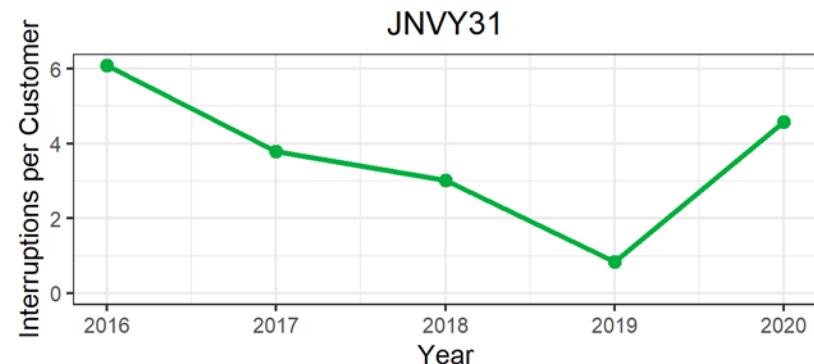

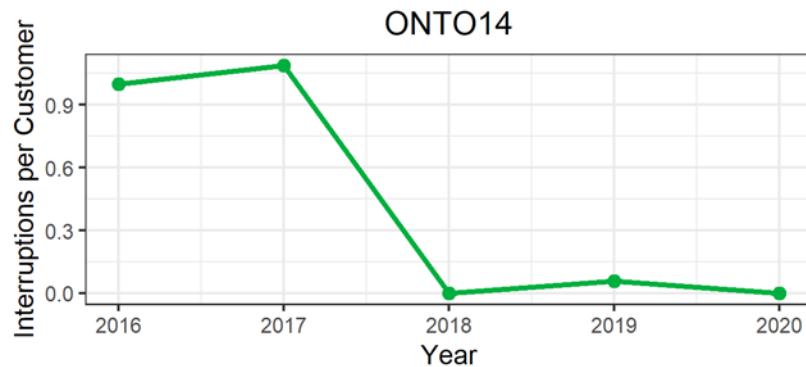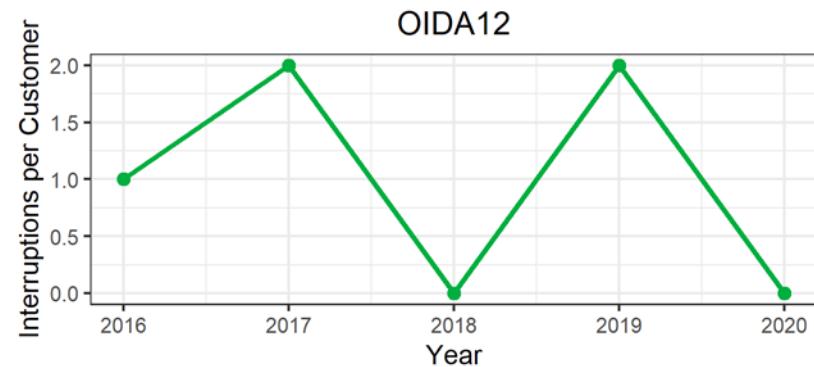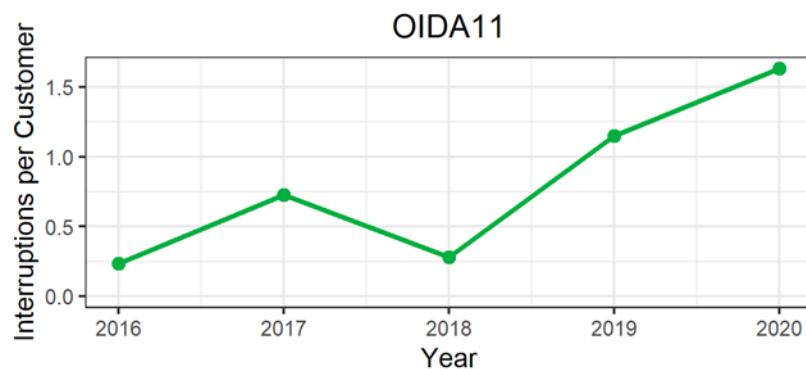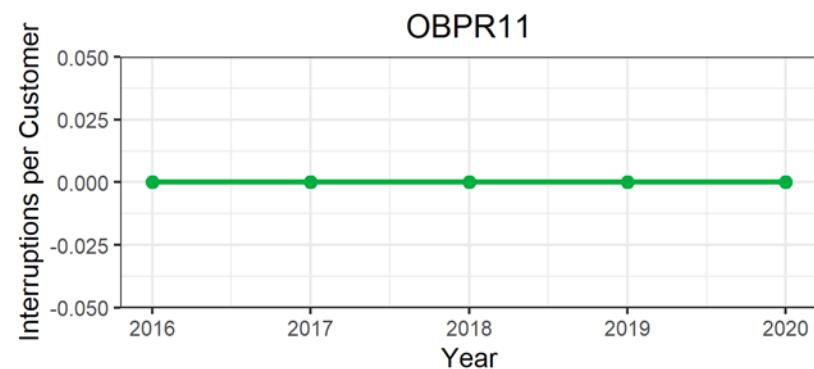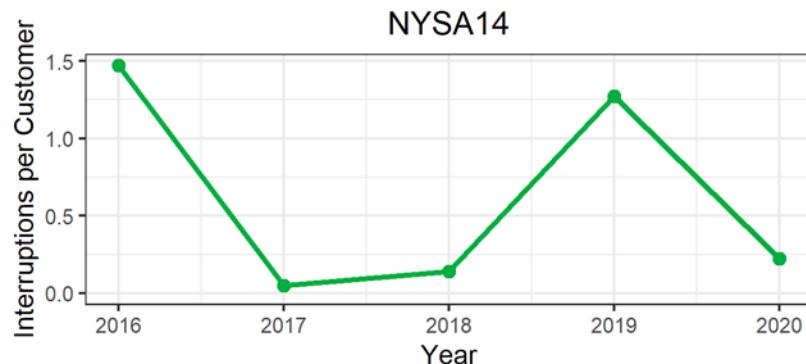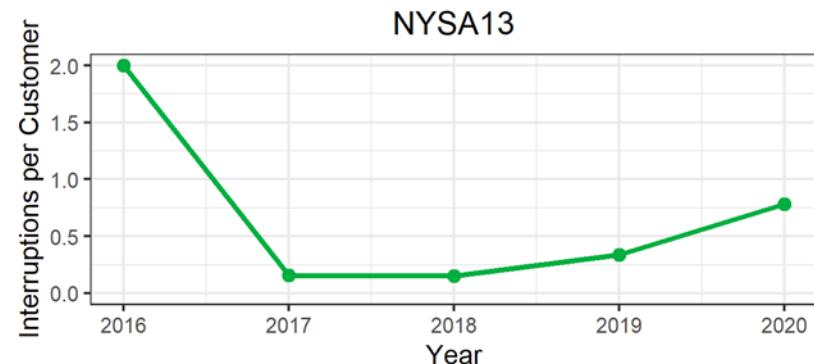

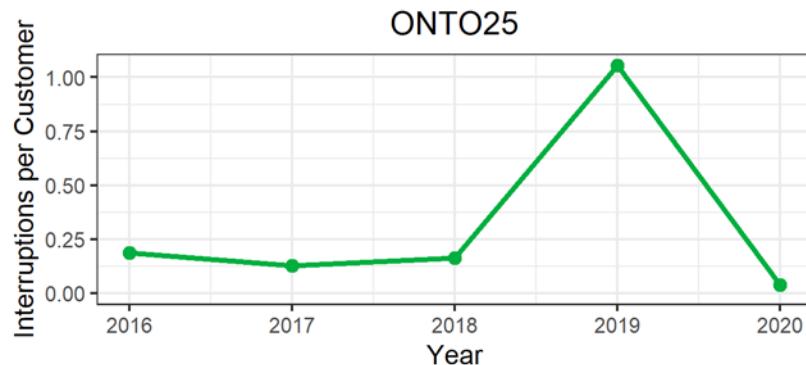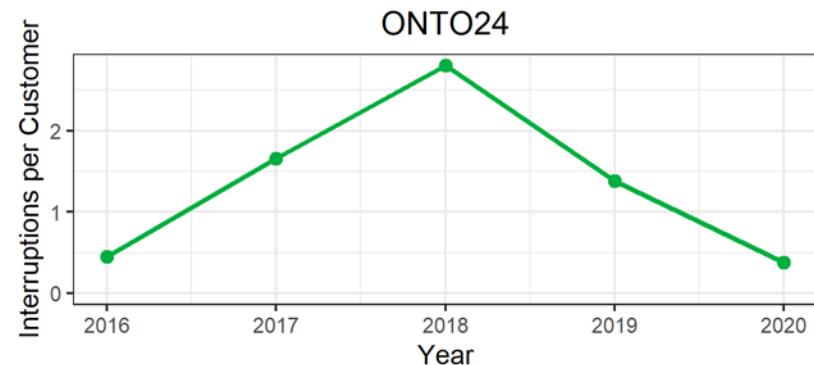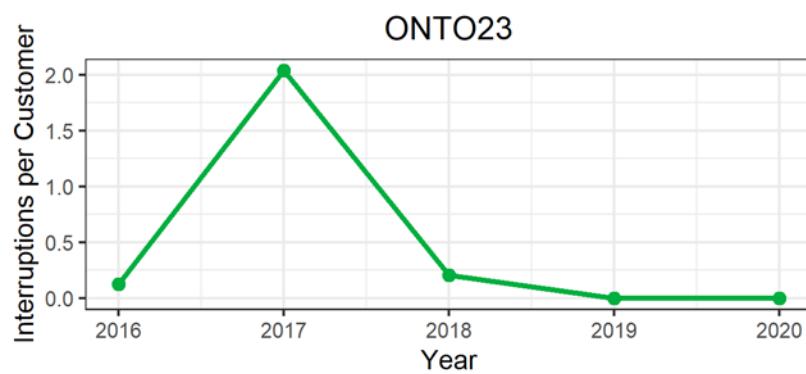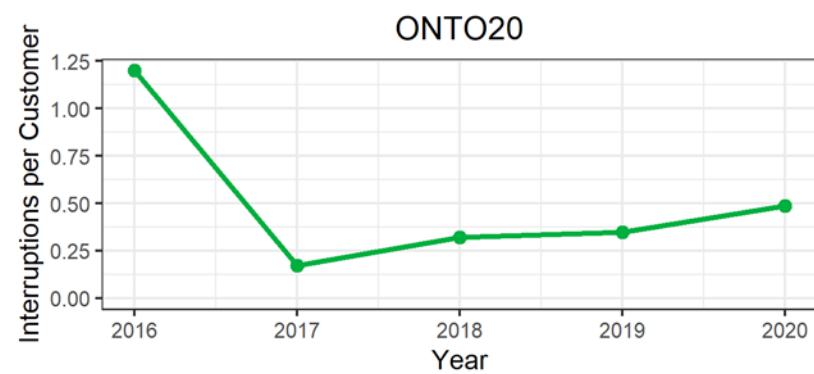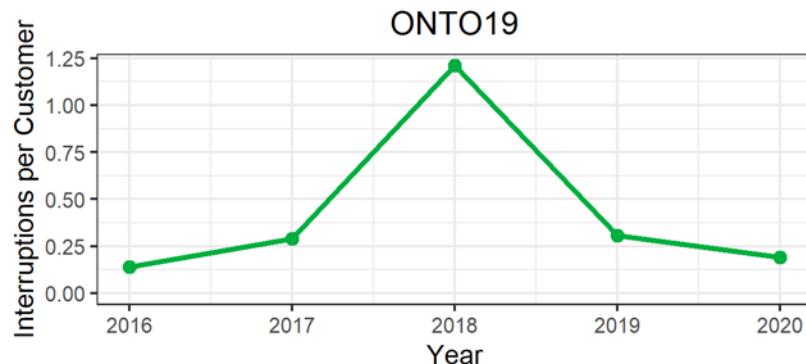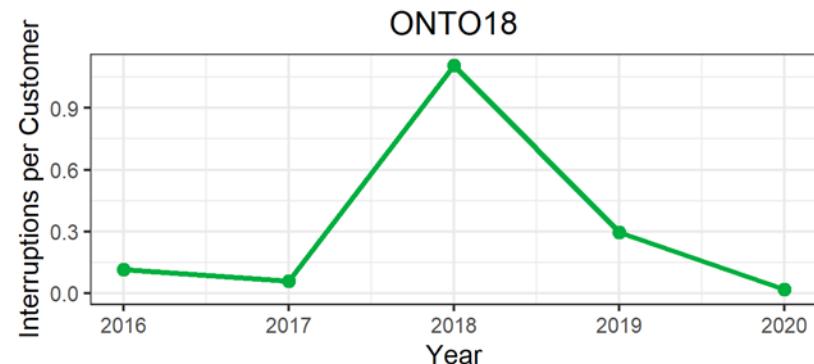

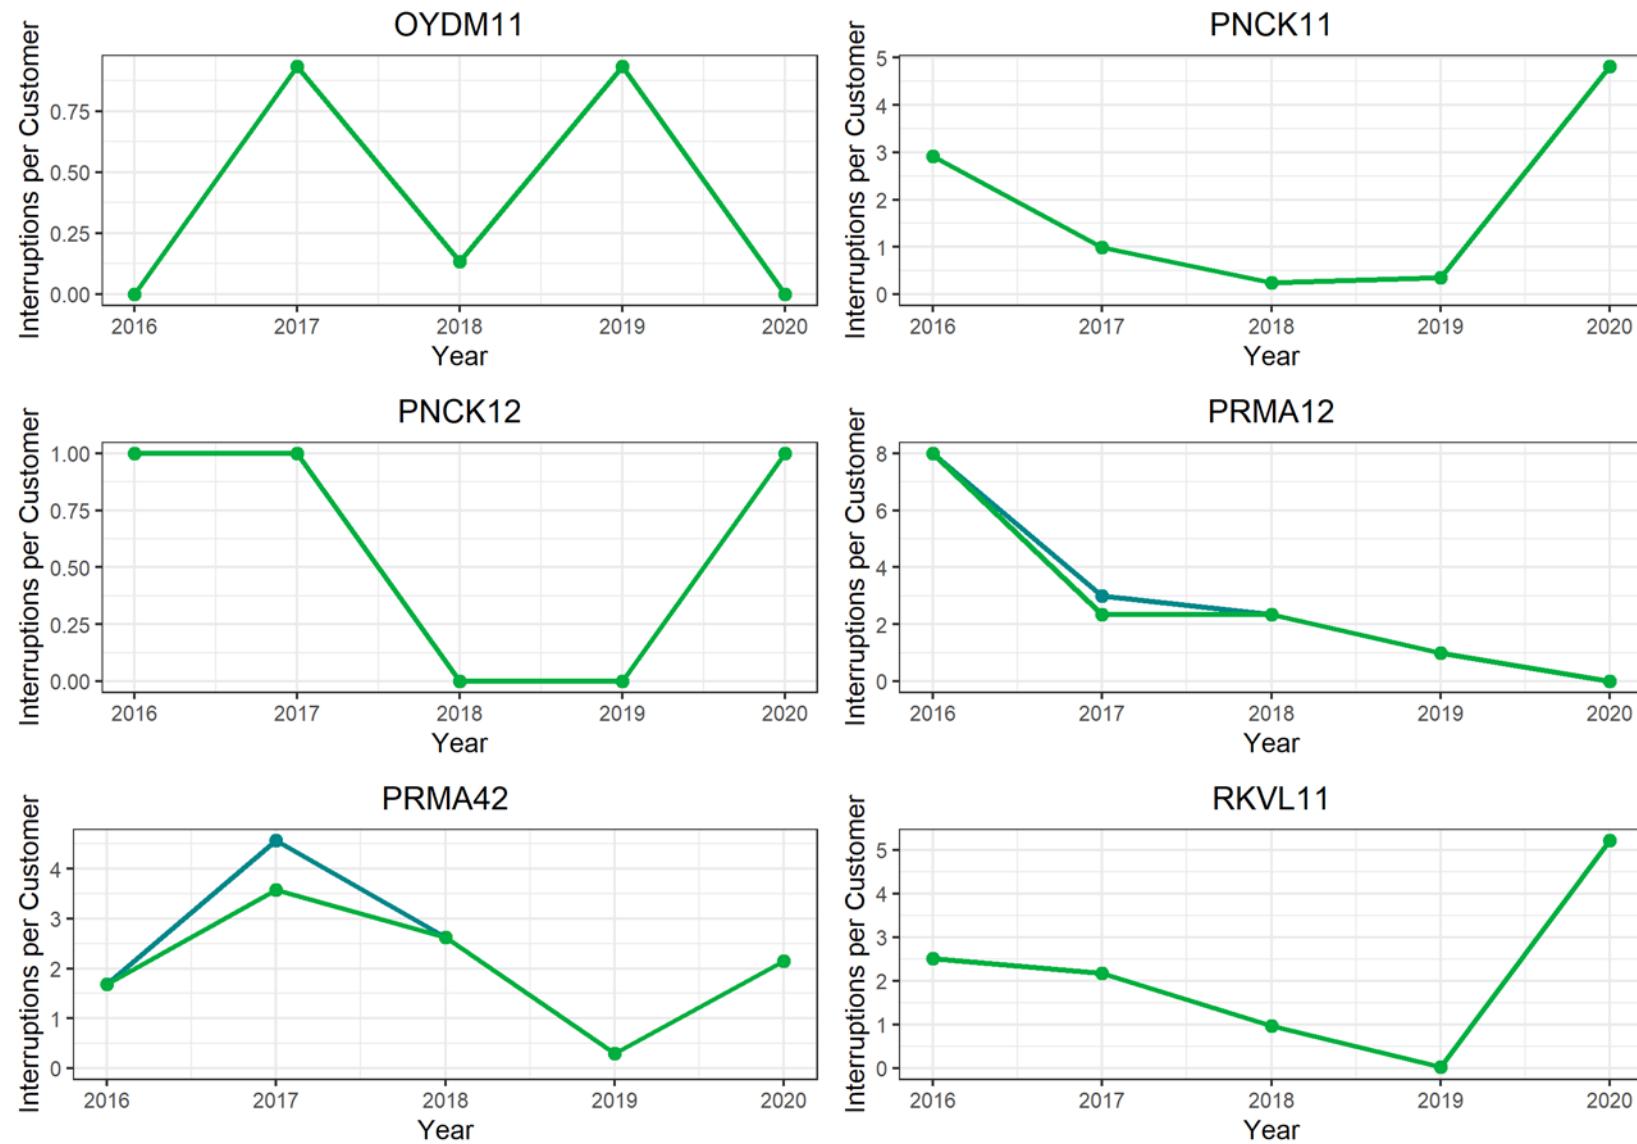

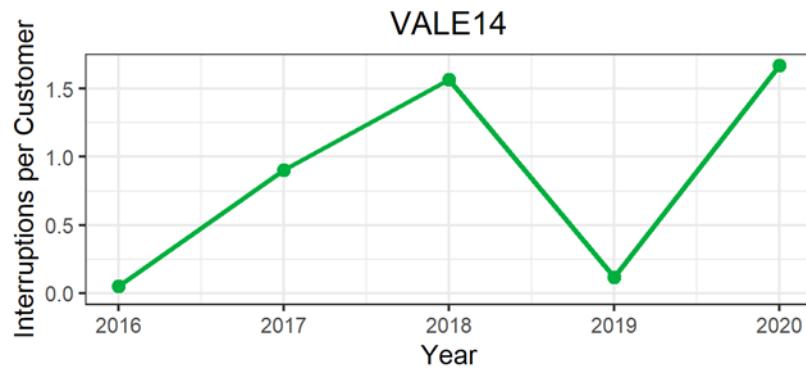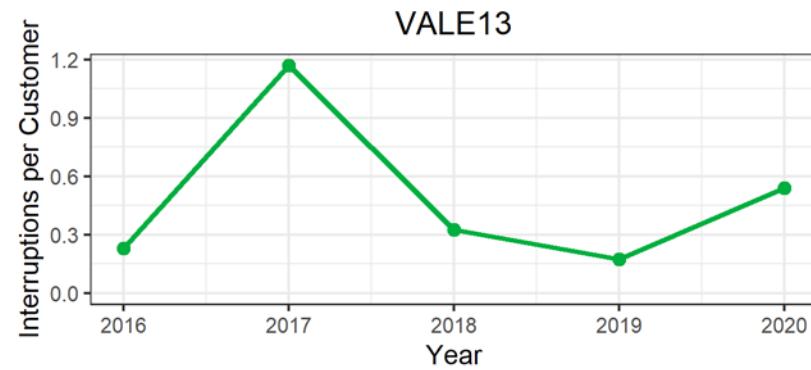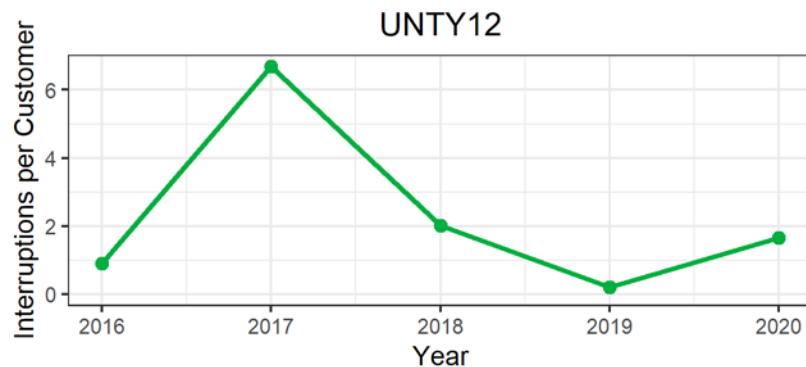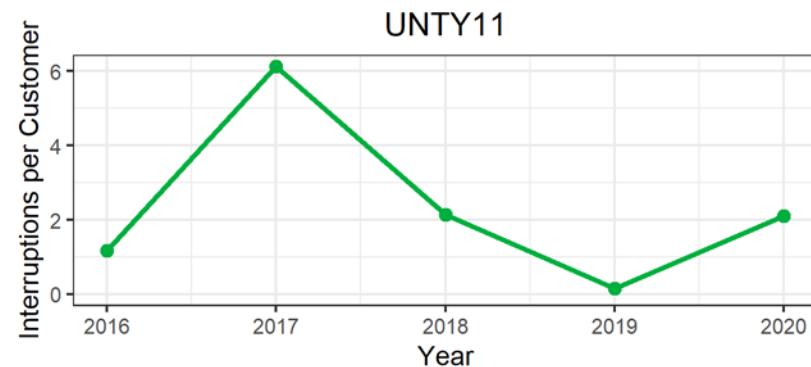

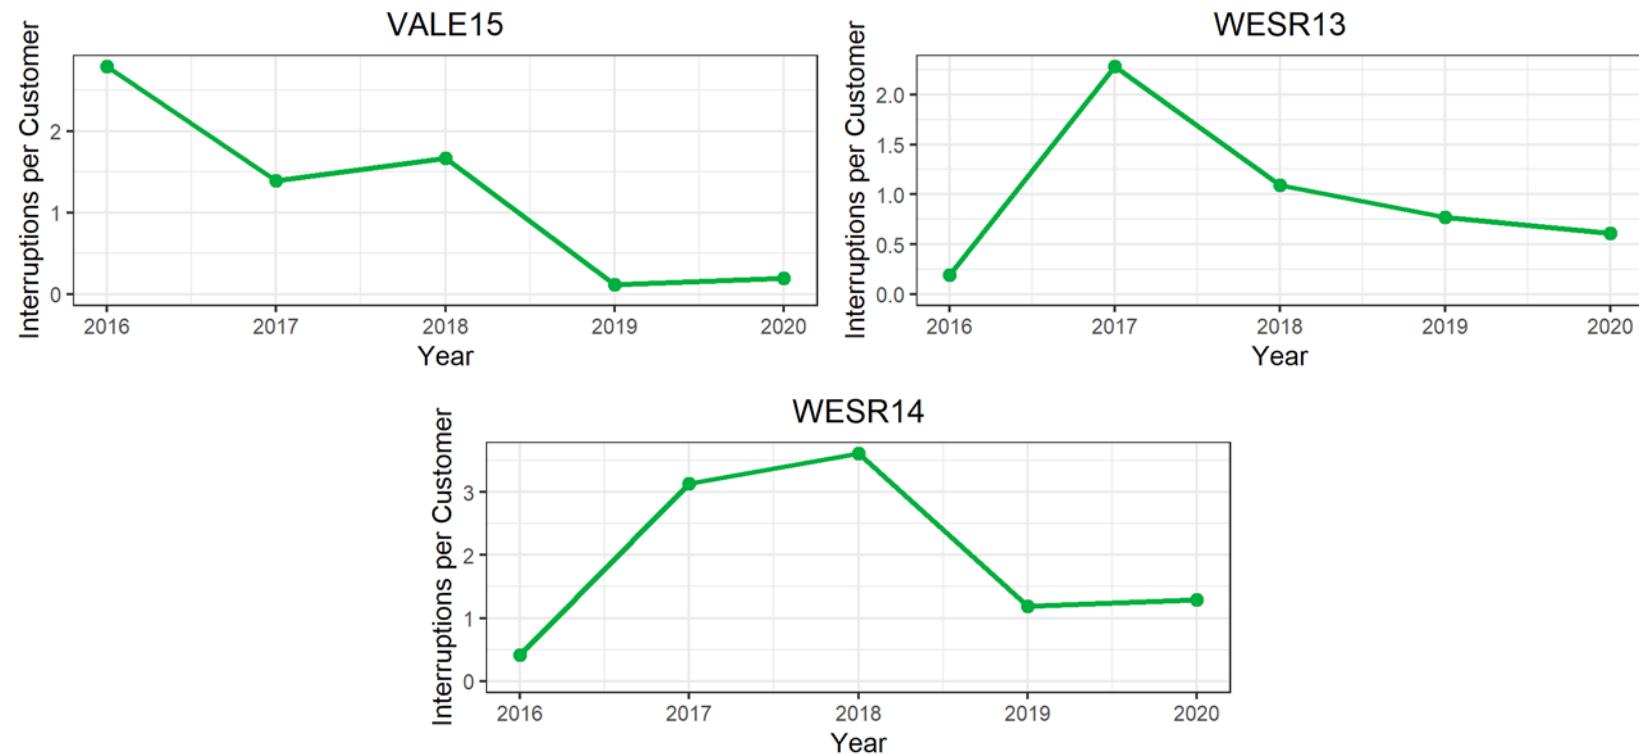
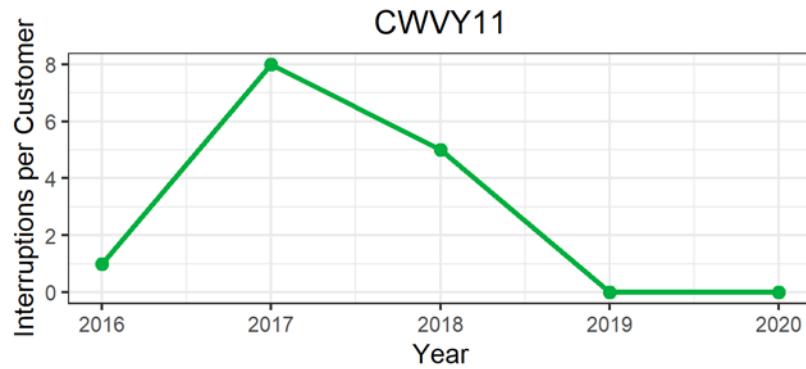
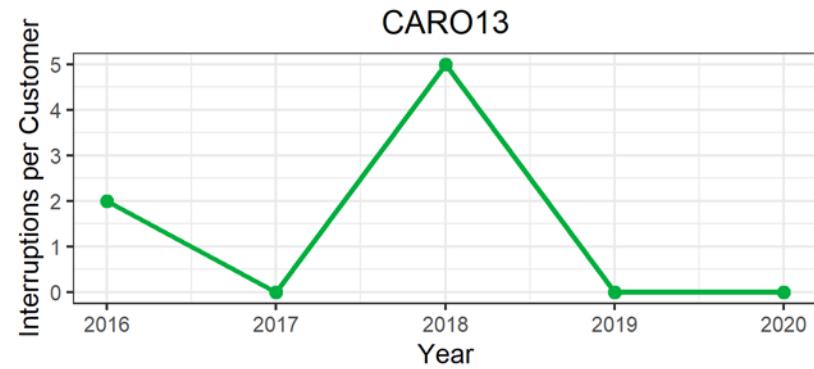
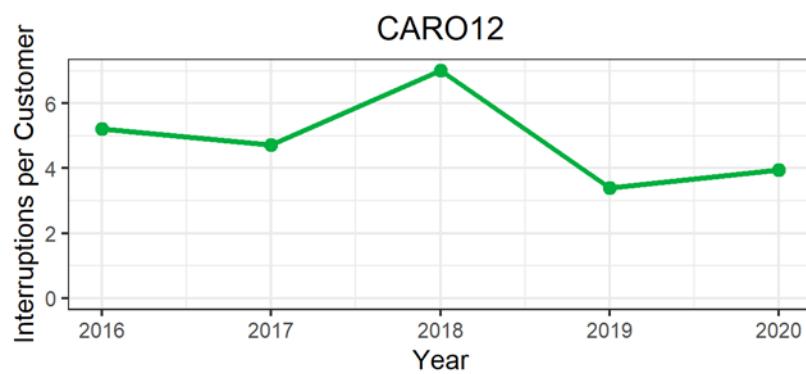
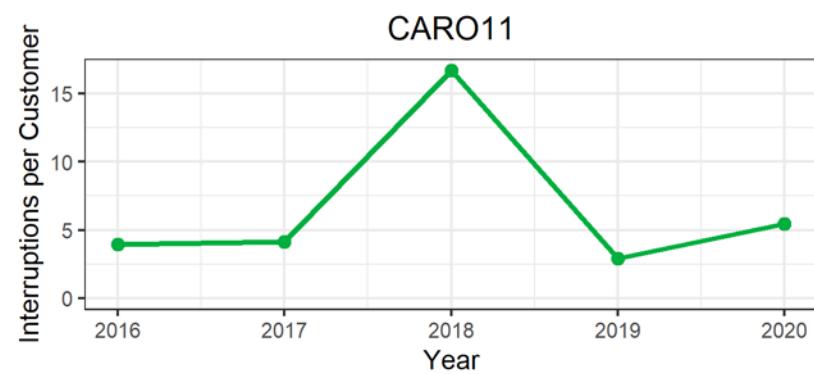
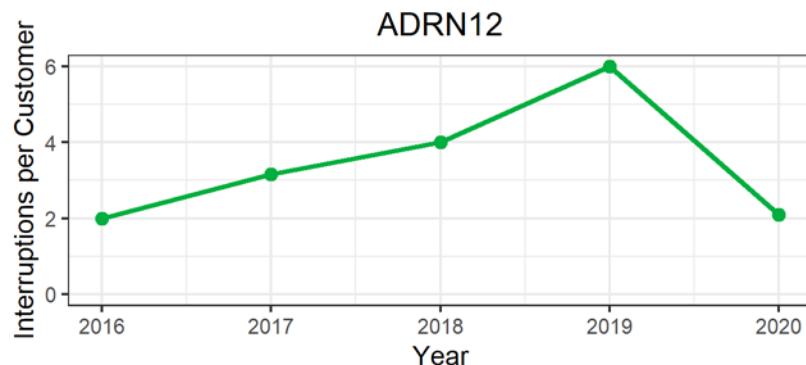








Figure 7 Five Years of Circuit SAIFI







Five Years of Circuit MAIFI_E







Circuit	2016	2017	2018	2019	2020	2020 MedEx
ADRN11	1.91	3.84	3.50	3.00	2.09	2.09
ADRN12	2.00	6.55	13.20	6.00	2.09	2.09
CARO11	4.01	4.42	11.18	3.10	5.43	5.43
CARO12	5.19	4.66	7.04	3.38	3.95	3.95
CARO13	2.00	0.00	5.00	0.00	0.00	0.00
CWVY11	1.00	8.00	5.00	0.00	0.00	0.00
CWVY12	3.06	6.65	3.00	6.00	0.00	0.00
DRKE11	10.33	18.00	4.00	5.00	3.00	3.00
DUKE11	0.00	2.00	2.00	0.00	0.00	0.00
DWSY11	8.27	7.47	9.00	7.85	4.48	4.48
ESTN11	0.00	0.00	0.00	0.00	0.00	0.00
HCSU11	0.00	0.00	0.00	0.00	0.00	0.00
HFwy11	2.64	15.57	1.79	6.29	1.73	1.73
HFwy12	7.25	9.15	6.00	5.17	17.00	17.00
HGTN11	1.00	1.00	2.00	4.00	4.00	4.00
HGTN12	1.00	2.00	0.00	2.00	4.00	4.00
HMDL12	4.72	8.23	6.92	6.52	2.04	2.04
HOLY11	0.00	0.00	0.00	0.00	0.00	0.00
HOLY12	0.00	4.00	6.00	2.00	5.00	5.00
HOLY13	0.42	3.72	2.00	4.00	0.00	0.00
HOLY14	NA	NA	NA	0.00	0.00	0.00
HOPE11	1.00	5.00	2.00	0.00	2.39	2.39
HRPR11	2.09	3.00	2.00	3.00	4.63	4.63
HRPR12	4.96	5.42	3.27	5.03	3.45	3.45
JMSN11	0.00	1.11	0.70	0.94	0.87	0.87
JMSN12	3.00	9.67	7.00	7.00	4.00	4.00
JNTA11	9.00	12.00	9.00	9.00	3.00	3.00
JNTA12	9.25	14.13	9.63	10.00	8.00	8.00
JNVY11	3.66	6.32	6.00	7.00	0.00	0.00
JNVY12	4.00	5.00	2.00	3.00	1.00	1.00
JNVY31	9.28	10.12	7.24	5.00	4.46	4.46
LIME11	1.00	2.19	2.00	2.00	0.60	0.60
MRBT41	0.00	1.00	1.00	1.00	3.00	3.00
MRBT42	0.00	0.00	1.00	1.00	2.00	2.00
NYSA11	1.00	0.00	2.00	1.00	2.00	2.00
NYSA12	5.42	7.15	1.95	0.00	0.00	0.00
NYSA13	0.00	1.26	1.09	1.00	0.52	0.52
NYSA14	1.00	1.35	0.00	1.00	0.00	0.00
OBPR11	0.00	0.00	0.00	0.00	0.00	0.00
OIDA11	4.23	2.00	0.00	0.00	3.00	3.00
OIDA12	0.00	0.00	0.00	0.00	0.00	0.00
ONTO14	1.00	1.00	1.00	1.00	0.00	0.00
ONTO18	0.00	2.00	3.00	4.00	3.00	3.00
ONTO19	1.36	0.00	1.72	1.72	1.34	1.34
ONTO20	0.00	0.00	0.00	2.00	1.00	1.00
ONTO23	2.00	7.00	0.00	0.00	0.00	0.00
ONTO24	0.94	3.28	0.00	0.00	0.68	0.68
ONTO25	0.00	3.00	0.00	0.00	0.00	0.00
OYDM11	0.00	0.00	0.00	0.00	0.00	0.00
PNCK11	3.00	4.00	4.00	4.00	5.00	5.00
PNCK12	0.00	0.00	0.00	0.00	0.00	0.00
PRMA12	3.00	5.00	1.00	0.00	0.00	0.00
PRMA42	4.76	12.23	9.74	6.24	3.15	3.15
RKVL11	6.00	6.00	5.00	6.00	3.00	3.00
UNTY11	1.00	15.00	8.00	7.00	8.05	8.05
UNTY12	1.22	14.85	0.00	0.00	0.00	0.00
VALE11	4.17	4.55	2.86	1.00	1.00	1.00
VALE12	0.00	0.00	0.00	0.00	0.00	0.00
VALE13	4.90	3.73	0.00	0.91	2.89	2.89
VALE14	1.07	2.61	2.00	0.00	0.12	0.12
VALE15	4.51	2.76	2.25	0.00	5.00	4.00
WESR13	0.00	0.27	0.74	4.26	1.26	1.26
WESR14	0.00	2.90	6.00	3.00	2.00	2.00







Table 8 Five Years of Circuit MAIFI_E









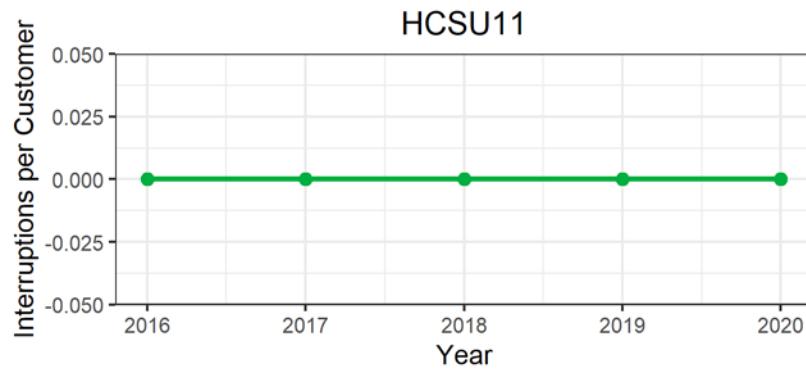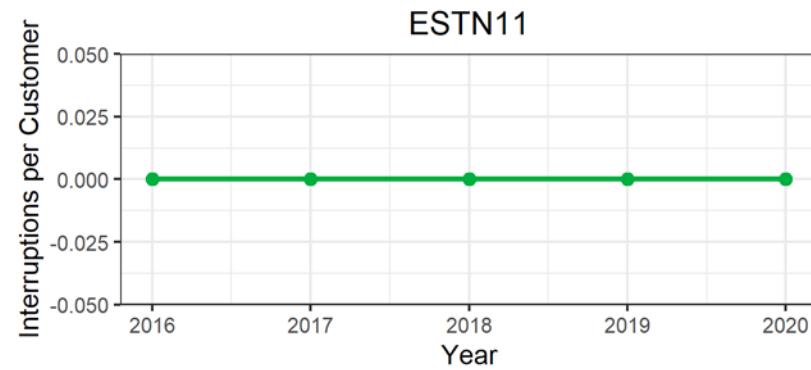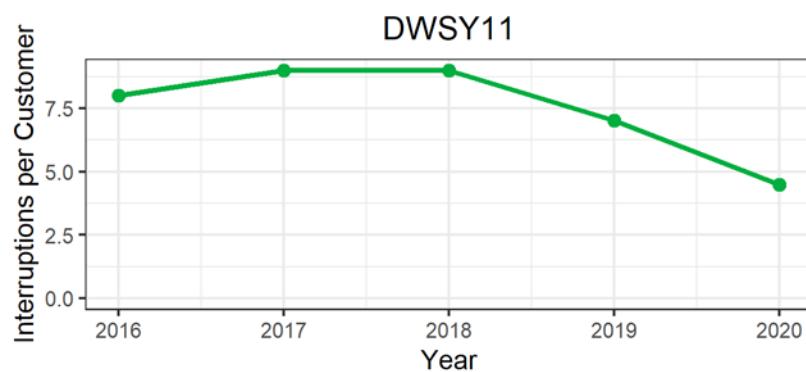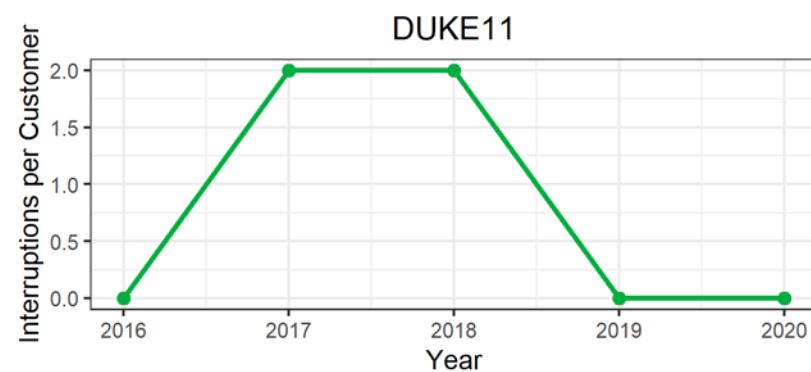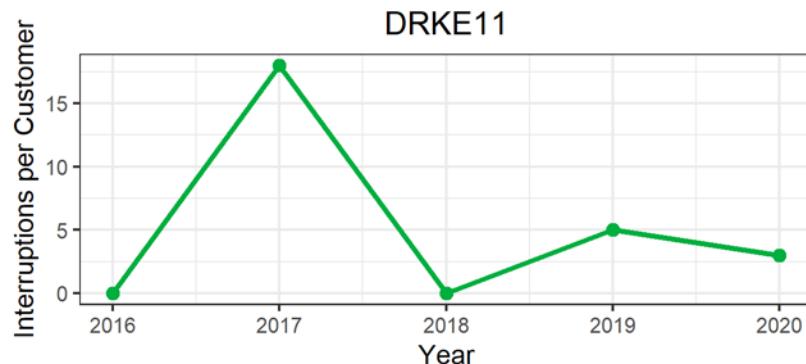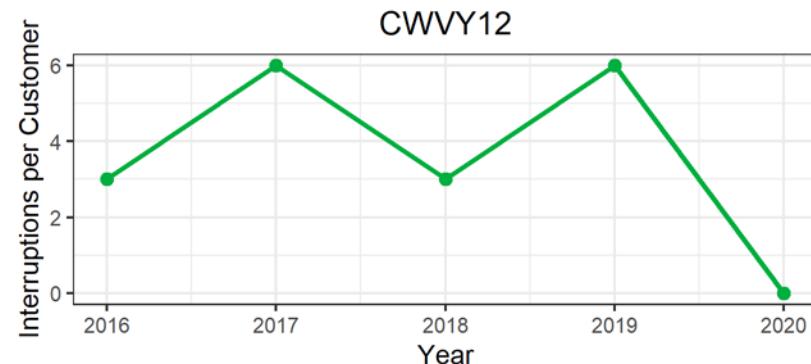


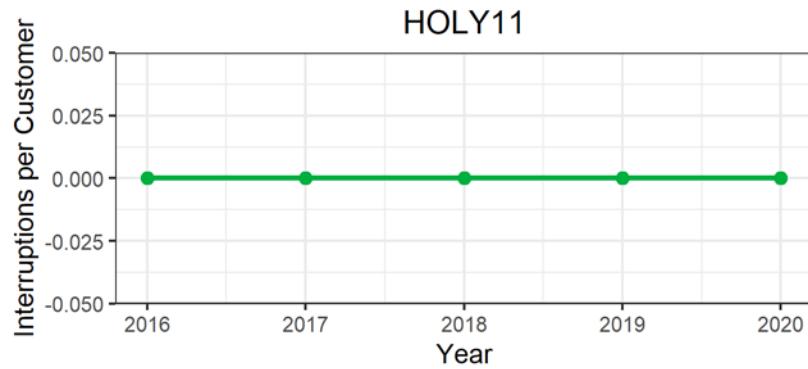
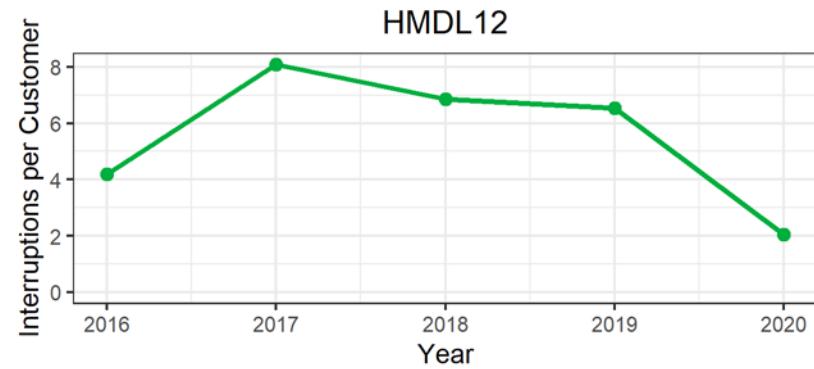
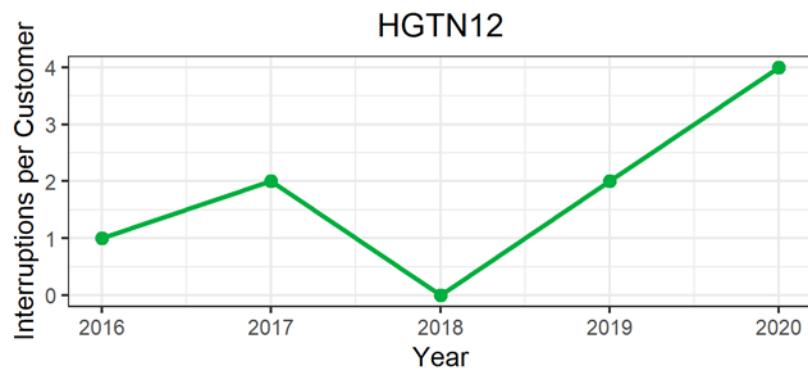
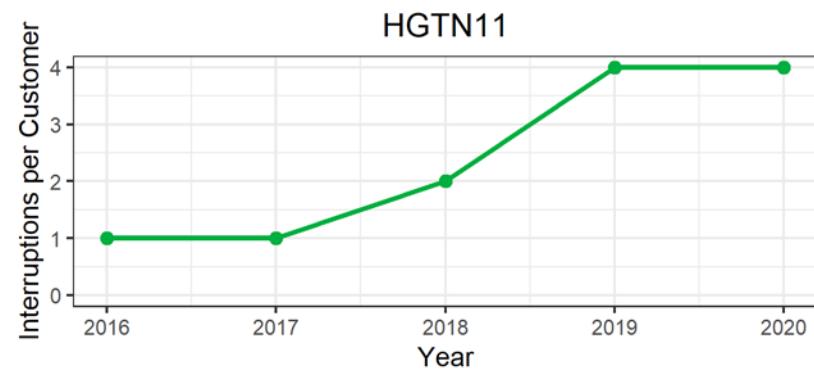
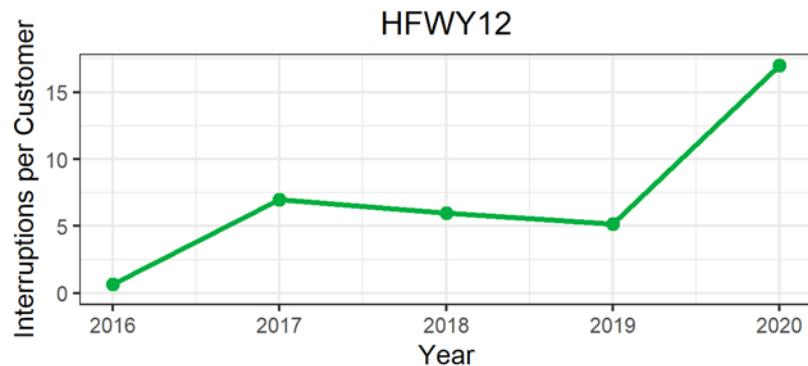
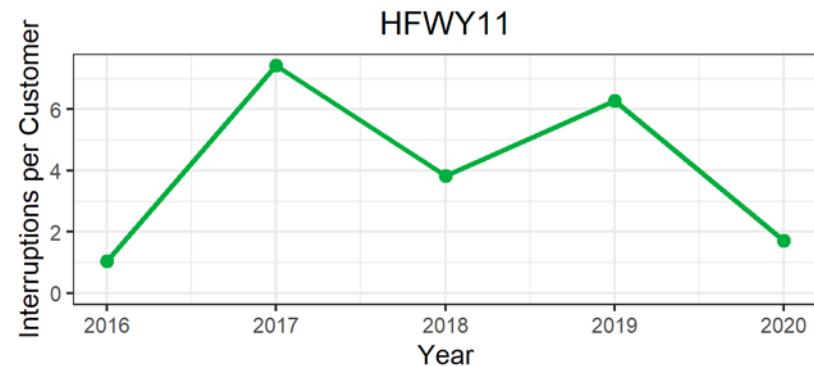


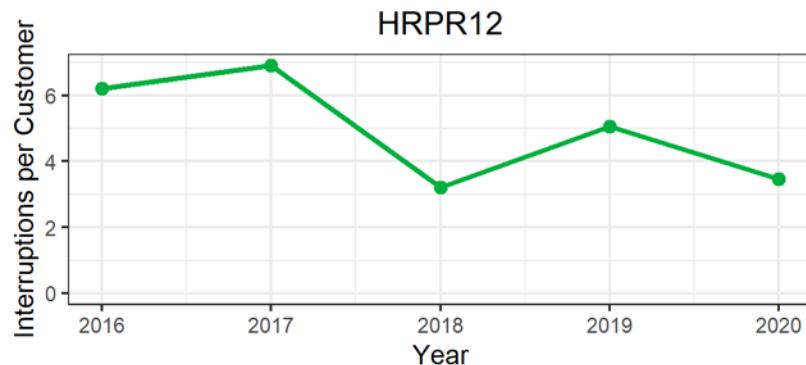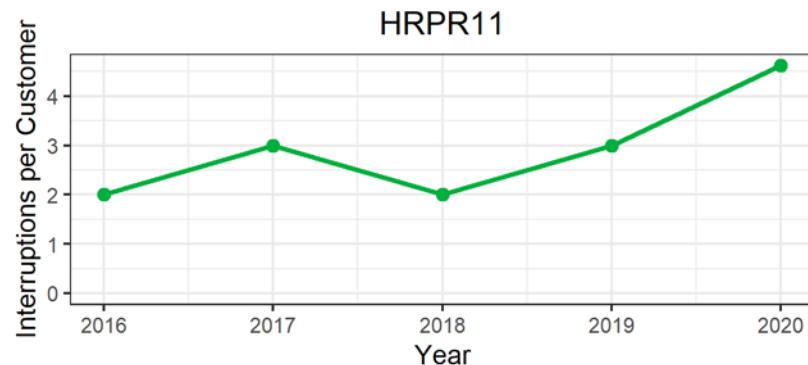
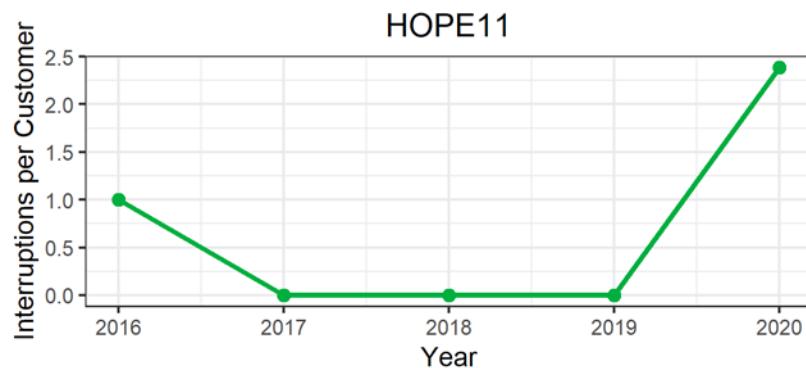
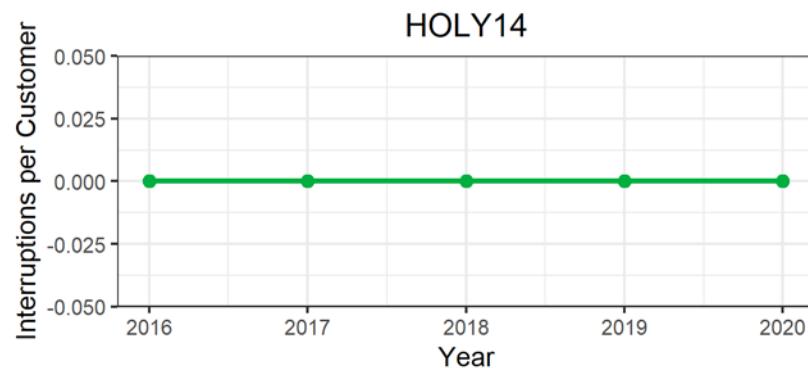
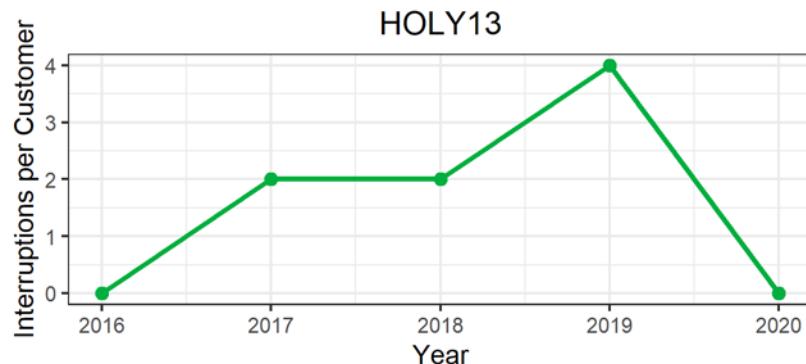
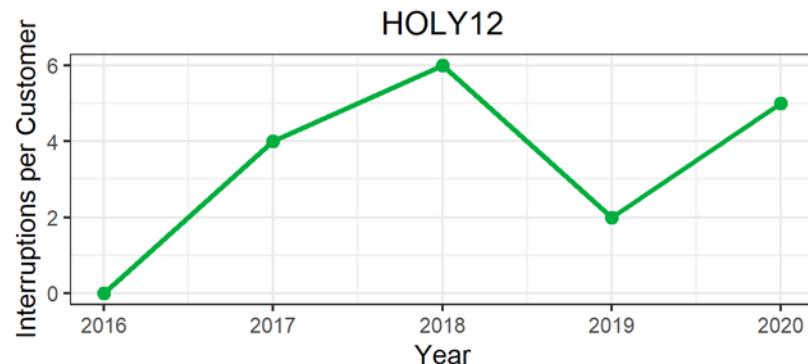


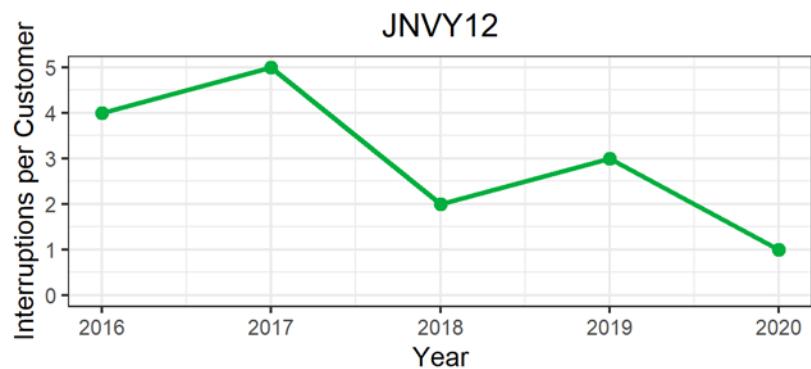
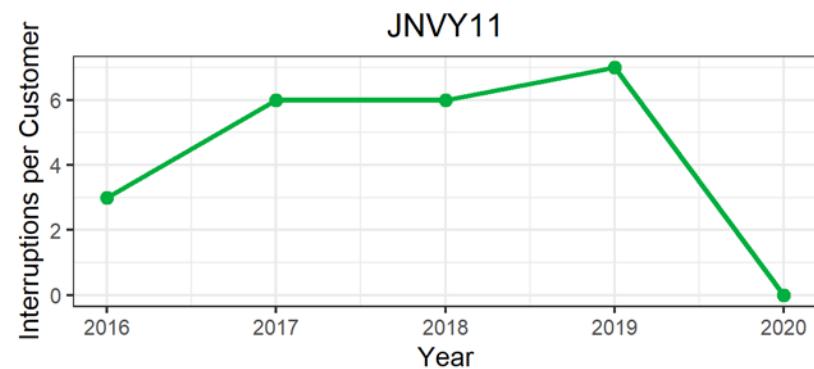
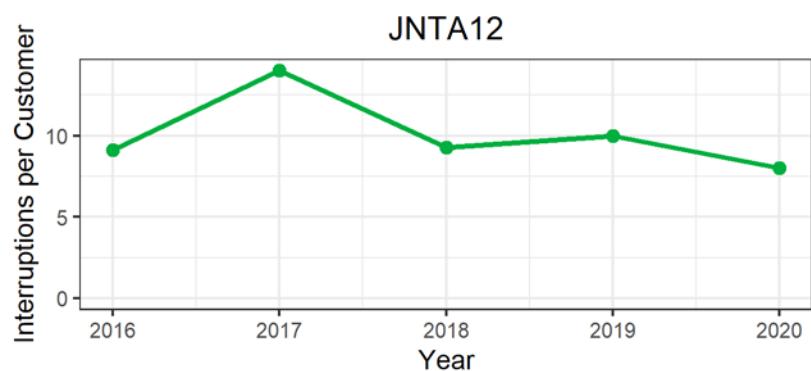
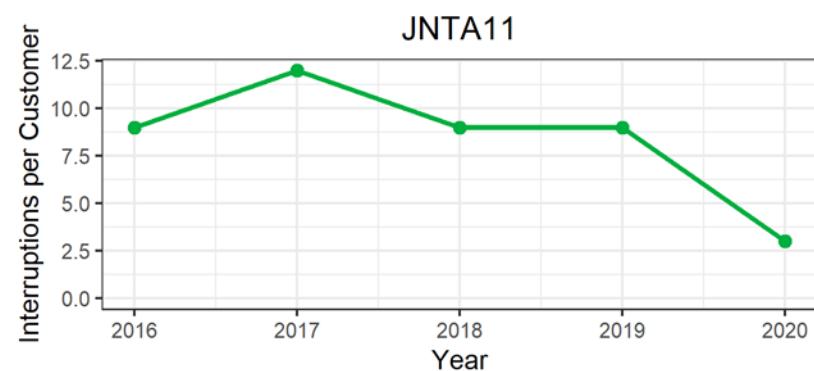
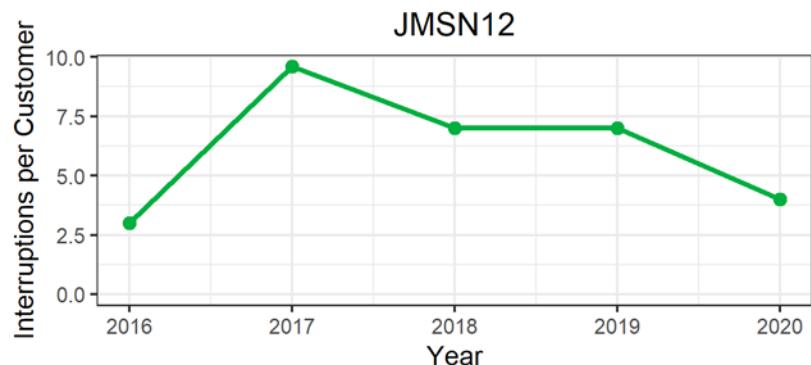
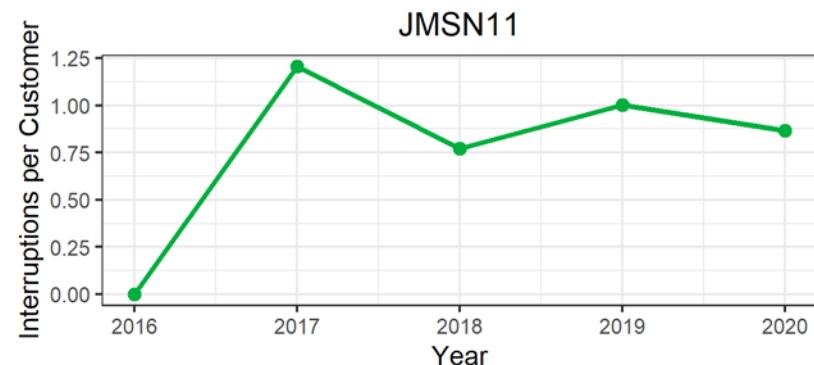


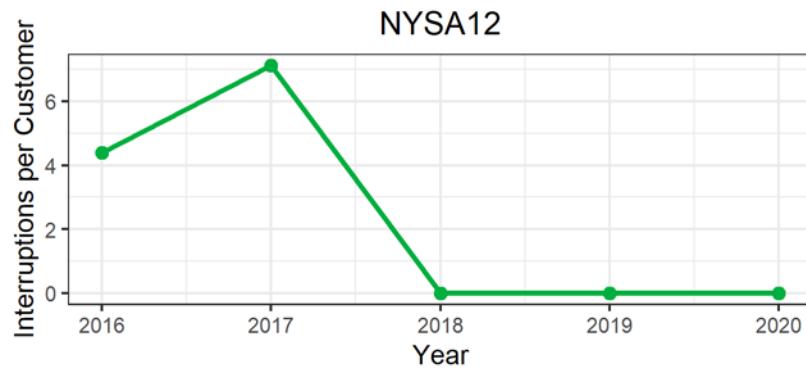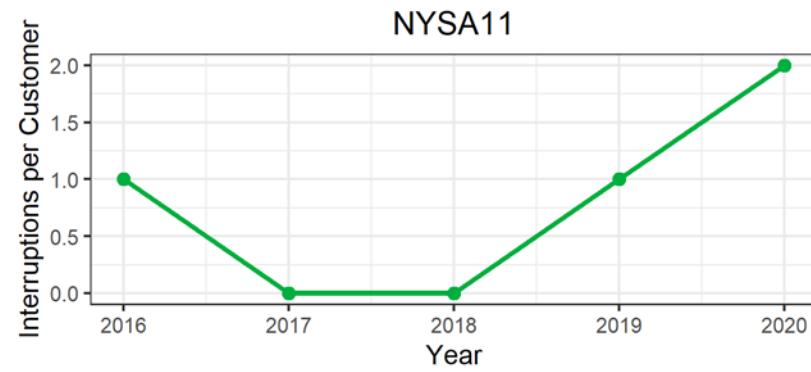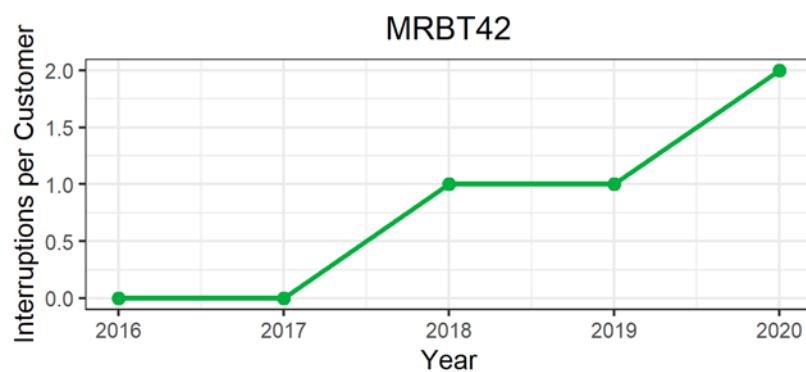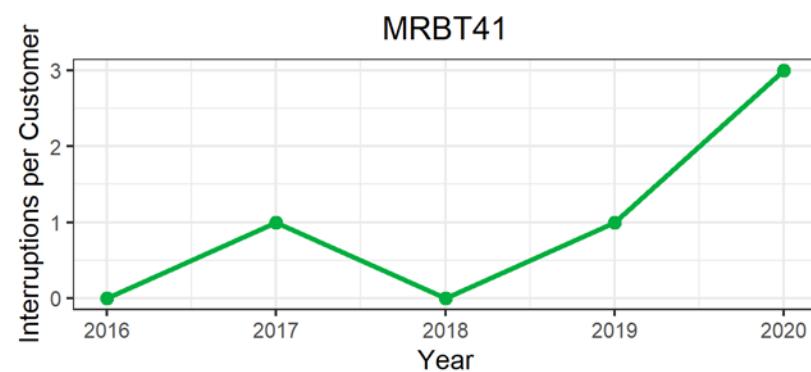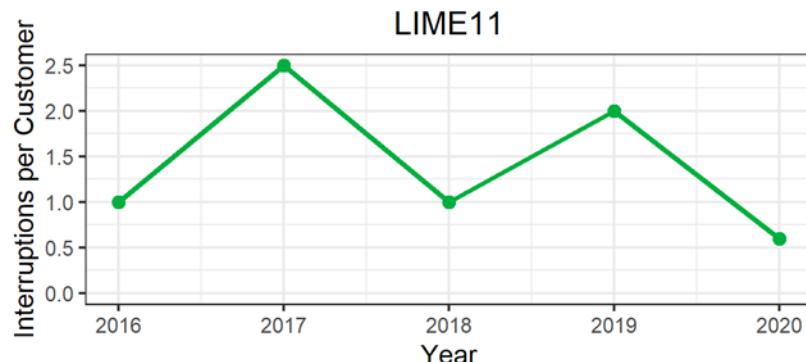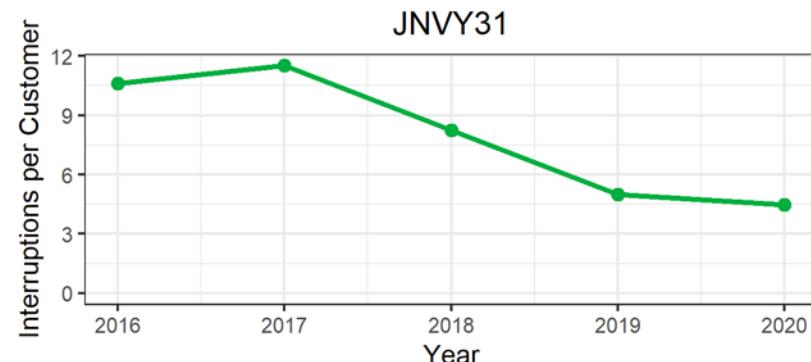

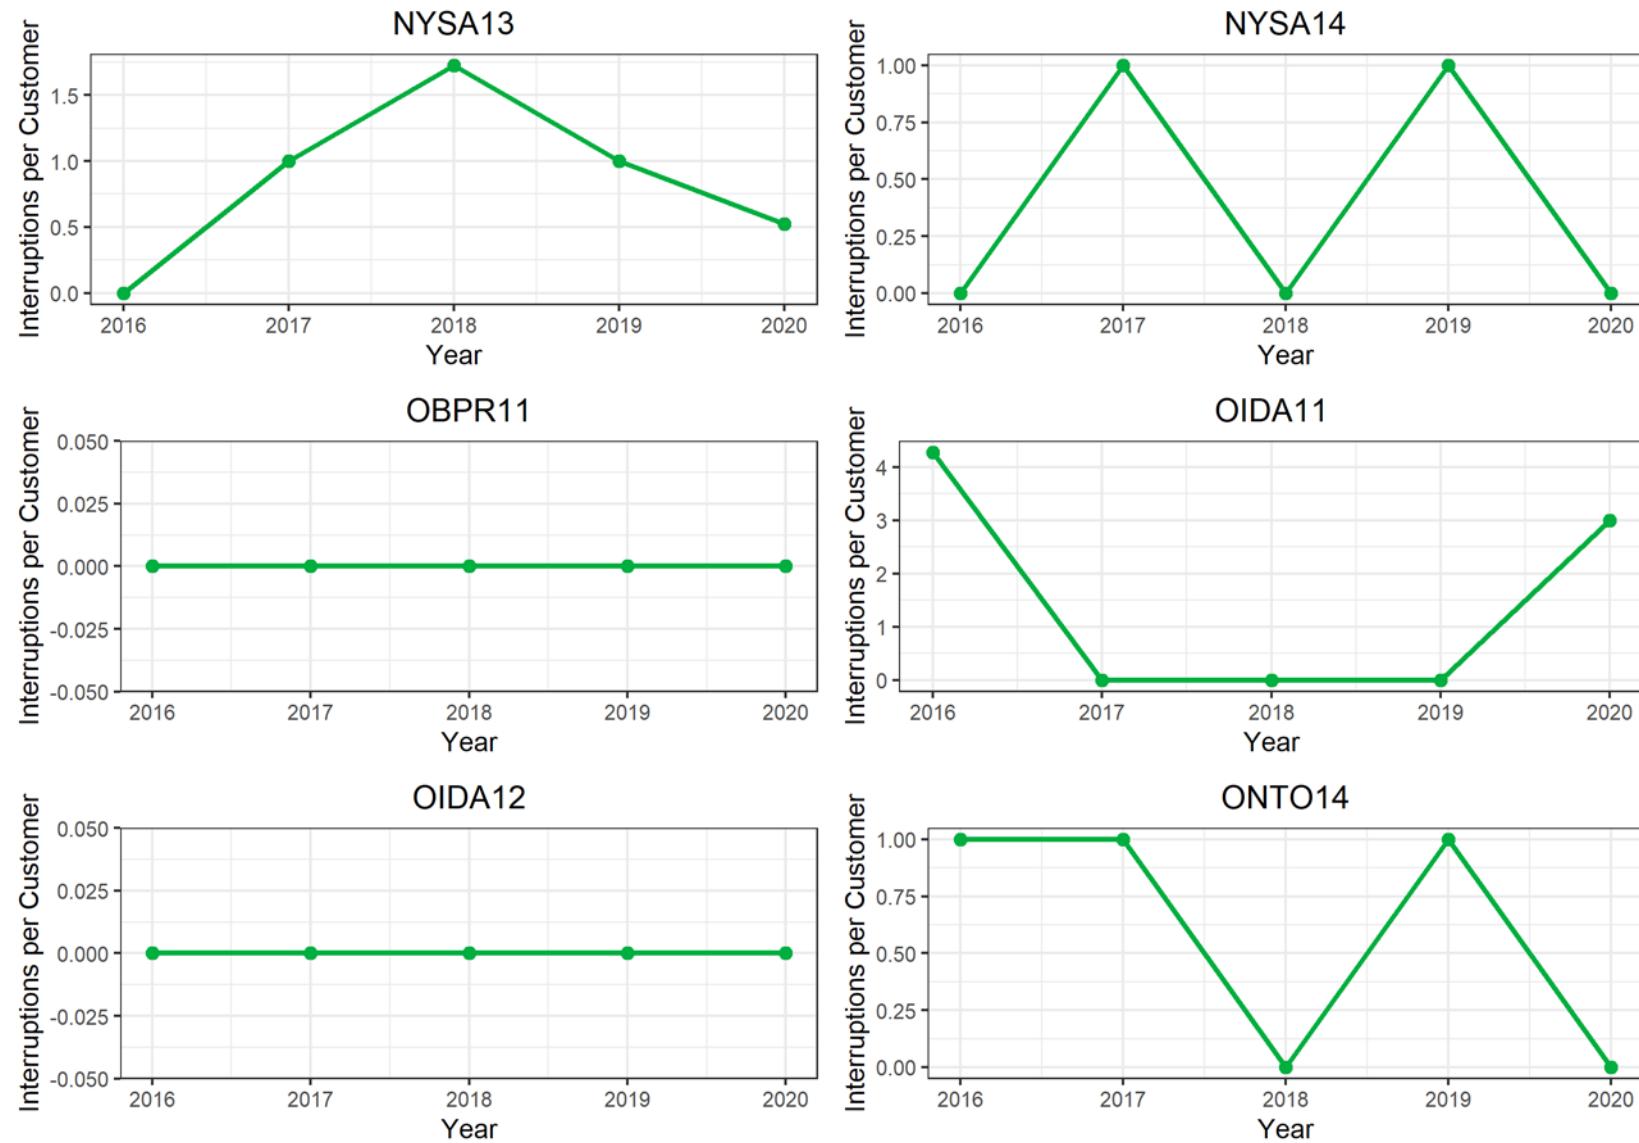

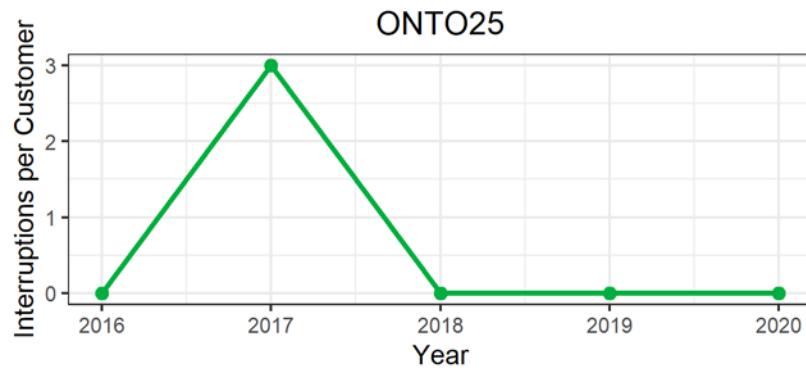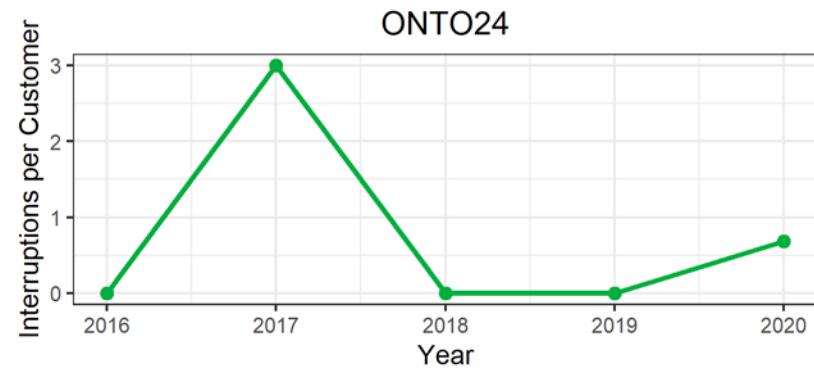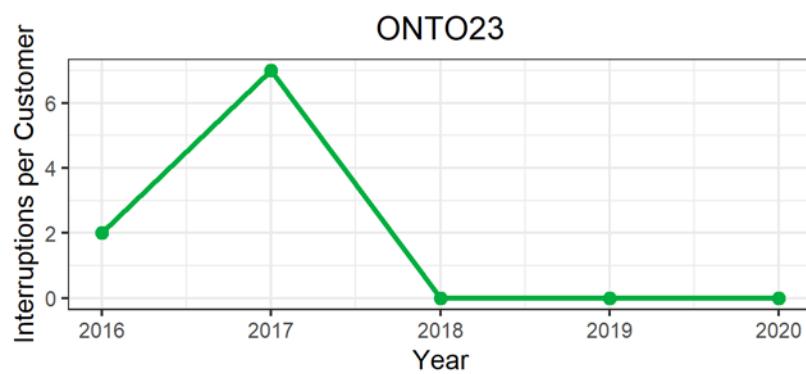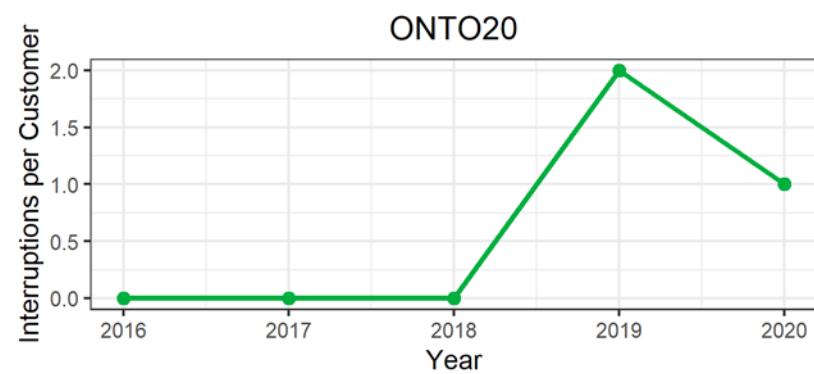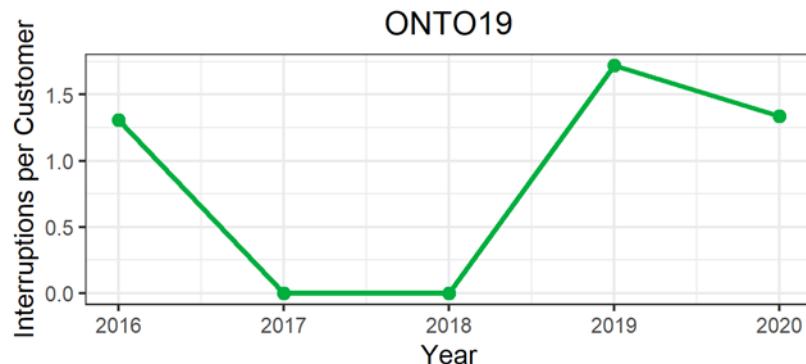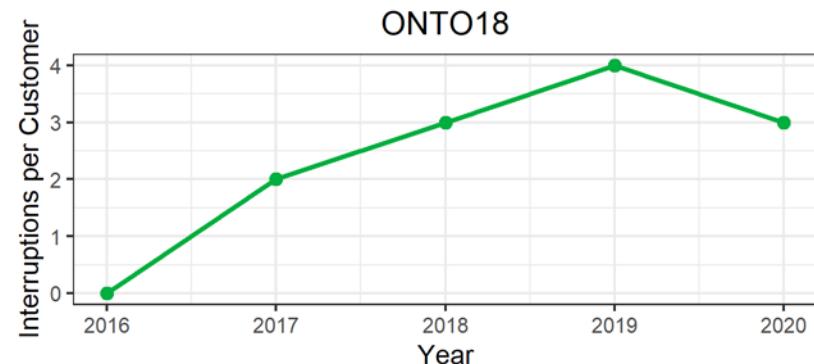

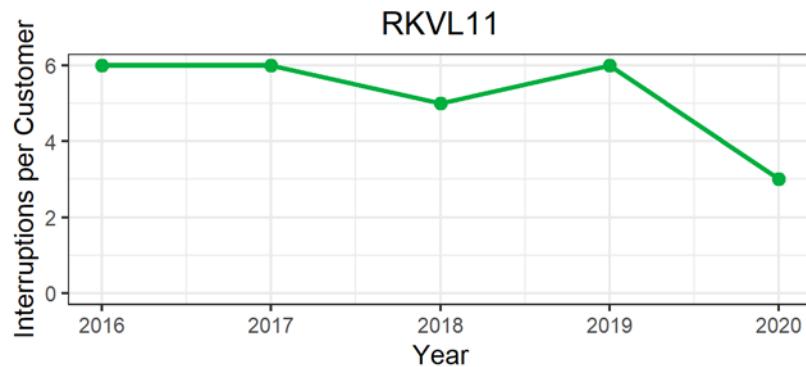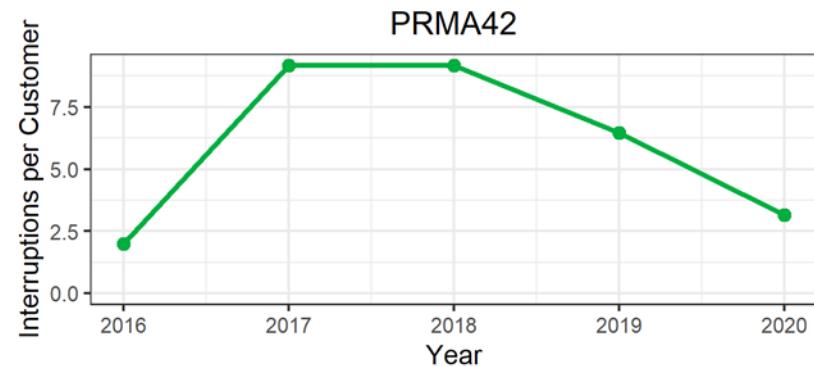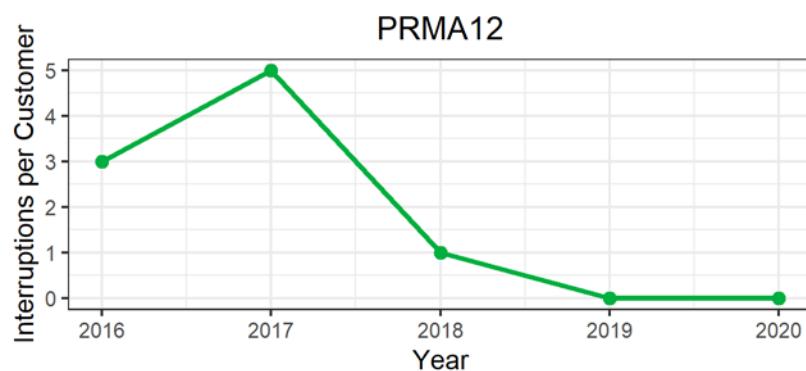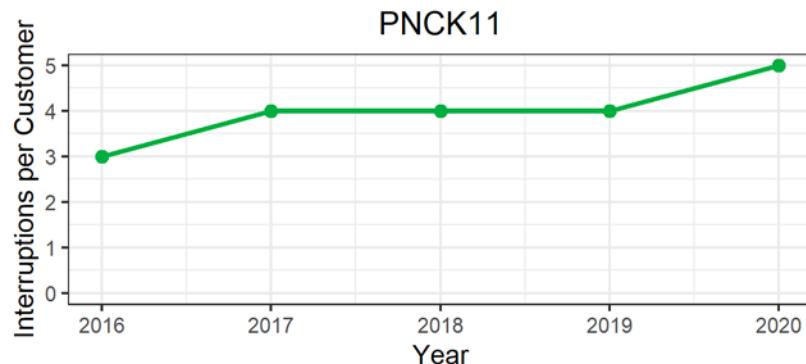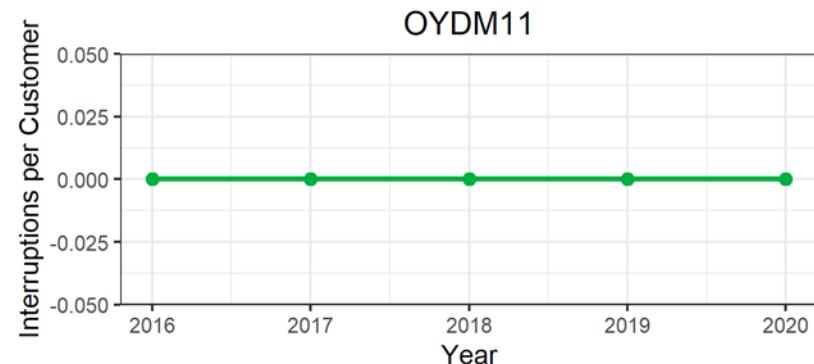

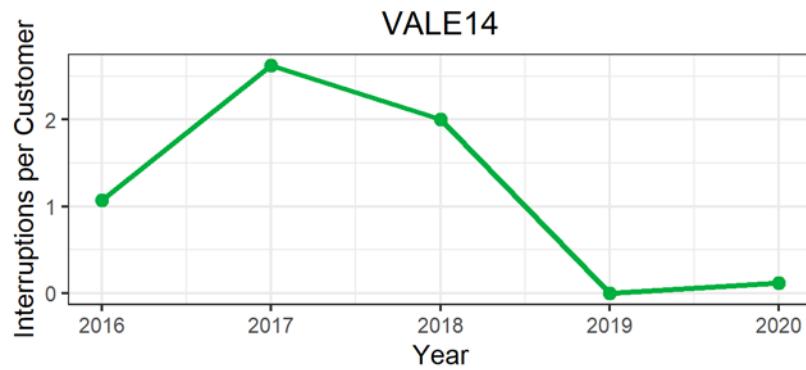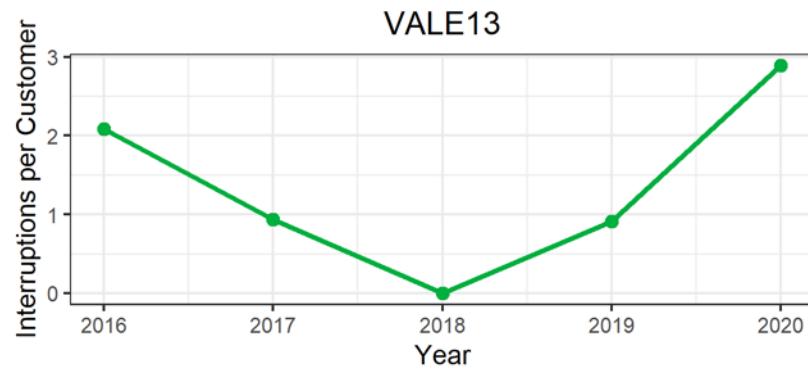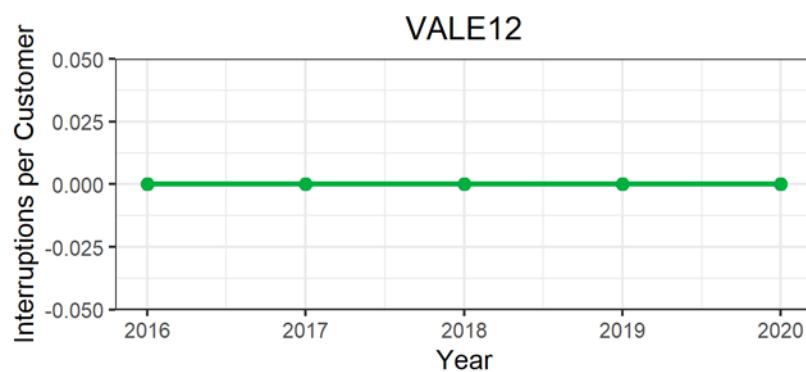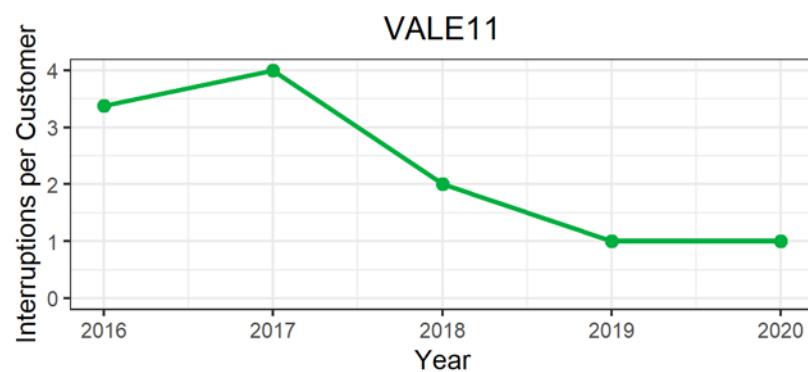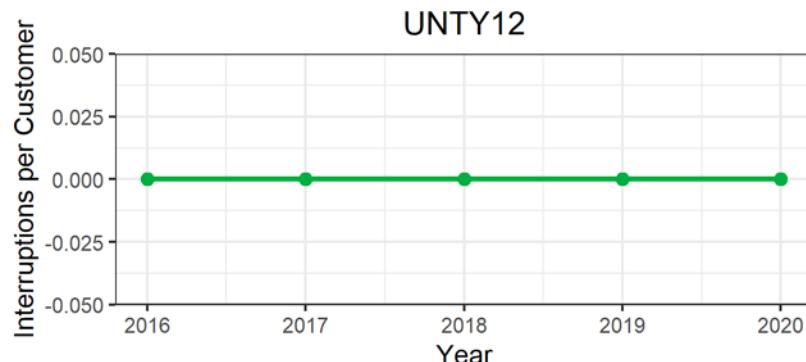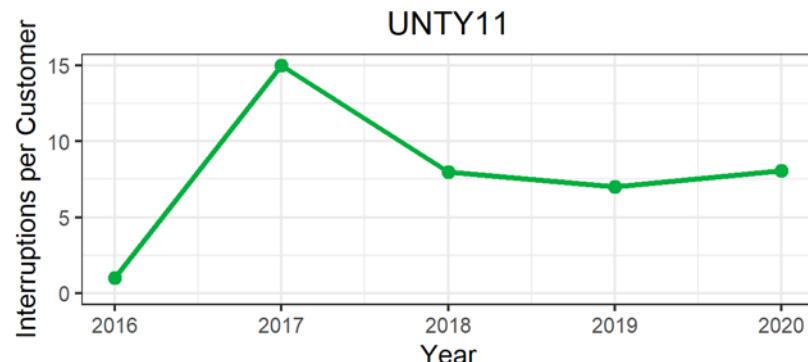

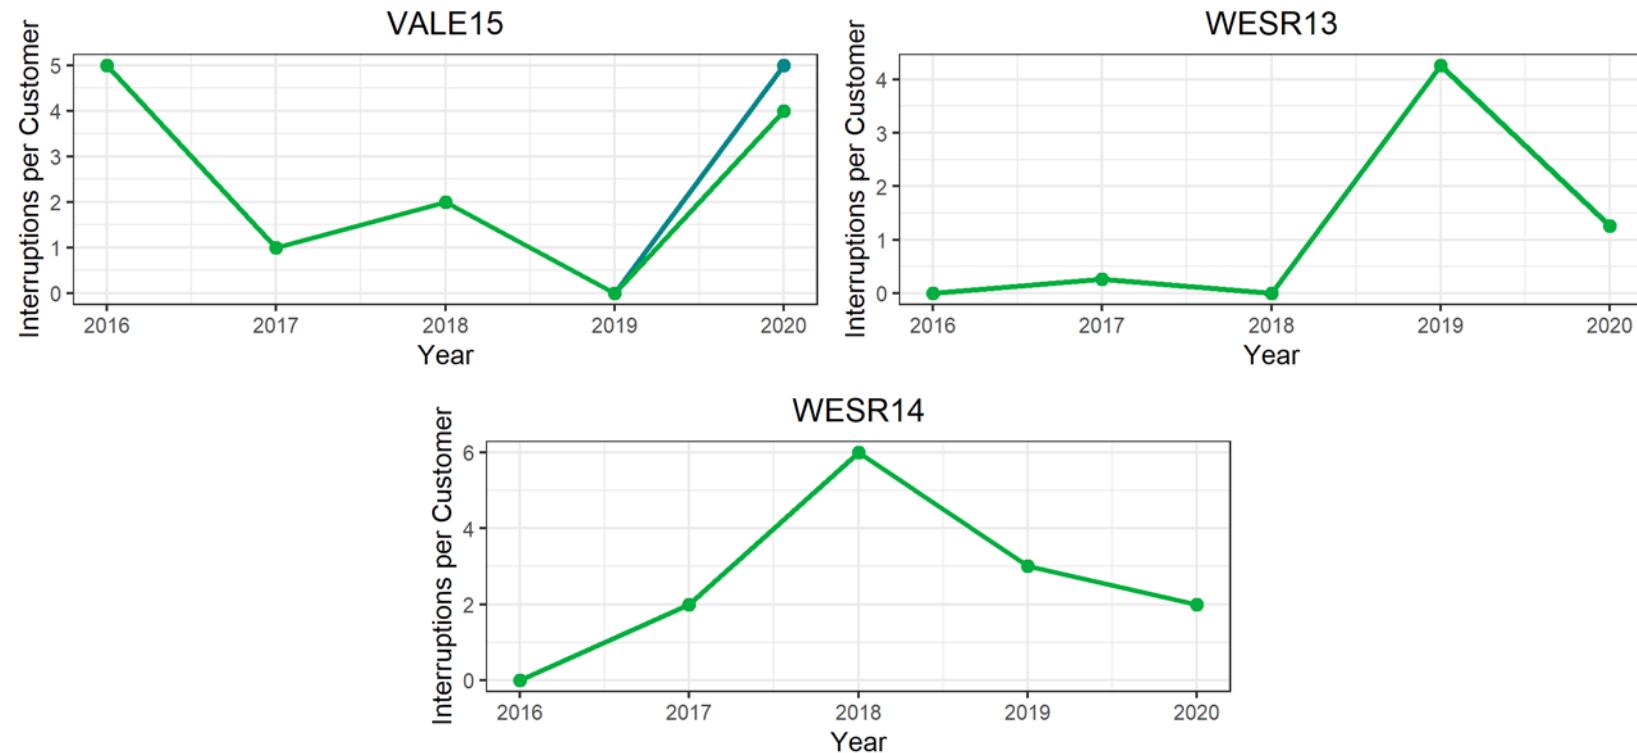


Figure 8 Five Years of Circuit MAIFI_E

2020 Descending Indices by Circuit

Circuit	SAIDI MedEx	SAIFI MedEx	Circuit	SAIFI	SAIFI MedEx	Circuit	MAIFI _E MedEx
PNCK11	27.39	27.39	RKVL11	5.22	5.22	HFWY12	17.00
JNYY31	19.07	19.07	PNCK11	4.82	4.82	UNTY11	8.05
RKVL11	17.07	17.07	JNYY31	4.57	4.57	JNTA12	8.00
JNYY11	17.02	17.02	HRPR11	4.42	4.42	CARO11	5.43
JNYY12	16.29	16.29	JNYY11	4.14	4.14	HOLY12	5.00
HRPR11	14.32	14.32	DWSY11	4.06	4.06	PNCK11	5.00
DWSY11	13.44	13.44	ESTN11	4.00	4.00	VALE15	5.00
JNTA12	12.08	12.08	JNYY12	3.86	3.86	HRPR11	4.63
ESTN11	11.40	11.40	HRPR12	3.68	3.68	DWSY11	4.48
CWVY11	11.00	11.00	JNTA12	3.19	3.19	JNYY31	4.46
CWVY12	10.99	10.99	JNTA11	3.16	3.16	HGTN11	4.00
JNTA11	10.89	10.89	LIME11	2.33	2.33	HGTN12	4.00
HRPR12	9.70	9.70	CWVY11	2.17	2.17	JMSN12	4.00
HFWY12	7.84	0.29	CWVY12	2.15	2.15	CARO12	3.95
HFWY11	7.36	7.36	PRMA42	2.15	2.15	HRPR12	3.45
LIME11	6.87	6.87	ADRN11	2.14	2.14	PRMA42	3.15
UNTY12	6.85	6.85	UNTY11	2.10	2.10	DRKE11	3.00
HOPE11	6.11	6.11	MRBT41	2.03	2.03	JNTA11	3.00
UNTY11	5.99	5.99	JMSN11	1.88	1.88	MRBT41	3.00
PRMA42	5.95	5.95	VALE14	1.67	1.67	OIDA11	3.00
PNCK12	4.48	4.48	UNTY12	1.65	1.65	ONTO18	3.00
MRBT41	4.15	4.15	OIDA11	1.63	1.63	RKVL11	3.00
CARO11	3.89	3.89	HFWY11	1.39	1.39	VALE13	2.89
HGTN11	3.88	3.88	HOPE11	1.32	1.32	HOPE11	2.39
ADRN11	3.68	3.68	WESR14	1.29	1.29	ADRN12	2.09
JMSN11	3.50	3.50	ADRN12	1.29	1.29	ADRN11	2.09
VALE13	3.42	3.42	DRKE11	1.25	1.25	HMDL12	2.04
VALE14	3.14	3.14	HMDL12	1.17	1.17	MRBT42	2.00
HGTN12	3.06	3.06	HFWY12	1.13	0.21	NYSA11	2.00
DRKE11	2.93	2.93	JMSN12	1.12	1.12	WESR14	2.00
OIDA11	2.77	2.77	HGTN12	1.06	1.06	HFWY11	1.73
ADRN12	2.19	2.19	HGTN11	1.06	1.06	ONTO19	1.34
JMSN12	2.15	2.15	CARO13	1.04	1.04	WESR13	1.26
WESR14	1.71	1.71	NYSA12	1.02	1.02	JNYY12	1.00
NYSA13	1.71	1.71	PNCK12	1.00	1.00	ONTO20	1.00
HMDL12	1.43	1.43	NYSA13	0.78	0.78	VALE11	1.00
HOLY13	1.08	1.08	HOLY13	0.61	0.61	JMSN11	0.87
WESR13	1.04	1.04	WESR13	0.61	0.61	ONTO24	0.68
ONTO20	0.98	0.98	CARO11	0.57	0.57	LIME11	0.60
HOLY12	0.92	0.92	VALE13	0.54	0.54	NYSA13	0.52
HOLY11	0.86	0.86	ONTO20	0.49	0.49	VALE14	0.12
CARO13	0.86	0.86	HOLY11	0.47	0.47	CARO13	0.00
CARO12	0.66	0.66	HOLY12	0.38	0.38	CWVY11	0.00
ONTO19	0.55	0.55	ONTO24	0.38	0.38	CWVY12	0.00
VALE15	0.48	0.48	CARO12	0.30	0.30	DUKE11	0.00
ONTO24	0.48	0.48	NYSA14	0.23	0.23	ESTN11	0.00
NYSA14	0.31	0.31	VALE15	0.20	0.20	HCSU11	0.00
NYSA12	0.20	0.20	ONTO19	0.19	0.19	HOLY11	0.00
NYSA11	0.10	0.10	NYSA11	0.05	0.05	HOLY13	0.00
VALE11	0.10	0.10	ONTO25	0.04	0.04	HOLY14	0.00
ONTO18	0.03	0.03	VALE11	0.03	0.03	JNYY11	0.00
ONTO25	0.03	0.03	ONTO18	0.02	0.02	NYSA12	0.00
DUKE11	0.00	0.00	DUKE11	0.00	0.00	NYSA14	0.00
HCSU11	0.00	0.00	HCSU11	0.00	0.00	OBPR11	0.00
HOLY14	0.00	0.00	HOLY14	0.00	0.00	OIDA12	0.00
MRBT41	0.00	0.00	MRBT41	0.00	0.00	ONTO14	0.00
OBPR11	0.00	0.00	OBPR11	0.00	0.00	ONTO23	0.00
OIDA12	0.00	0.00	OIDA12	0.00	0.00	ONTO25	0.00
ONTO14	0.00	0.00	ONTO14	0.00	0.00	OYDM11	0.00
ONTO23	0.00	0.00	ONTO23	0.00	0.00	PNCK12	0.00
OYDM11	0.00	0.00	OYDM11	0.00	0.00	PRMA12	0.00
PRMA12	0.00	0.00	PRMA12	0.00	0.00	UNTY12	0.00
VALE12	0.00	0.00	VALE12	0.00	0.00	VALE12	0.00

Table 9 2020 Descending Indices by Circuit

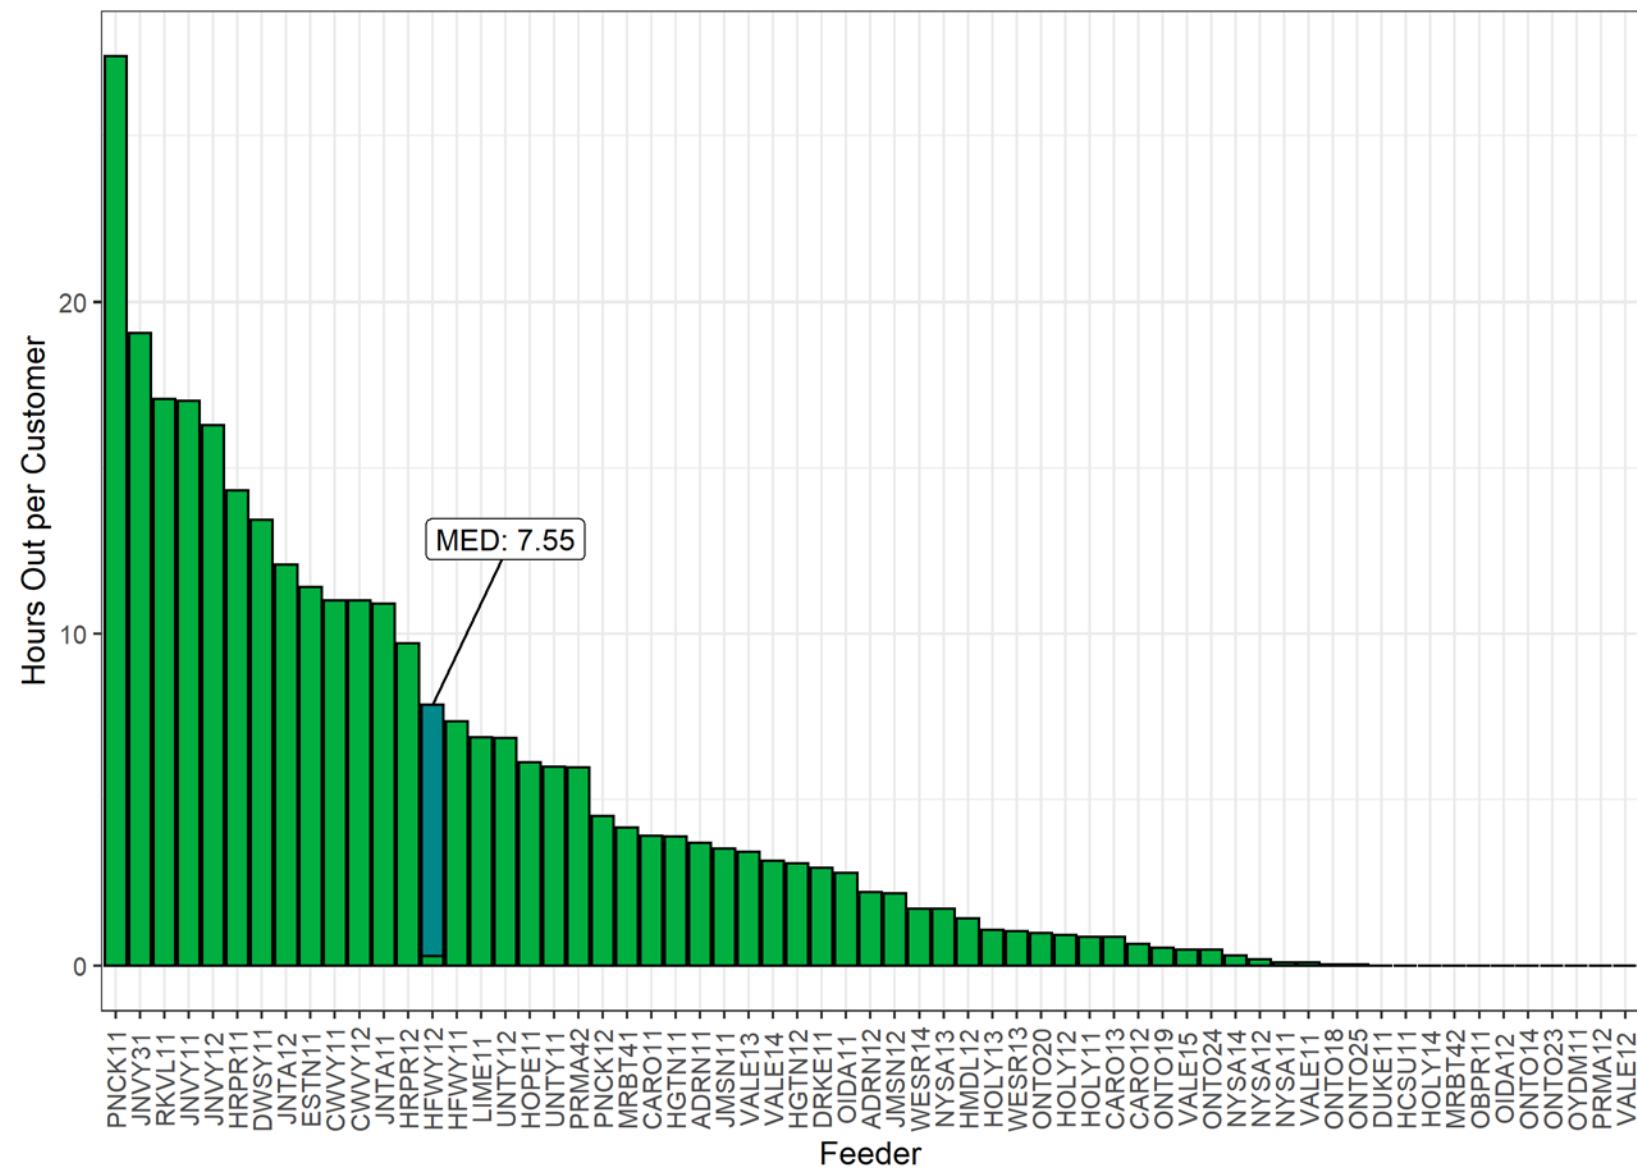


Figure 9 2020 Descending SAIDI by Circuit

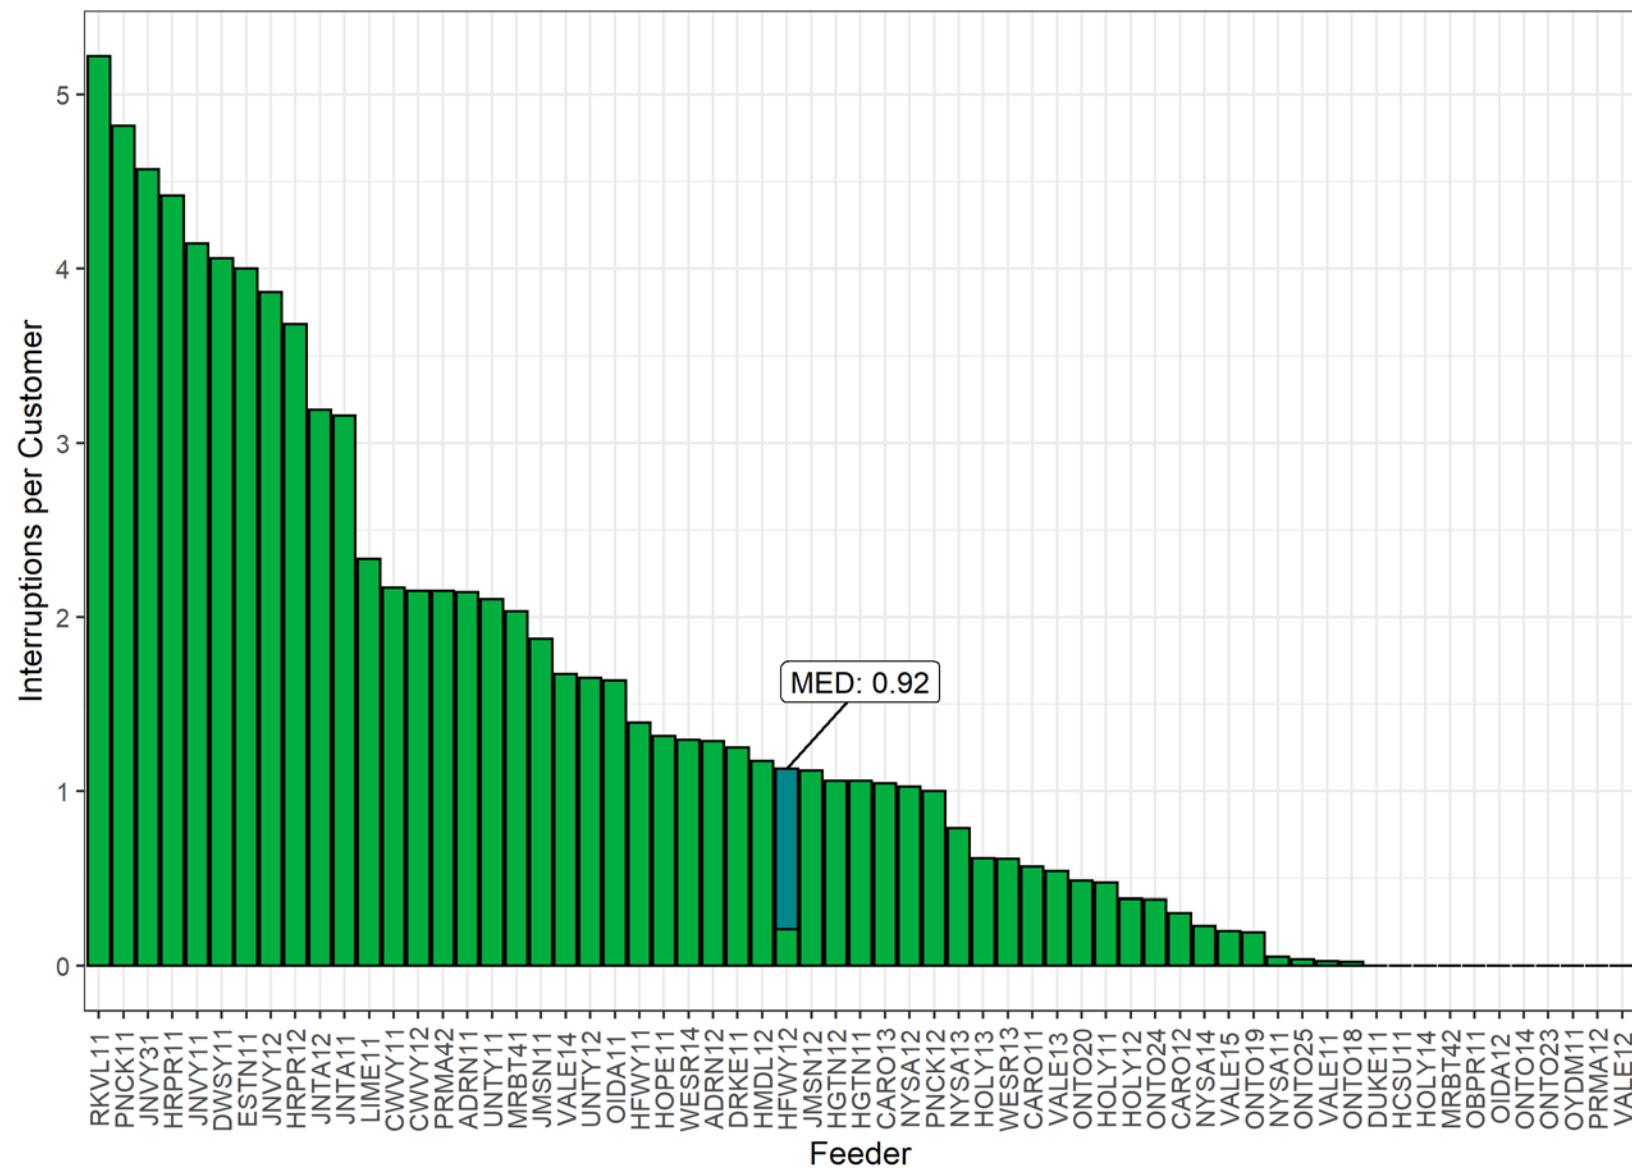
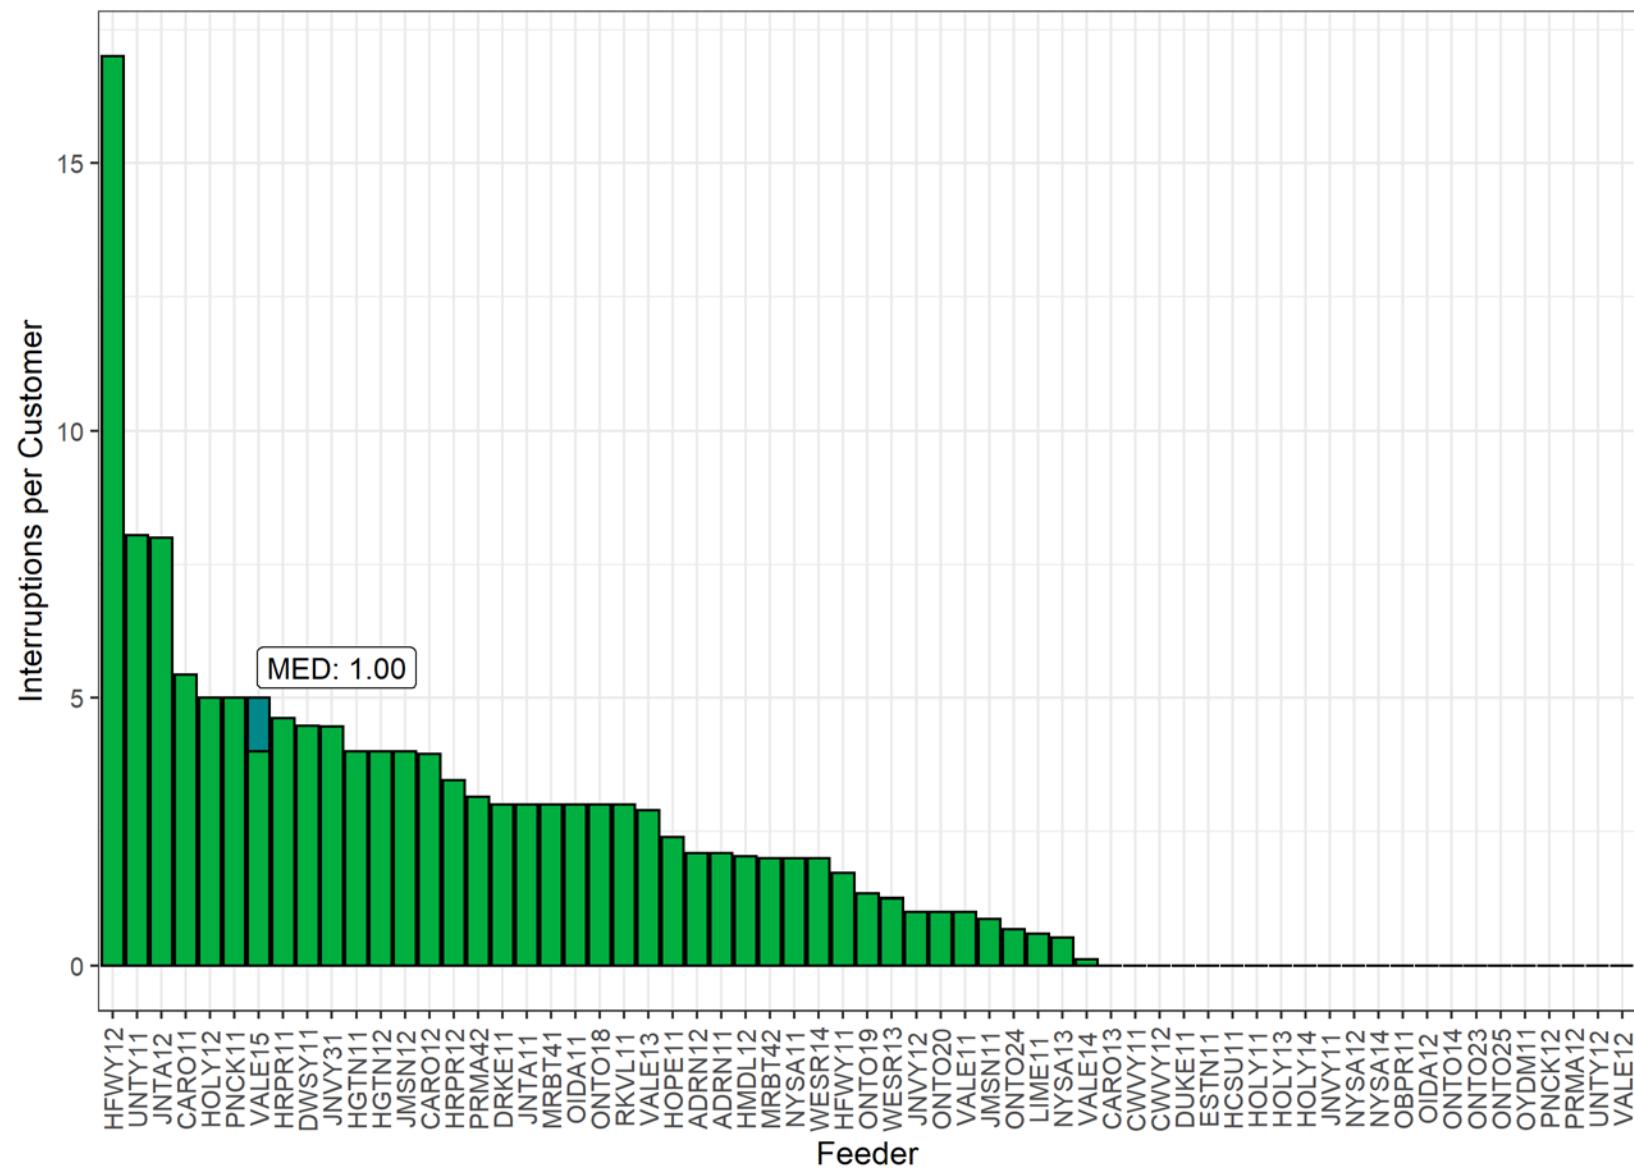


Figure 10 2020 Descending SAIFI by Circuit

Figure 11 2020 Descending MAIFI_E by Circuit

APPENDIX

Circuit Reference Information

Circuit	Substation	Operating Area	Voltage (kV)	Customers*
ADR11	Adrian	Western	12.5	411
ADR12	Adrian	Western	12.5	612
CARO11	Cairo	Western	12.5	1,229
CARO12	Cairo	Western	12.5	90
CARO13	Cairo	Western	12.5	740
CWVY11	Cow Valley	Western	12.5	42
CWVY12	Cow Valley	Western	12.5	112
DRKE11	Durkee	Western	12.5	164
DUKE11	Duke	Western	12.5	29
DWSY11	Drewsey	Western	12.5	185
ESTN11	Easton	Western	12.5	3
HCSU11	Hells Canyon	Western	12.5	2
HFWY11	Halfway	Western	12.5	774
HFWY12	Halfway	Western	12.5	555
HGTN11	Huntington	Western	12.5	88
HGTN12	Huntington	Western	12.5	310
HMDL12	Homedale	Canyon	12.5	146
HOLY11	Holly	Western	12.5	197
HOLY12	Holly	Western	12.5	79
HOLY13	Holly	Western	12.5	171
HOLY14	Holly	Western	12.5	5
HOPE11	Hope	Western	12.5	152
HRPR11	Harper	Western	12.5	110
HRPR12	Harper	Western	12.5	187
JMSN11	Jamieson	Western	12.5	401
JMSN12	Jamieson	Western	12.5	238
JNTA11	Juntura	Western	12.5	63
JNTA12	Juntura	Western	12.5	52
JNVY11	Jordan Valley	Canyon	12.5	90
JNVY12	Jordan Valley	Canyon	12.5	117
JNVY31	Jordan Valley	Canyon	25	347
LIME11	Lime	Western	12.5	120
MRBT41	Malheur Butte	Western	34.5	31
MRBT42	Malheur Butte	Western	34.5	11
NYSA11	Nyssa	Western	12.5	856
NYSA12	Nyssa	Western	12.5	336
NYSA13	Nyssa	Western	12.5	752
NYSA14	Nyssa	Western	12.5	253
OBPR11	Oxbow	Western	12.5	1
OIDA11	Ore-Ida	Western	12.5	672
OIDA12	Ore-Ida	Western	12.5	1
ONTO14	Ontario	Western	12.5	35
ONTO18	Ontario	Western	12.5	870
ONTO19	Ontario	Western	12.5	1,845
ONTO20	Ontario	Western	12.5	1,214
ONTO23	Ontario	Western	12.5	50
ONTO24	Ontario	Western	12.5	712
ONTO25	Ontario	Western	12.5	504
OYDM11	Owyhee Dam	Western	12.5	15
PNCK11	Pine Creek	Western	12.5	94
PNCK12	Pine Creek	Western	12.5	2
PRMA12	Parma	Western	12.5	3
PRMA42	Parma	Western	34.5	193
RKVL11	Rockville	Canyon	12.5	32
UNTY11	Unity	Western	12.5	147
UNTY12	Unity	Western	12.5	239
VALE11	Vale	Western	12.5	1,043
VALE12	Vale	Western	12.5	55
VALE13	Vale	Western	12.5	574
VALE14	Vale	Western	12.5	310
VALE15	Vale	Western	12.5	476
WESR13	Weiser	Western	12.5	197
WESR14	Weiser	Western	12.5	34

Table 10 Circuit Reference Information

*Some circuits have customers in Idaho and Oregon. The counts are for Oregon customers only as of 12/31/2020.

Five Years of System Pole and Trench Miles

Year	Overhead (OH) Pole Miles	Underground (UG) Trench Miles	Distribution All Miles	Transmission Line (Structure/Pole) Miles*	Percent OH / UG
2020	2,113.2	94.0	2,207.2	757.3	95%/5%
2019	2,113.6	100.8	2,214.4	757.3	95%/5%
2018	2,113.0	99.9	2,212.9	757.0	95%/5%
2017	2,114.5	98.9	2,213.5	759.4	96%/4%
2016	2,131.4	97.9	2,229.3	760.3	96%/4%

Table 11 Five Years of System Pole and Trench Miles

*Transmission line miles include some lines that do not directly serve customer load.

2020 Major Event Day System Summary

Date	Cause	Customers	CMI	CI	SAIDI (Minutes)	SAIFI	CAIDI (Minutes)
9/7/2020	Tree/Vegetation	19,326	251,430	510	13.01	0.03	493.00

Table 12 2020 MED System Summary

2020 Major Event Day Feeder Summary

Date	Feeder	Customers	CMI	CI	SAIDI (Minutes)	SAIFI	CAIDI (Minutes)
9/7/2020	HFWY12	546	251,430	510	493.00	0.93	493.00

Table 13 2020 MED Feeder Summary

Five Years of Major Event Days

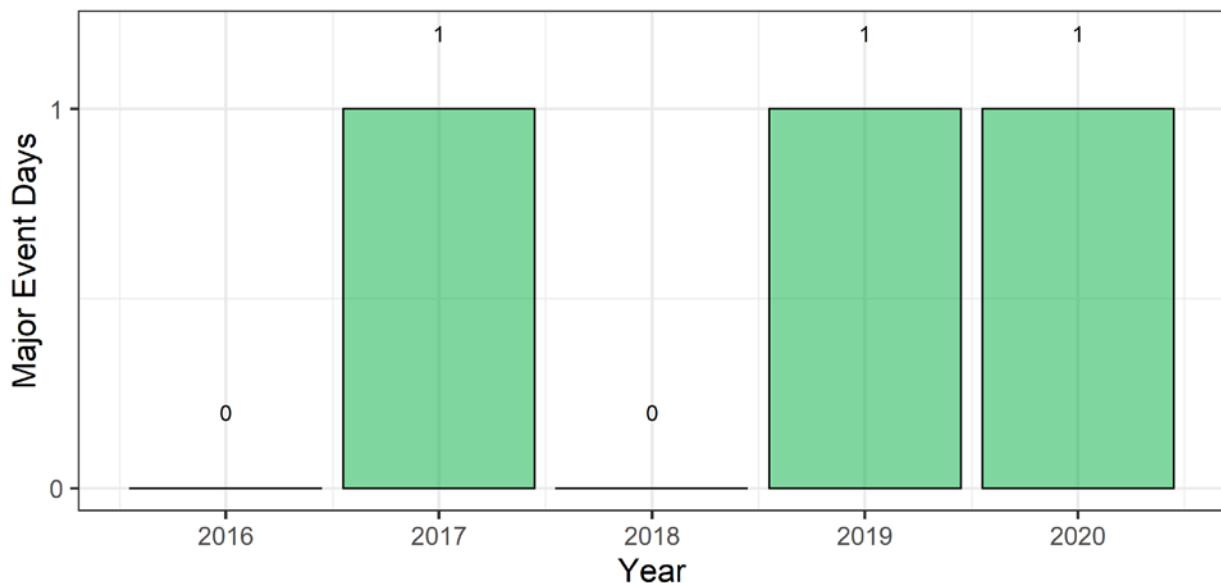


Figure 12 Five Years of MEDs

Cause Category Translation


Idaho Power Cause	OAR 860-023-0151 (2)(b) Cause
Loss of Supply – Transmission*	Loss of Supply – Transmission
Loss of Supply – Station*	Loss of Supply – Substation
Corrosion/Rot	Distribution – Equipment
Electrical Failure	Distribution – Equipment
Loose Hardware	Distribution – Equipment
Mechanical Failure	Distribution – Equipment
Improper Installation	Distribution – Equipment
Contamination	Distribution – Equipment
Lightning	Distribution – Lightning
Other IPC Circuit	Distribution – Other
Other (Define in Comments)	Distribution – Other
Safety Precaution	Distribution – Other
Utility Operating Error	Distribution – Other
Planned Maintenance	Distribution – Planned
Structures (Signs, Buildings)	Distribution – Public
Construction/Dig-in	Distribution – Public
Foreign Object (Pipe, Kite, Tree Trim)	Distribution – Public
Vandalism	Distribution – Public
Vehicle Collision	Distribution – Public
Momentary (Tripping)	Distribution – Unknown
Unknown	Distribution – Unknown
Tree/Vegetation	Distribution – Vegetation
Loading/Unloading (Snow, Ice)	Distribution – Weather (Non-Lightning)
Unstable Earth	Distribution – Weather (Non-Lightning)
Load Shed/Transfer	Distribution – Weather (Non-Lightning)
Wildland/Building Fire	Distribution – Weather (Non-Lightning)
Overload/Cold Load	Distribution – Weather (Non-Lightning)
Bird – NonRaptor	Distribution – Wildlife
Bird – Raptor	Distribution – Wildlife
Large Animal (Livestock)	Distribution – Wildlife
Small Animal	Distribution – Wildlife

Table 14 Cause Category Translation


*These are also identified from the Idaho Power SYSTEM field. This field has values for “Transmission”, “Substation”, “Distribution Primary OH”, “Distribution Primary UG”, “Secondary/Service OH” and “Secondary/Service UG”. So, “Loss of Supply – Transmission” in this report includes events where the CAUSE field was “Loss of Supply – Transmission” **or** the SYSTEM field was “Transmission”, and “Loss of Supply – Substation” includes events where the CAUSE field was “Loss of Supply – Station” **or** the SYSTEM field was “Substation”.

MAPS


2020 Customers Oregon Area

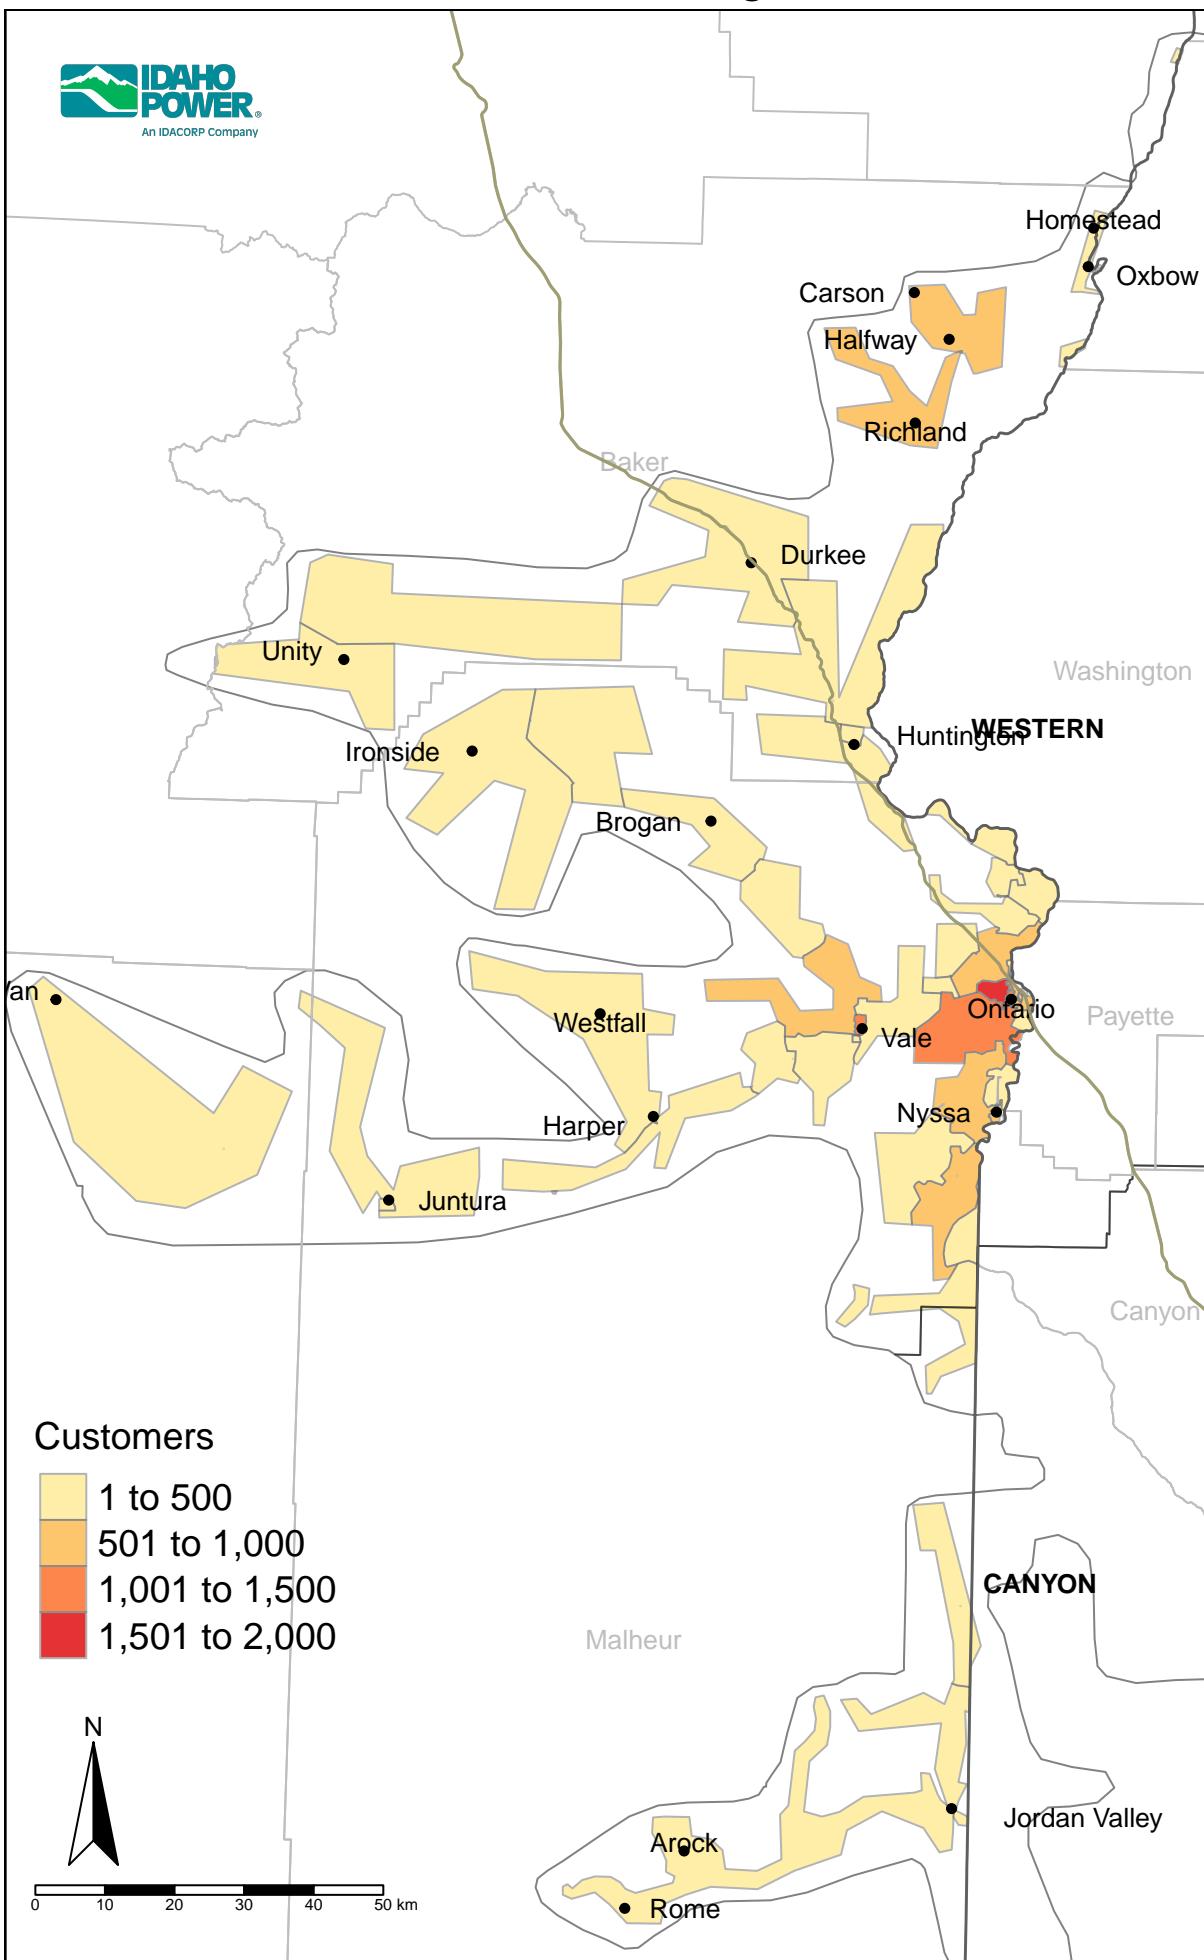


2020 SAIDI with MED Oregon Area

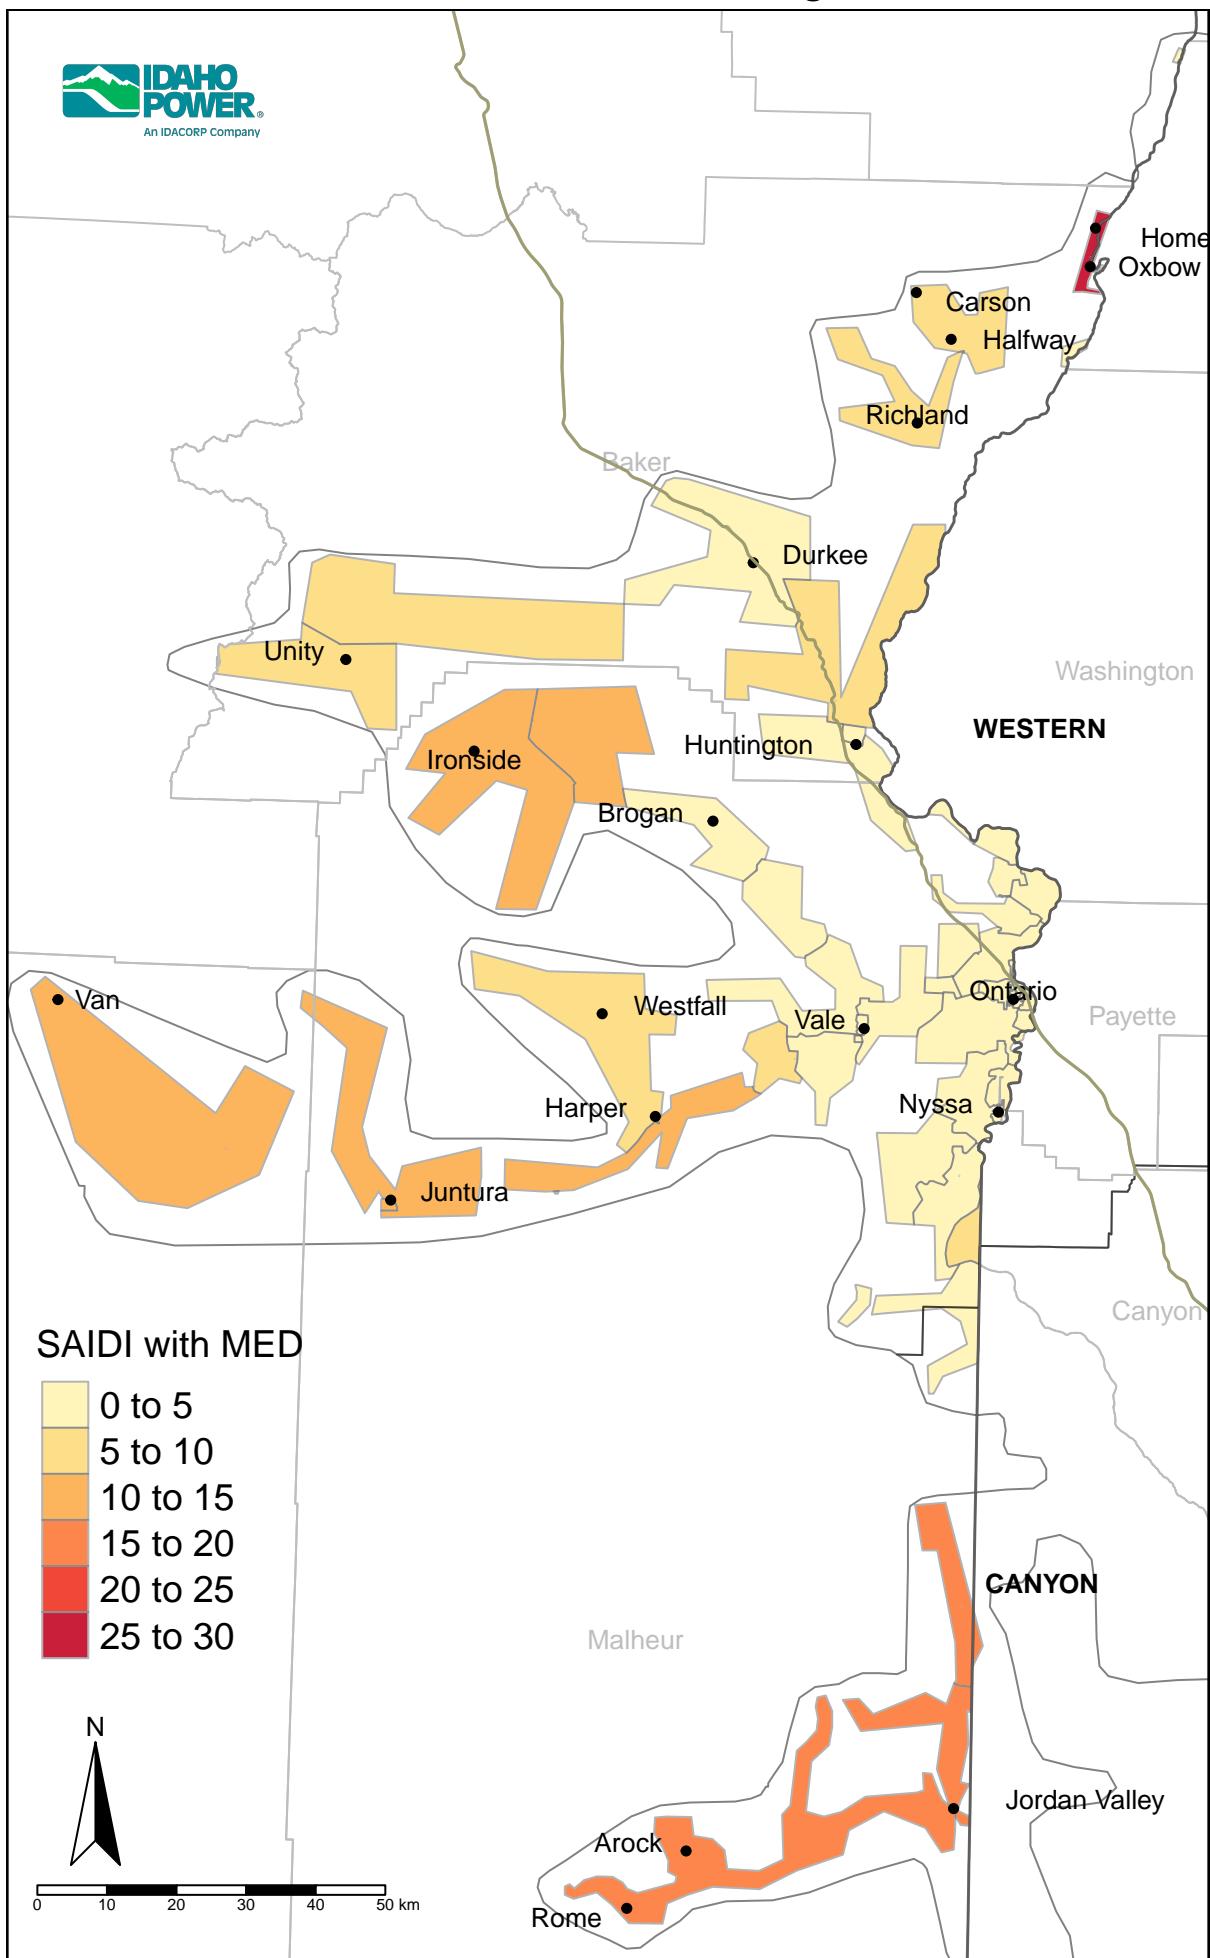


2020 SAIDI w/o MED Oregon Area

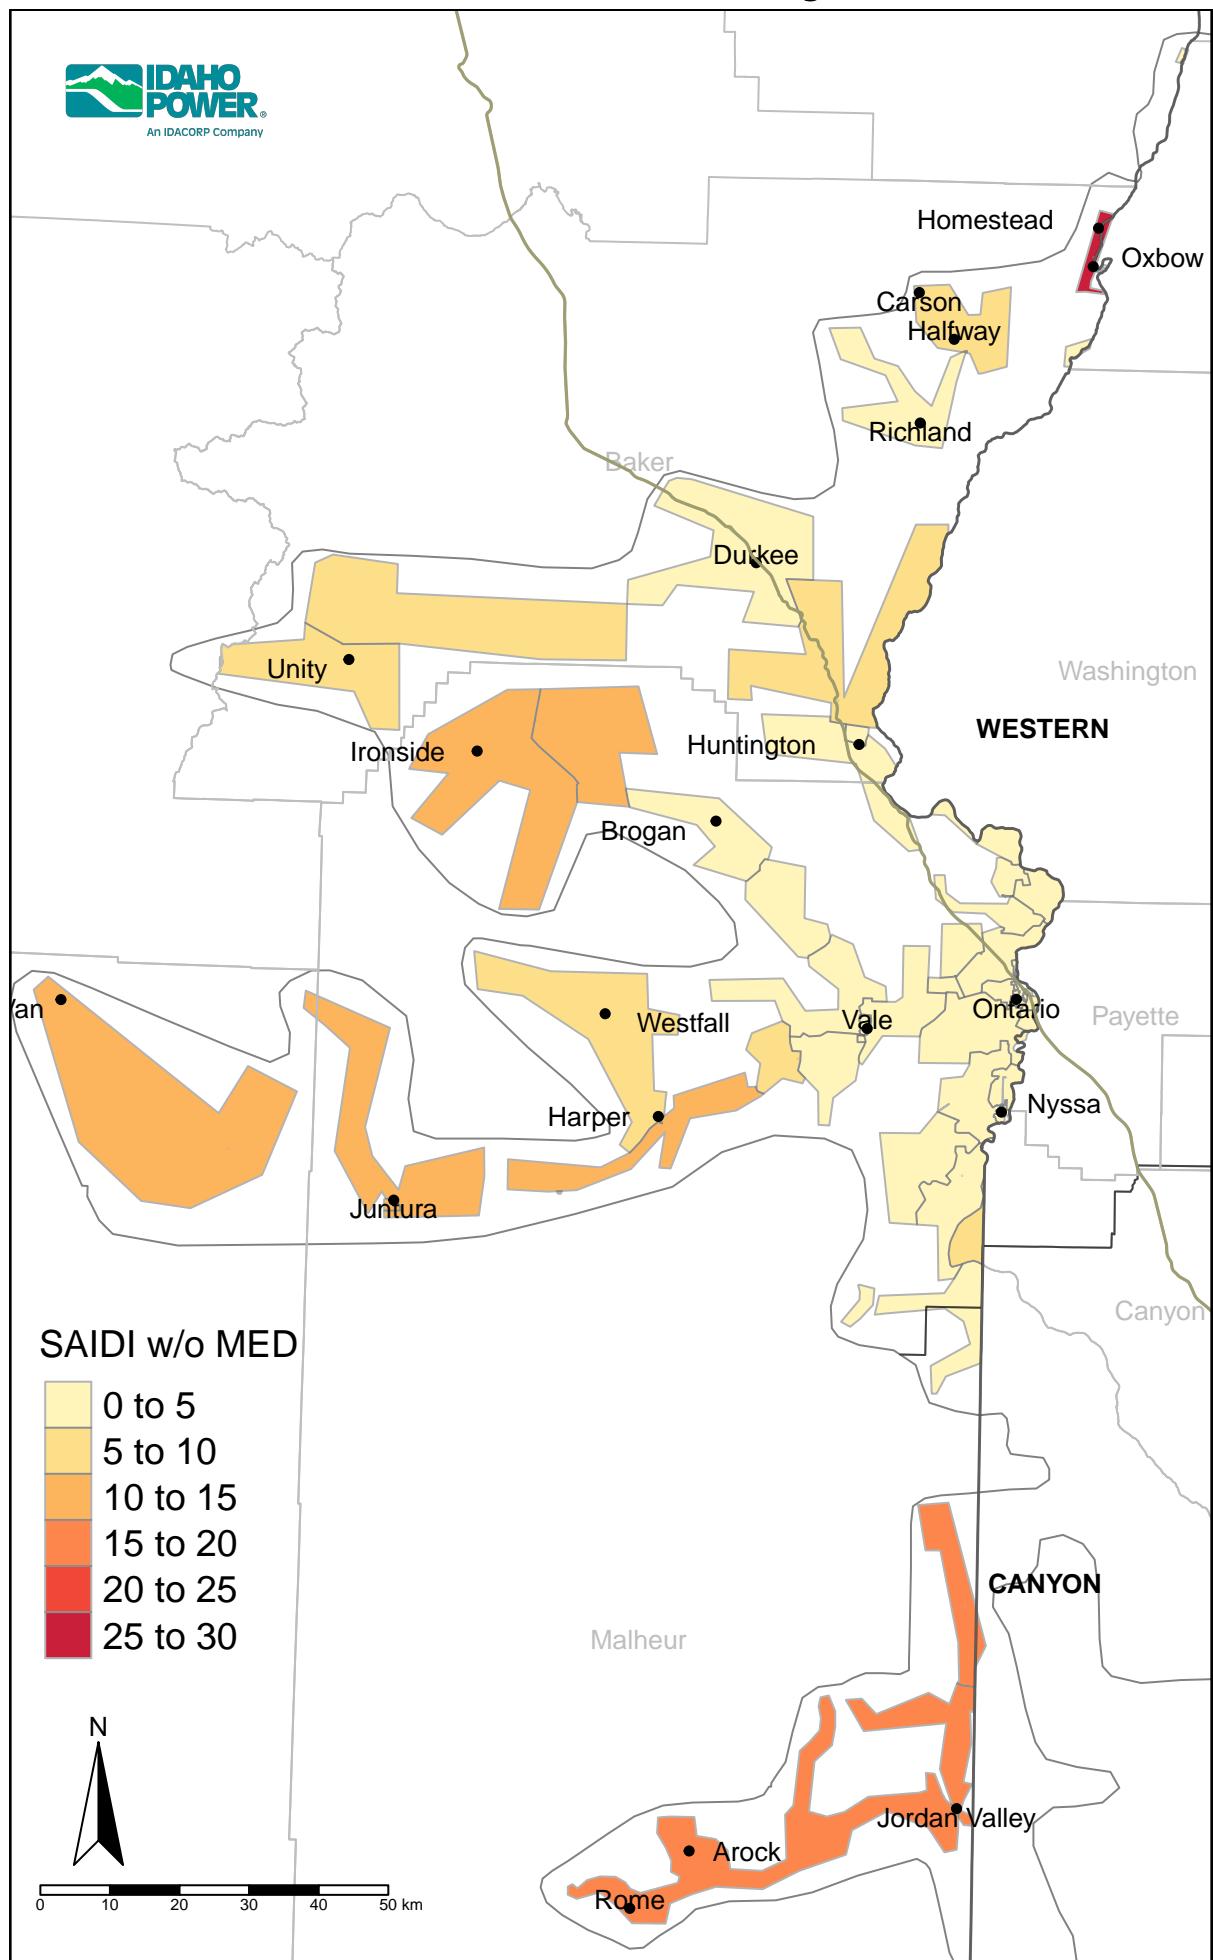


2020 SAIFI with MED Oregon Area

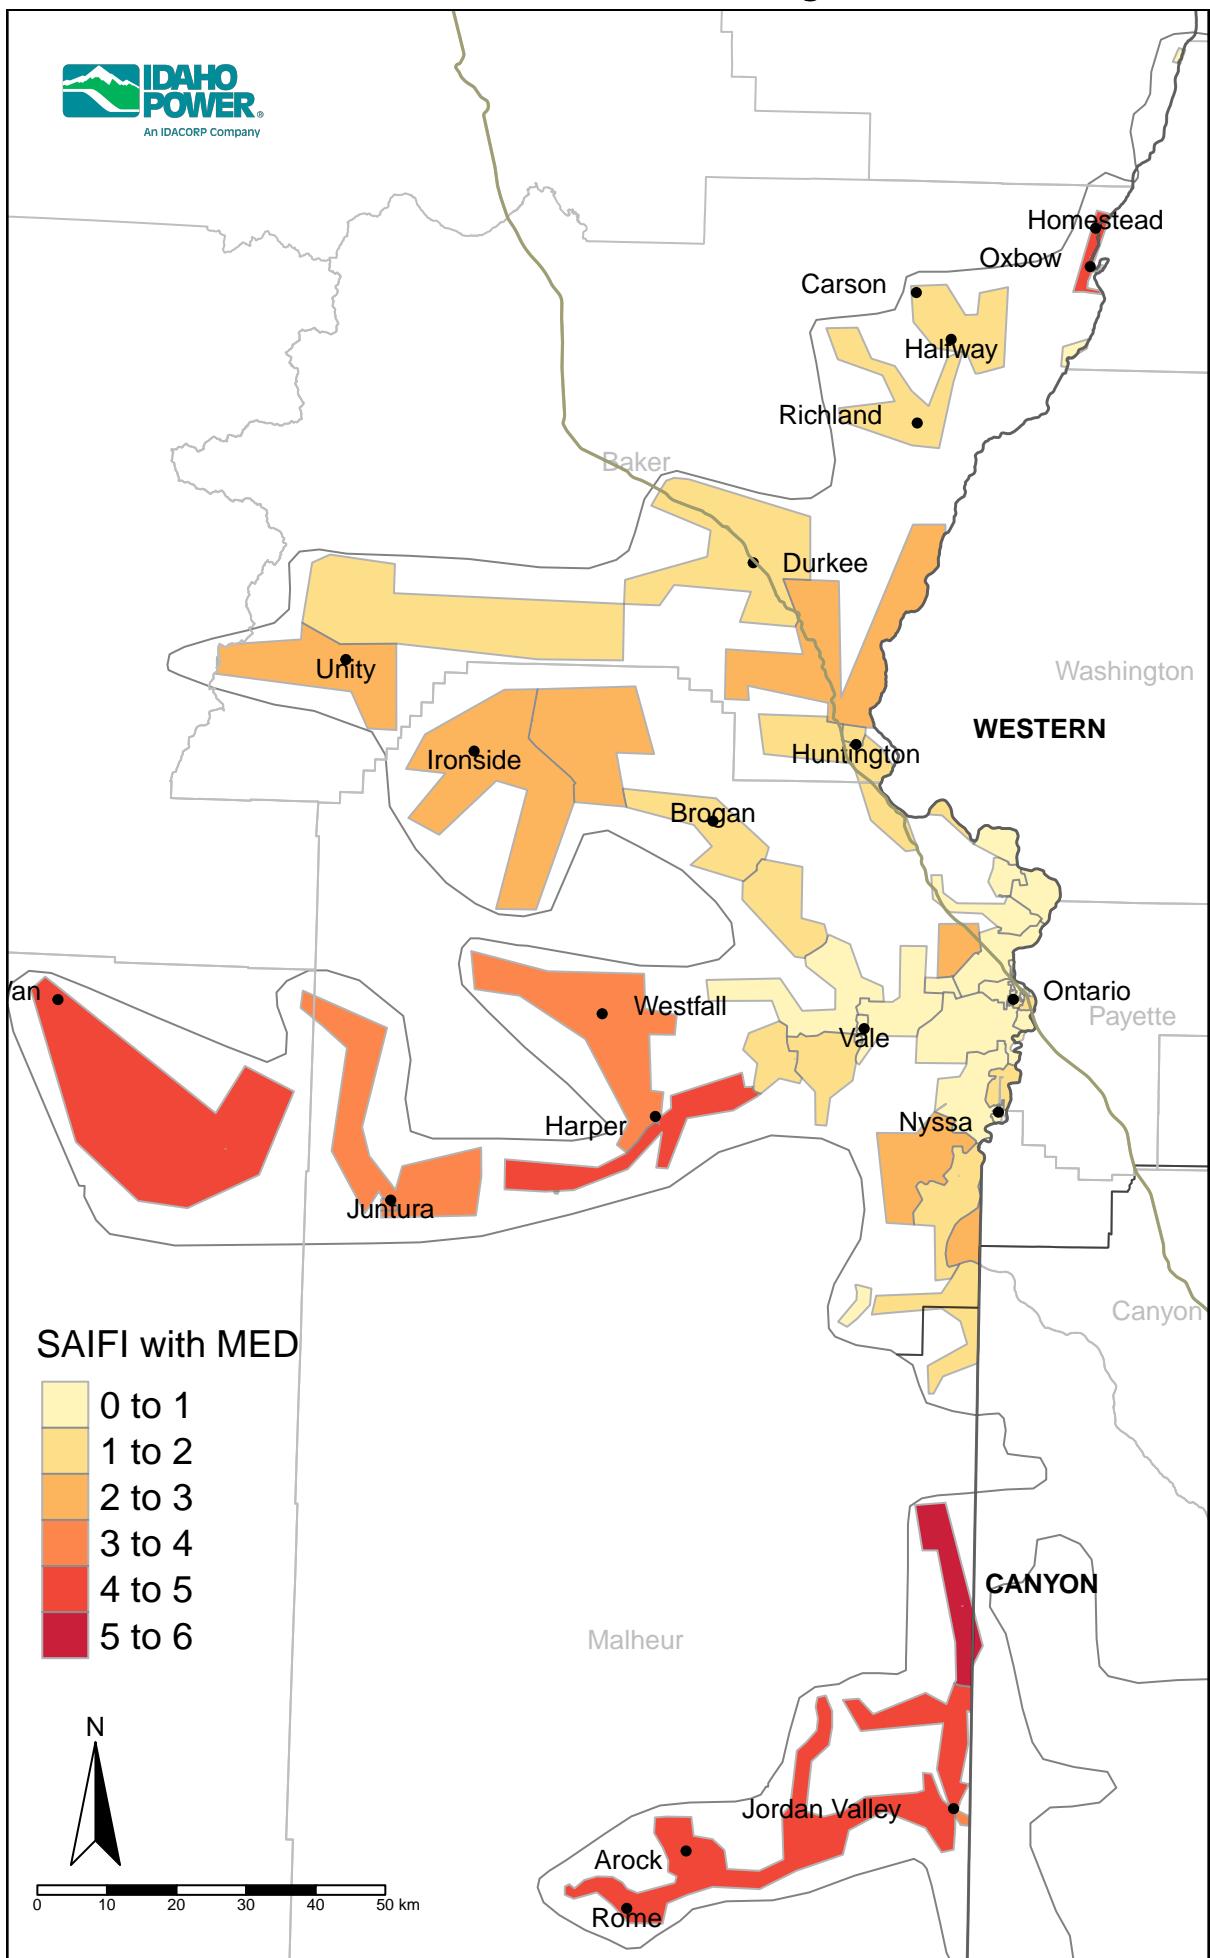

2020 SAIFI w/o MED Oregon Area

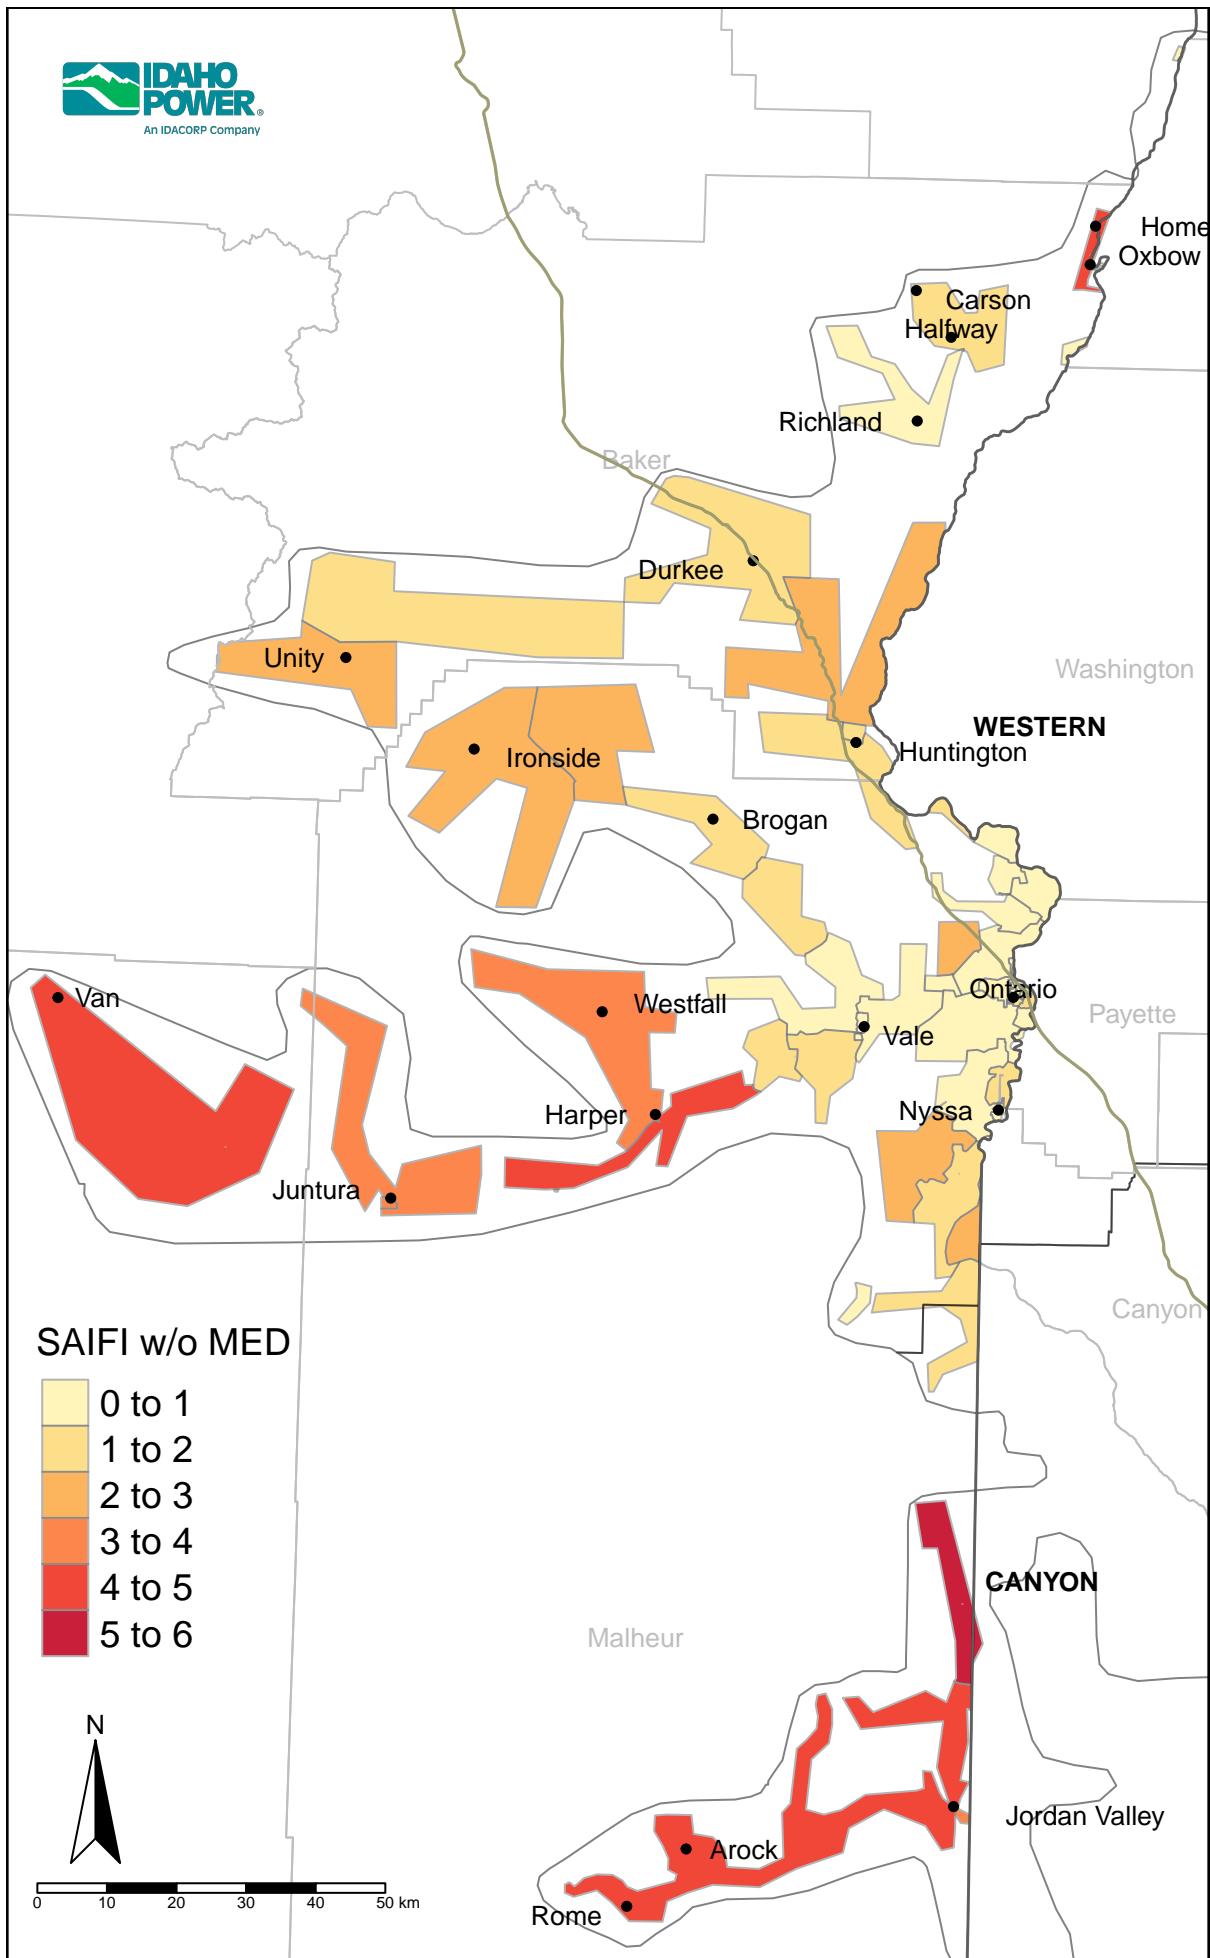

2020 MAIFIE with MED Oregon Area

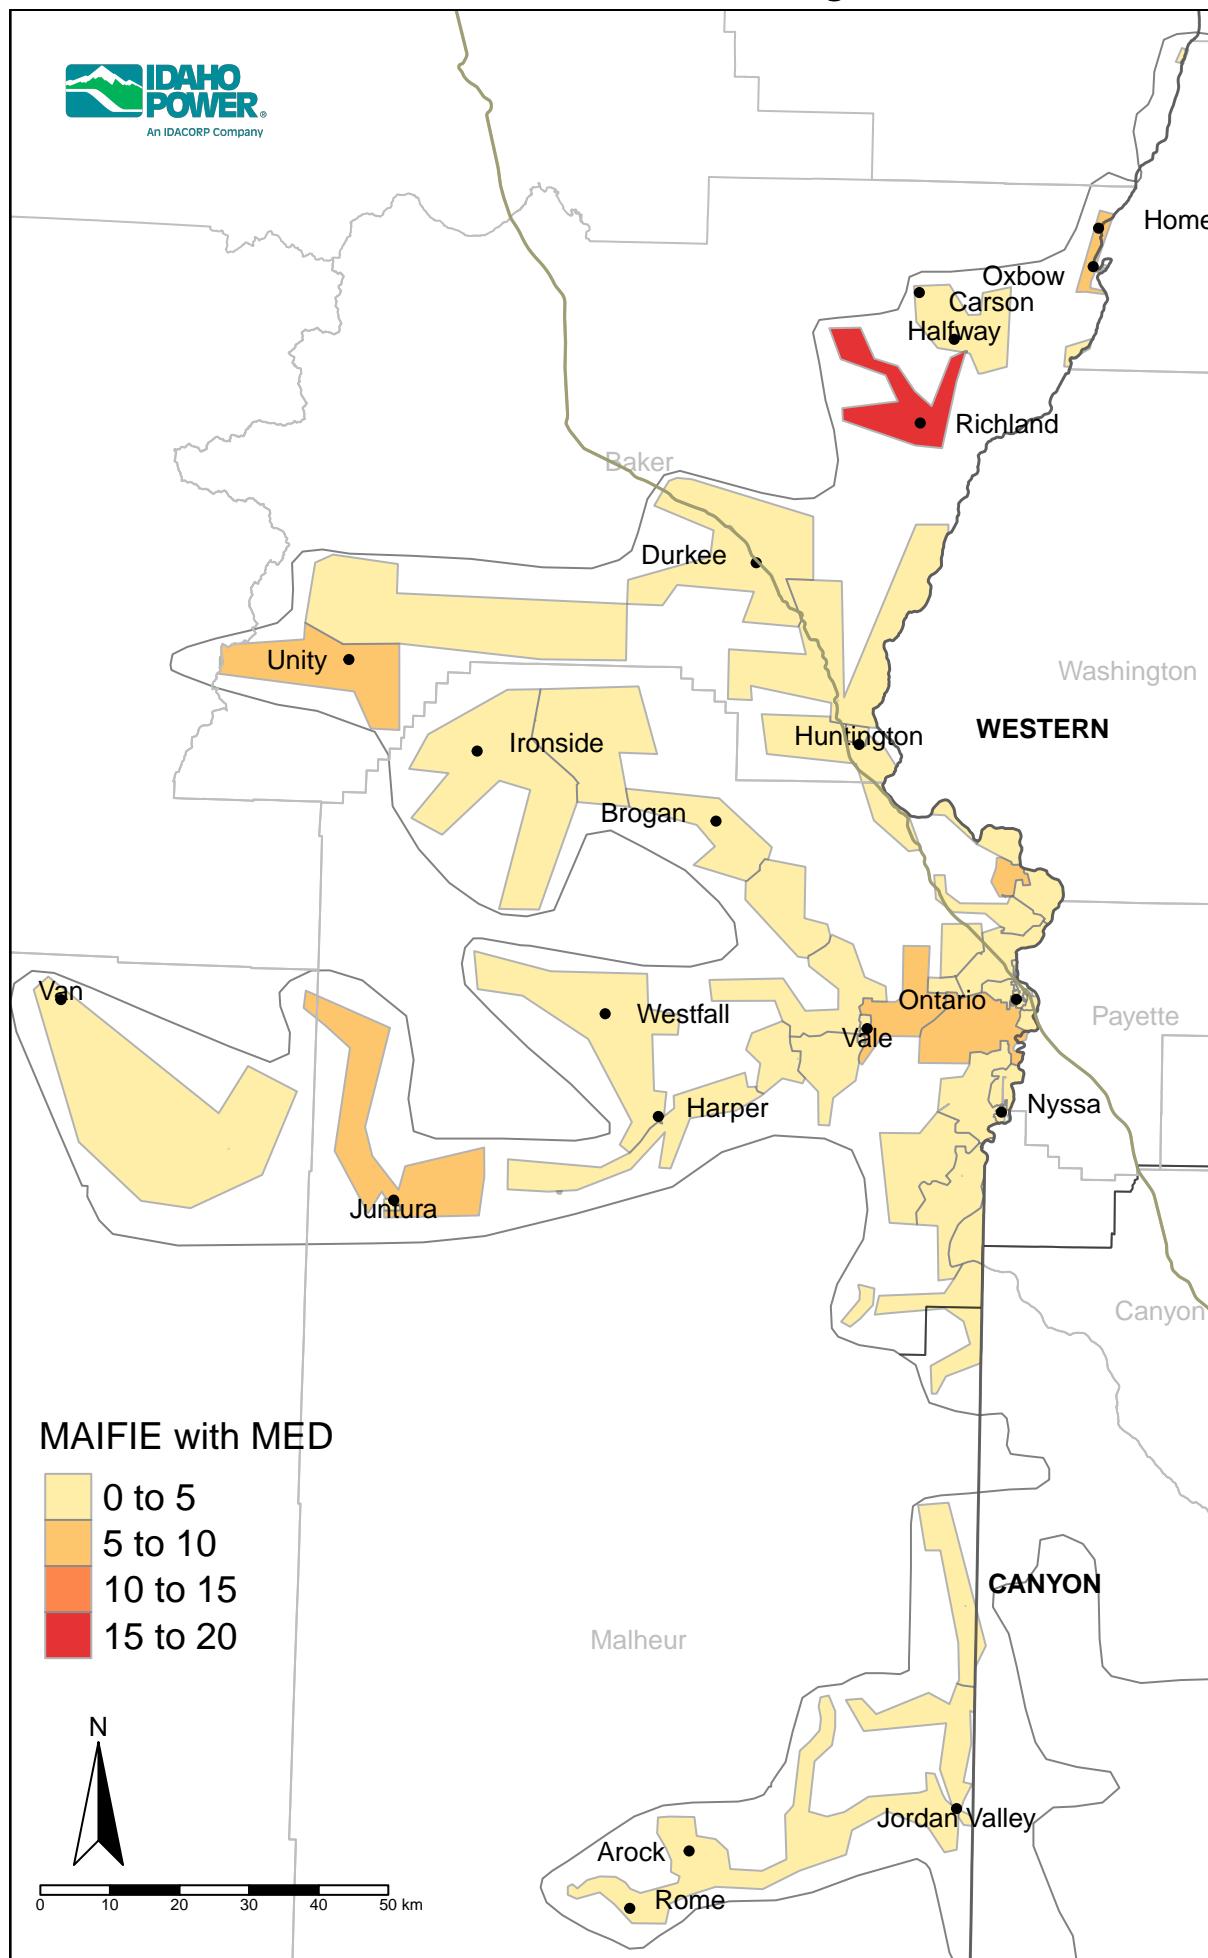

2020 MAIFIE w/o MED Oregon Area

