



825 NE Multnomah, Suite 2000
Portland, Oregon 97232

June 10, 2014

***VIA ELECTRONIC FILING
AND OVERNIGHT DELIVERY***

Public Utility Commission of Oregon
3930 Fairview Industrial Dr. SE
Salem, Oregon 97302-1166

Attn: Filing Center

Re: Docket UM 1694

On May 21, 2014, Loyd Fery Farms, LLC submitted a complaint against PacifiCorp, d/b/a Pacific Power (PacifiCorp or the Company) to the Public Utility Commission of Oregon, docketed as UM 1694. The Company hereby submits its answer in response to the complaint.

Please contact Natasha Siores, Director of Regulatory Affairs at (503) 813-6853 for questions on this matter.

Sincerely,

A handwritten signature in black ink that reads "R. Bryce Dalley" followed by a stylized flourish or initials.

R. Bryce Dalley
Vice President, Regulation

Enclosures

Cc: Service List - UM 1694

CERTIFICATE OF SERVICE

I certify that I served a true and correct copy of Pacific Power's Answer on the parties listed below via electronic mail and/or US mail in compliance with OAR 860-001-0180.


UM 1694

Loyd Fery
Loyd Fery Farms
11022 Rainwater Lane SE
Aumsville, OR 97325
dlchain@wvi.com

Barb Coughlin
Pacific Power
825 NE Multnomah St. Ste 800
Portland, OR 97232
Barb.coughlin@pacificorp.com

Donna Fery
Roush Hydro
366 E Water
Stayton, OR 97383
donna@wvi.com

Dated this 10th day of June, 2014.



Carrie Meyer
Supervisor, Regulatory Operations

**BEFORE THE PUBLIC UTILITY COMMISSION
OF OREGON
UM 1694**

Loyd Fery Farms, LLC, Complainant
vs.
PacifiCorp d/b/a Pacific Power, Respondent

ANSWER TO COMPLAINT
OF LOYD FERY FARMS, LLC

1 Consistent with ORS 756.612 and OAR 860-001-0400, PacifiCorp d/b/a Pacific
2 Power (PacifiCorp or the Company) files this answer to the complaint of Loyd Fery Farms,
3 LLC (Fery Farms or Complainant), mailed to the Public Utility Commission of Oregon on
4 March 4, 2014 and served on PacifiCorp May 21, 2014 (the Complaint). PacifiCorp answers
5 as follows:

I. BACKGROUND

6
7 Fery Farms operates a hydroelectric qualifying facility (QF) and sells the output of
8 the Fery Farms QF to PacifiCorp through a Power Purchase Agreement (PPA) entered into
9 December 9, 2013 and attached to this answer as Confidential Exhibit A. The
10 interconnection of the Fery Farms QF is governed by a Generation Interconnection
11 Agreement (GIA) entered into January 11, 2013 and attached to this answer as Exhibit B.

II. RESPONSE TO ALLEGATIONS

12
13 The Complaint raises three issues related to the PPA and GIA. First, Fery Farms
14 alleges the Company's installation of bi-directional meters at the Fery Farms QF resulted in a
15 more than 50 percent reduction in the avoided cost rate paid by PacifiCorp. Second, Fery
16 Farms alleges that PacifiCorp's avoided cost structure under Oregon Schedule 37 is flawed.
17 Finally, Fery Farms alleges that PacifiCorp is improperly charging fees related to the
18 Company's provision of station service to the Fery Farms QF, including monthly basic
19 service charges under Oregon Schedule 23—General Service-Small Nonresidential Delivery

1 Service (Oregon Schedule 23). As fully explained below, Fery Farms’s grievances are
2 misguided and do not cite to any legal authority as a basis for the allegations, and the
3 Company therefore moves to dismiss the Complaint.

4 **a. The installation of a bi-directional meter did not impact the avoided cost rate**
5 **paid to Fery Farms.**

6 Fery Farms claims the “kWh price,” which PacifiCorp understands to mean the
7 avoided cost rate, has been reduced due to the installation of bi-directional meters at the Fery
8 Farms QF. This allegation is unfounded. The installation of bi-directional meters measures
9 generation output and does not impact the avoided cost rate paid to QF generators. At all
10 times, the Company has compensated Fery Farms the appropriate avoided cost rate as
11 determined by Oregon Schedule 37.

12 The rate paid to Fery Farms for generational output is determined by PacifiCorp’s
13 Oregon Schedule 37. The avoided cost rate at the time Fery Farms executed the currently
14 effective PPA on December 9, 2013 was lower than the avoided cost rate established in Fery
15 Farms’s previously effective PPA, resulting in the reduction in the overall payments received
16 by Fery Farms for the QF’s generational output.

17 Although Fery Farms does not allege PacifiCorp’s installation of bi-directional
18 metering was inappropriate, the Company seeks to clarify the installation of the bi-directional
19 meter is consistent with the GIA. Because power may flow into or out of small generating
20 facilities at different times, PacifiCorp requires interconnection customers to have bi-
21 directional metering. Bi-directional metering allows PacifiCorp to measure the amount of
22 power generated by the interconnecting QF for the purpose of determining the QF
23 generator’s payment while separately recording PacifiCorp’s deliveries of station service
24 power to the QF as a separate transaction. Bi-directional metering does not affect the

1 avoided cost rate paid to the QF. Rather, the bi-directional meter determines the amount of
2 generation PacifiCorp is obligated to compensate the generator for.

3 The GIA between Fery Farms and PacifiCorp clearly establishes the requirement for
4 bi-directional metering. Section 1.5 (Metering & Monitoring) of the GIA states that Mr. Fery
5 “will be responsible for metering and monitoring as required by OAR 860-082-0070¹ and as
6 may be detailed in any attachments to this Agreement.” In turn, Attachment 1 to the GIA
7 (Description of Interconnection Facilities and Metering Equipment Operated or Maintained
8 by the Public Utility), states that “[PacifiCorp’s] interconnection facilities on [Fery Farms’s]
9 side of the Point of Interconnection include the bi-directional metering package complete
10 with cell phone communications required for the Small Generator Facility.”

11 PacifiCorp compensates the Fery Farms QF for the facility’s output at the appropriate
12 avoided cost rates. Changes in the Company’s standard avoided cost rates, not the
13 installation of bi-directional meters, resulted in a decrease in the overall compensation due to
14 the Fery Farms QF. For this reason, Fery Farms’s allegations are misguided and are not a
15 basis for a claim of relief.

16 **b. Issues involving Oregon Schedule 37 are more appropriately addressed in**
17 **other proceedings.**

18 Fery Farms claims Oregon Schedule 37 relies on a rate structure that is flawed.
19 PacifiCorp responds that whether the rate structure used to determine avoided cost rates is
20 flawed is an issue more appropriately address in docket UM 1610. The issue of the

¹ OAR 860-082-0070(1) requires Pacific Power to:

[I]ninstall, maintain, test, repair, operate, and replace any metering and data acquisition equipment necessary under the terms of the public utility’s interconnection agreement, power purchase agreement, or power service agreement with an applicant or interconnection customer. The applicant or interconnection customer is responsible for all reasonable costs associated with the metering and data acquisition equipment.

1 appropriate methodology and rate structure for avoided cost rates is an issue that has been
2 addressed recently in UM 1610 and continues to be addressed in this same docket as part of
3 the Commission’s review of the Company’s recently filed updates to Oregon Schedule 37
4 avoided cost rates. PacifiCorp takes no position as to whether the avoided cost rate structure
5 is flawed but notes that Fery Farm’s allegation on this point does not present a basis for a
6 claim of relief and is more appropriately addressed in docket UM 1610.

7 **c. PacifiCorp has not inappropriately charged Fery Farms.**

8 Fery Farms alleges the Company is inappropriately charging the Fery Farms QF
9 multiple fees as a retail customer. The Company understands this allegation to refer to
10 charges associated with the Company’s provision of service under Oregon Schedule 23.
11 Oregon Schedule 23 is applicable to “Small Nonresidential Consumers whose entire electric
12 service requirements are supplied hereunder[.]”² PacifiCorp’s rules and regulations define a
13 “Small Nonresidential Consumer” as a “Nonresidential Consumer whose demand has not
14 exceeded 30 kW more than once within the preceding 13 months or with seven months or
15 less of service whose demand has not exceeded 30 kW.” Fery Farms does not dispute that
16 the Fery Farms QF qualifies as a Small Nonresidential Consumer.

17 The Company serves the Fery Farms QF under Oregon Schedule 23 in order to
18 provide the Fery Farms QF with station service, the delivery of electricity necessary to serve
19 the generator’s load during times when the generator cannot provide it. Fery Farms alleges
20 that the Fery Farms QF does not use electricity from the Company. However, as the
21 Company’s meter readings show, this is not the case. The Fery Farms QF does, in fact,
22 receive energy from the Company and therefore it is appropriate for the Company to charge

² See Pacific Power Oregon Schedule 23—General Service-Small Nonresidential Delivery Service.

1 Fery Farms the distribution charge, transmission and ancillary service charge, and system
2 usage charge set forth in Oregon Schedule 23.

3 The Complaint notes that PacifiCorp recently began charging Fery Farms as a retail
4 customer under Oregon Schedule 23. PacifiCorp recently became aware of an administrative
5 oversight in which certain QF generators were not being billed for station service. In order to
6 address this oversight, the Company is engaged in an effort to review its existing agreements
7 with QF generators and, if appropriate, begin billing them for station service. PacifiCorp
8 installed the bi-directional metering at the Fery Farms QF to facilitate prospective billing for
9 station service.³ And significantly, Exhibit A to the PPA with Fery Farms indicates that the
10 project requires a limited amount of station service—which is precisely what PacifiCorp has
11 been providing.

12 Although PacifiCorp has been purchasing the output of the Fery Farms QF for many
13 years without charging the Fery Farms QF for station service, once PacifiCorp discovered the
14 oversight, PacifiCorp contracted with Fery Farms QF to install bi-directional metering to
15 measure the retail service taken by the QF. Once the installation was complete, PacifiCorp
16 reminded Fery Farms of the station service requirement via a letter dated September 23,
17 2013, attached to this answer as Exhibit C.

18 PacifiCorp is appropriately charging the Fery Farms QF under Oregon Schedule 23
19 on a prospective basis only for the provision of station service. PacifiCorp has made no
20 attempt to retroactively collect charges associated with the provision of station service. Fery
21 Farms's allegation that it is not a retail customer is factually incorrect and therefore does not
22 state a basis for a claim of relief.

³ The GIA with Loyd Fery provides for bi-directional metering. *See* GIA Attachment 1.

1
2
3
4
5
6
7
8
9
10
11
12
13
14

III. MOTION TO DISMISS

The Company moves to dismiss the Complaint on the grounds that Fery Farms failed to state grounds for which the Commission may grant relief. The Complaint cites no statute, administrative rules, or other authority relating to the Company’s provision of service to the Mr. Fery for which the Company may be found in violation by the Commission, as required by ORS 765.500(1) and (3).

PacifiCorp has acted in accordance with the PPA and GIA signed and executed by the Fery Farms, as well as all applicable statutes and rules. Payments made to Fery Farms have been calculated using the then-effective avoided cost rates. The appropriate rate structure for avoided costs rates is more appropriately raised in docket UM 1610. Finally, Fery Farms receives electricity from the Company as a retail customer and it is therefore appropriate for the Company to charge Fery Farms under Oregon Schedule 23.

Fery Farms fails to state grounds for which request may be granted by the Commission, therefore the Complaint should be dismissed.

WHEREFORE having fully answered Complainant’s complaint,

Respectfully submitted this 10th day of June, 2014.



Dustin Till
Pacific Power
825 NE Multnomah, Suite 1800
Portland, OR 97232
Telephone: (503) 813-6589
E-Mail: dustin.till@pacificcorp.com

REDACTED EXHIBIT A
Power Purchase Agreement
Between PacifiCorp and Loyd Fery Farms, LLC

POWER PURCHASE AGREEMENT

BETWEEN

LOYD FERY

[an existing Qualifying Facility with 10,000 kW Facility Capacity Rating, or Less]

AND

PACIFICORP

Section 1: Definitions	2
Section 2: Term; EFFECTIVE Date.....	5
Section 3: Representations and Warranties	5
Section 4: Delivery of Power.....	9
Section 5: Purchase Prices.....	10
Section 6: Operation and Control	10
Section 7: Fuel/Motive Force	12
Section 8: Metering	12
Section 9: Billings, Computations, and Payments	12
Section 10: Security.....	13
Section 11: Defaults and Remedies	15
Section 12: Indemnification and Liability	18
Section 13: Insurance (<i>Facilities over 200kW only</i>)	19
Section 14: Force Majeure	20
Section 15: Several Obligations	21
Section 16: Choice of Law	21
Section 17: Partial Invalidity	21
Section 18: Waiver	21
Section 19: Governmental Jurisdictions and Authorizations	21
Section 20: Repeal of PURPA.....	22
Section 21: Successors and Assigns	22
Section 22: Entire Agreement.....	22
Section 23: Jury Trial Waiver.....	23
Section 24: Notices.....	23

POWER PURCHASE AGREEMENT

THIS POWER PURCHASE AGREEMENT ("Agreement"), entered into this 9th day of December, 2013, is between Loyd Fery, "Seller" and PacifiCorp (d/b/a Pacific Power & Light Company), an Oregon corporation acting in its regulated utility capacity, "PacifiCorp." (Seller and PacifiCorp are referred to individually as a "Party" or collectively as the "Parties").

RECITALS

- A. Seller owns, operates and maintains a hydroelectric facility for the generation of electric power, including interconnection facilities, located in Aumsville, Marion County, Oregon [City, County, State] with a Facility Capacity Rating of 65-kilowatts (kW) as further described in **Exhibit A** and **Exhibit B ("Facility")**; and
- B. The Parties desire to enter into this Agreement to replace in its entirety the power purchase agreement dated November 7, 2007 (the "PPA"), which terminates on December 31, 2013; and
- C. Seller intends to continue to deliver Net Output under this Agreement; and
- D. Seller intends to continue to operate the Facility as a Qualifying Facility, and is deemed to have established commercial operation under the previous PPA; and
- E. Seller estimates that the average annual Net Energy to be delivered by the Facility to PacifiCorp is [REDACTED] kilowatt-hours (kWh), which amount of energy PacifiCorp will include in its resource planning; and
- F. Seller shall sell and PacifiCorp shall purchase all Net Output from the Facility in accordance with the terms and conditions of this Agreement; and
- G. This Agreement is a "New QF Contract" under the PacifiCorp Inter-Jurisdictional Cost Allocation Revised Protocol.

AGREEMENT

NOW, THEREFORE, the Parties mutually agree as follows:

SECTION 1: DEFINITIONS

When used in this Agreement, the following terms shall have the following meanings:

1.1 “**As-Built Supplement**” shall be a supplement to **Exhibit A** and **Exhibit B**, provided by Seller following completion of construction on the Facility, describing the Facility as actually built.

1.2 “**Average Annual Generation**” shall have the meaning set forth in Section 4.2.

1.3 “**Billing Period**” means the time period between PacifiCorp's consecutive readings of its power purchase billing meter at the Facility in the normal course of PacifiCorp's business. Such periods typically range between twenty-seven (27) and thirty-four (34) days and may not coincide with calendar months.

1.4 “**Commission**” means the Oregon Public Utilities Commission.

1.5 “**Contract Price**” means the applicable price for capacity or energy, or both capacity and energy, stated in Sections 5.1 and 5.2.

1.6 “**Contract Year**” means a twelve (12) month period commencing at 00:00 hours Pacific Prevailing Time (“PPT”) on January 1 and ending on 24:00 hours PPT on December 31; *provided, however*, that the first Contract Year shall commence on the Effective Date and end on the next succeeding December 31, and the last Contract Year shall end on the Termination Date.

1.7 “**Credit Requirements**” means a long-term credit rating (corporate or long-term senior unsecured debt) of (1) “Baa3” or greater by Moody’s, or (2) “BBB-” or greater by S&P, or such other indicia of creditworthiness acceptable to PacifiCorp in its reasonable judgment.

1.8 “**Default Security**”, unless otherwise agreed to by the Parties in writing, means the amount of either a Letter of Credit or cash placed in an escrow account sufficient to replace twelve (12) average months of replacement power costs over the term of this Agreement, and shall be calculated by taking the average, over the term of this Agreement, of the positive difference between (a) the monthly forward power prices at Mid-Columbia (as determined by PacifiCorp in good faith using information from a commercially reasonable independent source), multiplied by 110%, minus (b) the average of the Fixed Avoided Cost Prices specified in Schedule 37, and multiplying such difference by (c) the Minimum Annual Delivery; provided, however, the amount of Default Security shall in no event be less than the amount equal to the payments PacifiCorp would make for three (3) average months based on Seller’s average monthly volume over the term of this Agreement and utilizing the average Fixed Avoided Cost Prices specified in Schedule 37. Such amount shall be fixed at the Effective Date of this Agreement.

1.9 “**Effective Date**” of this Agreement shall be January 1, 2014, which is the date upon which the PPA terminates.

1.10 “**Energy Delivery Schedule**” shall have the meaning set forth in Section 4.5.

1.11 “**Environmental Attributes**” shall have the meaning set forth in Section 5.5.

1.12 “**Excess Output**” shall mean any increment of Net Output delivered at a rate, on an hourly basis, exceeding the Facility Capacity Rating.

1.13 “**Facility**” shall have the meaning set forth in Recital A.

1.14 “**Facility Capacity Rating**” means the sum of the Nameplate Capacity Ratings for all generators comprising the Facility.

1.15 “**FERC**” means the Federal Energy Regulatory Commission, or its successor.

1.16 “**Generation Interconnection Agreement**” means the generation interconnection agreement to be entered into separately between Seller and PacifiCorp’s transmission or distribution department, as applicable, providing for the construction, operation, and maintenance of PacifiCorp’s interconnection facilities required to accommodate deliveries of Seller’s Net Output if the Facility is to be interconnected directly with PacifiCorp rather than another electric utility.

1.17 “**Letter of Credit**” means an irrevocable standby letter of credit, from an institution that has a long-term senior unsecured debt rating of “A” or greater from S&P or “A2” or greater from Moody’s, in a form reasonably acceptable to PacifiCorp, naming PacifiCorp as the party entitled to demand payment and present draw requests thereunder.

1.18 “**Licensed Professional Engineer**” means a person acceptable to PacifiCorp in its reasonable judgment who is licensed to practice engineering in the state of Oregon, who has no economic relationship, association, or nexus with the Seller, and who is not a representative of a consulting engineer, contractor, designer or other individual involved in the development of the Facility, or of a manufacturer or supplier of any equipment installed in the Facility. Such Licensed Professional Engineer shall be licensed in an appropriate engineering discipline for the required certification being made.

1.19 “**Material Adverse Change**” means the occurrence of any event of default under any material agreement to which Seller is a party and of any other development, financial or otherwise, which would have a material adverse effect on Seller, the Facility or Seller’s ability to operate, maintain or own the Facility as provided in this Agreement

1.20 “**Maximum Annual Delivery**” shall have the meaning set forth in Section 4.3.

1.21 “**Minimum Annual Delivery**” shall have the meaning set forth in Section 4.3.

1.22 “**Nameplate Capacity Rating**” means the full-load electrical quantities assigned by the designer to a generator and its prime mover or other piece of electrical equipment, such as transformers and circuit breakers, under standardized conditions, expressed in amperes, kilovolt-

amperes, kilowatts, volts, or other appropriate units. Usually indicated on a nameplate attached to the individual machine or device.

1.23 “**Net Energy**” means the energy component, in kWh, of Net Output.

1.24 “**Net Output**” means all energy and capacity produced by the Facility, less station use and less transformation and transmission losses and other adjustments (e.g., Seller’s load other than station use), if any. For purposes of calculating payment under this Agreement, Net Output of energy shall be the amount of energy flowing through the Point of Delivery.

1.25 “**Net Replacement Power Costs**” shall have the meaning set forth in Section 11.4.1.

1.26 “**Off-Peak Hours**” means all hours of the week that are not On-Peak Hours.

1.27 “**On-Peak Hours**” means the hours between 6 a.m. Pacific Prevailing Time (“**PPT**”) and 10 p.m. PPT, Mondays through Saturdays, excluding all hours occurring on holidays as provided in Schedule 37.

1.28 “**Point of Delivery**” means the high side of the Seller’s step-up transformer(s) located at the point of interconnection between the Facility and PacifiCorp’s distribution/transmission system, or as otherwise specified in the Generation Interconnection Agreement, or, if the Facility is not interconnected directly with PacifiCorp, the point at which another utility will deliver the Net Output to PacifiCorp as specified in **Exhibit B**.

1.29 “**Prime Rate**” means the publicly announced prime rate for commercial loans to large businesses with the highest credit rating in the United States in effect from time to time quoted by Citibank, N.A. If a Citibank, N.A. prime rate is not available, the applicable Prime Rate shall be the announced prime rate for commercial loans in effect from time to time quoted by a bank with \$10 billion or more in assets in New York City, New York, selected by the Party to whom interest based on the Prime Rate is being paid.

1.30 “**Prudent Electrical Practices**” means any of the practices, methods and acts engaged in or approved by a significant portion of the electrical utility industry or any of the practices, methods or acts, which, in the exercise of reasonable judgment in the light of the facts known at the time a decision is made, could have been expected to accomplish the desired result at the lowest reasonable cost consistent with reliability, safety and expedition. Prudent Electrical Practices is not intended to be limited to the optimum practice, method or act to the exclusion of all others, but rather to be a spectrum of possible practices, methods or acts.

1.31 “**QF**” means “**Qualifying Facility**,” as that term is defined in the FERC regulations (codified at 18 CFR Part 292) in effect on the Effective Date.

1.32 “**Replacement Price**” means the price at which PacifiCorp, acting in a commercially reasonable manner, purchases for delivery at the Point of Delivery a replacement for any Net Output that Seller is required to deliver under this Agreement plus (i) costs reasonably incurred by PacifiCorp in purchasing such replacement Net Output, and (ii) additional transmission charges, if any, reasonably incurred by PacifiCorp in causing replacement energy to

be delivered to the Point of Delivery. If PacifiCorp elects not to make such a purchase, the Replacement Price shall be the market price at the Mid-Columbia trading hub for such energy not delivered, plus any additional cost or expense incurred as a result of Seller's failure to deliver, as determined by PacifiCorp in a commercially reasonable manner (but not including any penalties, ratcheted demand or similar charges).

1.33 "**Required Facility Documents**" means all licenses, permits, authorizations, and agreements, including a Generation Interconnection Agreement or equivalent, necessary for operation, and maintenance of the Facility consistent with the terms of this Agreement and requested in writing by PacifiCorp, including without limitation those set forth in **Exhibit C**.

1.34 "**Schedule 37**" means the Schedule 37 of Pacific Power & Light Company's Commission-approved tariffs, providing pricing options for Qualifying Facilities of 10,000 kW or less, which is in effect on the Effective Date of this Agreement. A copy of that Schedule 37 is attached as **Exhibit F**.

1.35 "**Termination Date**" shall have the meaning set forth in Section 2.4.

SECTION 2: TERM; EFFECTIVE DATE

2.1 After execution by both Parties, this Agreement shall become effective on the Effective Date.

2.2 By the Effective Date, Seller shall provide PacifiCorp with (a) a copy of an executed Generation Interconnection Agreement, or wheeling agreement, as applicable, which shall be consistent with all material terms and requirements of this Agreement, (b) the Required Facility Documents, and (c) an executed copy of **Exhibit E** – Seller's Interconnection Request.

2.3 By the date thirty (30) days after the Effective Date, Seller shall provide Default Security required under Sections 10.1 or 10.2, as applicable.

2.4 Except as otherwise provided herein, this Agreement shall terminate on June 30, 2014 [enter Date that is no later than 20 years after the Effective Date] ("**Termination Date**").

SECTION 3: REPRESENTATIONS AND WARRANTIES

3.1 PacifiCorp represents, covenants, and warrants to Seller that:

3.1.1 PacifiCorp is duly organized and validly existing under the laws of the State of Oregon.

3.1.2 PacifiCorp has the requisite corporate power and authority to enter into this Agreement and to perform according to the terms of this Agreement.

3.1.3 PacifiCorp has taken all corporate actions required to be taken by it to authorize the execution, delivery and performance of this Agreement and the consummation of the transactions contemplated hereby.

- 3.1.4 The execution and delivery of this Agreement does not contravene any provision of, or constitute a default under, any indenture, mortgage, or other material agreement binding on PacifiCorp or any valid order of any court, or any regulatory agency or other body having authority to which PacifiCorp is subject.
 - 3.1.5 This Agreement is a valid and legally binding obligation of PacifiCorp, enforceable against PacifiCorp in accordance with its terms (except as the enforceability of this Agreement may be limited by bankruptcy, insolvency, bank moratorium or similar laws affecting creditors' rights generally and laws restricting the availability of equitable remedies and except as the enforceability of this Agreement may be subject to general principles of equity, whether or not such enforceability is considered in a proceeding at equity or in law).
- 3.2 Seller represents, covenants, and warrants to PacifiCorp that:
- 3.2.1 Seller is a sole proprietorship duly organized and validly existing under the laws of Oregon.
 - 3.2.2 Seller has the requisite power and authority to enter into this Agreement and to perform according to the terms hereof, including all required regulatory authority to make wholesale sales from the Facility.
 - 3.2.3 Seller has taken all actions required to authorize the execution, delivery and performance of this Agreement and the consummation of the transactions contemplated hereby.
 - 3.2.4 The execution and delivery of this Agreement does not contravene any provision of, or constitute a default under, any indenture, mortgage, or other material agreement binding on Seller or any valid order of any court, or any regulatory agency or other body having authority to which Seller is subject.
 - 3.2.5 This Agreement is a valid and legally binding obligation of Seller, enforceable against Seller in accordance with its terms (except as the enforceability of this Agreement may be limited by bankruptcy, insolvency, bank moratorium or similar laws affecting creditors' rights generally and laws restricting the availability of equitable remedies and except as the enforceability of this Agreement may be subject to general principles of equity, whether or not such enforceability is considered in a proceeding at equity or in law).
 - 3.2.6 The Facility is and shall for the term of this Agreement continue to be a QF, and Seller will operate the Facility in a manner consistent with its FERC QF certification. Seller has provided to PacifiCorp the appropriate QF certification (which may include a FERC self-certification) prior to PacifiCorp's execution of this Agreement. At any time during the term of

this Agreement, PacifiCorp may require Seller to provide PacifiCorp with evidence satisfactory to PacifiCorp in its reasonable discretion that the Facility continues to qualify as a QF under all applicable requirements and, if PacifiCorp is not satisfied that the Facility qualifies for such status, a written legal opinion from an attorney who is (a) in good standing in the state of Oregon, and (b) who has no economic relationship, association or nexus with the Seller or the Facility, stating that the Facility is a QF and providing sufficient proof (including copies of all documents and data as PacifiCorp may request) demonstrating that Seller has maintained and will continue to maintain the Facility as a QF.

3.2.7 Compliance with Partial Stipulation in Commission Proceeding No. UM-1129. Seller will not make any changes in its ownership, control, or management during the term of this Agreement that would cause it to not be in compliance with the definition of a Small Cogeneration Facility or Small Power Production Facility provided in PacifiCorp's Schedule 37 tariff approved by the Commission at the time this Agreement is executed. Seller will provide, upon request by PacifiCorp not more frequently than every 36 months, such documentation and information as reasonably may be required to establish Seller's continued compliance with such Definition. PacifiCorp agrees to take reasonable steps to maintain the confidentiality of any portion of the above-described documentation and information that the Seller identifies as confidential except PacifiCorp will provide all such confidential information the Public Utility Commission of Oregon upon the Commission's request.

3.2.8 Additional Seller Creditworthiness Warranties. Seller need not post security under Section 10 for PacifiCorp's benefit in the event of Seller default, provided that Seller warrants all of the following:

- (a) Neither the Seller nor any of its principal equity owners is or has within the past two (2) years been the debtor in any bankruptcy proceeding, is unable to pay its bills in the ordinary course of its business, or is the subject of any legal or regulatory action, the result of which could reasonably be expected to impair Seller's ability to own and operate the Facility in accordance with the terms of this Agreement.
- (b) Seller has not at any time defaulted in any of its payment obligations for electricity purchased from PacifiCorp.
- (c) Seller is not in default under any of its other agreements and is current on all of its financial obligations, including construction related financial obligations.
- (d) Seller owns, and will continue to own for the term of this Agreement, all right, title and interest in and to the Facility, free

and clear of all liens and encumbrances other than liens and encumbrances related to third-party financing of the Facility.

- (e) **[Applicable only to Seller's with a Facility having a Facility Capacity Rating greater than 3,000 kW]** Seller meets the Credit Requirements.

Seller hereby declares (Seller initial one only):

LF Seller affirms and adopts all warranties of this Section 3.2.8, and therefore is not required to post security under Section 10; or

_____ Seller does not affirm and adopt all warranties of this Section 3.2.8, and therefore Seller elects to post the security specified in Section 10.

3.3 Notice. If at any time during this Agreement, any Party obtains actual knowledge of any event or information which would have caused any of the representations and warranties in this Section 3 to have been materially untrue or misleading when made, such Party shall provide the other Party with written notice of the event or information, the representations and warranties affected, and the action, if any, which such Party intends to take to make the representations and warranties true and correct. The notice required pursuant to this Section shall be given as soon as practicable after the occurrence of each such event.

SECTION 4: DELIVERY OF POWER

4.1 Commencing on the Effective Date, Seller will sell and PacifiCorp will purchase all Net Output from the Facility delivered to the Point of Delivery.

4.2 Average Annual Generation. Seller estimates that the Facility will generate, on average, 342,433 kWh per Contract Year (“**Average Annual Generation**”). Seller may, upon at least six months prior written notice, modify the Average Annual Generation every other Contract Year.

4.3 Minimum and Maximum Delivery. Seller shall make available from the Facility a minimum of 300,000 kWh of Net Output during each Contract Year, provided that such minimum for the first Contract Year shall be reduced pro rata to reflect the Effective Date, and further provided that such minimum Net Output shall be reduced on a pro-rata basis for any periods during a Contract Year that the Facility was prevented from generating electricity for reasons of Force Majeure (“**Minimum Annual Delivery**”). Seller estimates, for informational purposes, that it will make available from the Facility a maximum of 400,000 kWh of Net Output during each Contract Year (“**Maximum Annual Delivery**”). Seller’s basis for determining the Minimum and Maximum Annual Delivery amounts is set forth in **Exhibit D-1**.

4.4 Deliveries in Deficit of Delivery Obligation. Seller’s failure to deliver the Minimum Annual Delivery in any Contract Year (prorated if necessary) shall be a default, and Seller shall be liable for damages in accordance with Section 11.

4.5 Energy Delivery Schedule. Seller has provided a monthly schedule of Net Energy expected to be delivered by the Facility (“**Energy Delivery Schedule**”), incorporated into **Exhibit D-1**.

SECTION 5: PURCHASE PRICES

5.1 Seller shall have the option to select one of four pricing options: Fixed Avoided Cost Prices (“Fixed Price”), Firm Market Indexed Avoided Cost Prices (“Firm Electric Market”), Gas Market Indexed Avoided Cost Prices (“Gas Market”), or Banded Gas Market Indexed Avoided Cost Prices (“Banded Gas Market”), as published in Schedule 37. Once an option is selected the option will remain in effect for the duration of the Facility’s contract. Seller has selected the following (Seller to initial one):

<u>LF</u>	Fixed Price
_____	Firm Electric Market
_____	Gas Market
_____	Banded Gas Market

A copy of Schedule 37, and a table summarizing the purchase prices under the pricing option selected by Seller, is attached as **Exhibit F**.

5.2 (Fixed Price Sellers Only). In the event Seller elects the Fixed Price payment method, PacifiCorp shall pay Seller the applicable On-Peak and Off-Peak rates specified in **Schedule 37** during the first fifteen (15) years after the Effective Date. Thereafter, PacifiCorp shall pay Seller market-based rates, using the following pricing option (Seller to initial one):

_____	Firm Electric Market
_____	Gas Market
_____	Banded Gas Market

5.3 If the Seller elects a gas market indexed price option, the index shall be the Opal Gas Market Index as provided in Schedule 37. In the event that Platt ceases to publish the Opal Gas Market Index, the Company shall replace the index with a similar gas index.

5.4 For all Excess Output, PacifiCorp shall pay a blended market index price for day-ahead non-firm energy at Mid-Columbia, California Oregon Border (COB), Four Corners and Palo Verde market indices as reported by Dow Jones, for the On-Peak and Off-Peak periods. PacifiCorp shall document its calculation of the blended rate, upon request, to Seller. Such payment will be accomplished by adjustments pursuant to Section 9.2.

5.5 Environmental Attributes. PacifiCorp waives any claim to Seller’s ownership of Environmental Attributes under this Agreement. Environmental Attributes include, but are not limited to, Green Tags, Green Certificates, Renewable Energy Credits (RECs) and Tradable Renewable Certificates (TRCs) (as those terms are commonly used in the regional electric utility industry) directly associated with the production of energy from the Seller’s Facility.

SECTION 6: OPERATION AND CONTROL

6.1 As-Built Supplement. Upon completion of any construction affecting the Facility, Seller shall provide PacifiCorp an As-built Supplement to specify the actual Facility as built.

The As-built Supplement must be reviewed and approved by PacifiCorp, which approval shall not unreasonably be withheld, conditioned or delayed.

6.2 Incremental Utility Upgrades. At start-up (and at any other time upon at least six month's prior written notice), Seller may increase Net Output, if such increase is due to normal variances in estimated versus actual performance, changed Facility operations, or improvements in Facility efficiency. Seller may not increase Net Output under this Agreement by installing additional generating units. In the case of substantial upgrades, PacifiCorp may require Seller to comply with Section 3.2.8(e) (in the event that the Facility upgrade causes the Facility Capacity Rating to exceed 3,000 kW) and increase its Minimum Annual Delivery obligation in Section 4.3 (if appropriate). PacifiCorp may also update Seller's security obligation (if applicable). So long as the Facility Capacity Rating after the upgrade is 10,000 kW or less, Seller will continue to receive the Contract Price for the Net Output, as set forth in Sections 5.1 and 5.2 of this Agreement. If Seller increases the Facility Capacity Rating above 10,000 kW, then (on a going forward basis) PacifiCorp shall pay Seller the Contract Price for the fraction of total Net Output equal to 10,000 kW divided by the Facility Capacity Rating of the upgraded Facility. For the remaining fraction of Net Output, PacifiCorp and Seller shall agree to a new negotiated rate. Seller shall be responsible for ensuring that any planned increase in the Facility Capacity Rating or the maximum instantaneous capacity of the Facility complies with Seller's Generation Interconnection Agreement and any other agreements with PacifiCorp.

6.3 Seller shall operate and maintain the Facility in a safe manner in accordance with the Generation Interconnection Agreement (if applicable), Prudent Electrical Practices and in accordance with the requirements of all applicable federal, state and local laws and the National Electric Safety Code as such laws and code may be amended from time to time. PacifiCorp shall have no obligation to purchase Net Output from the Facility to the extent the interconnection between the Facility and PacifiCorp's electric system is disconnected, suspended or interrupted, in whole or in part, pursuant to the Generation Interconnection Agreement, or to the extent generation curtailment is required as a result of Seller's non-compliance with the Generation Interconnection Agreement. PacifiCorp shall have the right to inspect the Facility to confirm that Seller is operating the Facility in accordance with the provisions of this Section 6.3 upon reasonable notice to Seller. Seller is solely responsible for the operation and maintenance of the Facility. PacifiCorp shall not, by reason of its decision to inspect or not to inspect the Facility, or by any action or inaction taken with respect to any such inspection, assume or be held responsible for any liability or occurrence arising from the operation and maintenance by Seller of the Facility.

6.4 Scheduled Outages. Seller may cease operation of the entire Facility or individual units, if applicable, for maintenance or other purposes. Seller shall exercise its best efforts to notify PacifiCorp of planned outages at least ninety (90) days prior, and shall reasonably accommodate PacifiCorp's request, if any, to reschedule such planned outage in order to accommodate PacifiCorp's need for Facility operation.

6.5 Unplanned Outages. In the event of an unscheduled outage or curtailment exceeding twenty-five (25) percent of the Facility Capacity Rating (other than curtailments due to lack of motive force), Seller immediately shall notify PacifiCorp of the necessity of such unscheduled outage or curtailment, the time when such has occurred or will occur and the anticipated duration. Seller shall take all reasonable measures and exercise its best efforts to

avoid unscheduled outage or curtailment, to limit the duration of such, and to perform unscheduled maintenance during Off-Peak hours.

SECTION 7: FUEL/MOTIVE FORCE

Prior to the Effective Date of this Agreement, Seller provided to PacifiCorp a fuel or motive force plan acceptable to PacifiCorp in its reasonable discretion and attached hereto as **Exhibit D-1**, together with a certification from a Licensed Professional Engineer to PacifiCorp attached hereto as **Exhibit D-2**, certifying that the implementation of the fuel or motive force plan can reasonably be expected to provide fuel or motive force to the Facility for the duration of this Agreement adequate to generate power and energy in quantities necessary to deliver the Minimum Annual Delivery set forth by Seller in Section 4.

SECTION 8: METERING

8.1 PacifiCorp shall design, furnish, install, own, inspect, test, maintain and replace all metering equipment required pursuant to the Generation Interconnection Agreement, if applicable.

8.2 Metering shall be performed at the location and in a manner consistent with this Agreement and as specified in the Generation Interconnection Agreement, or, if the Net Output is to be wheeled to PacifiCorp by another utility, metering will be performed in accordance with the terms of PacifiCorp's interconnection agreement with such other utility. All quantities of energy purchased hereunder shall be adjusted to account for electrical losses, if any between the point of metering and the Point of Delivery, so that the purchased amount reflects the net amount of energy flowing into PacifiCorp's system at the Point of Delivery.

8.3 PacifiCorp shall periodically inspect, test, repair and replace the metering equipment as provided in the Generation Interconnection Agreement, if applicable. If the Net Output is to be wheeled to PacifiCorp by another utility, meter inspection, testing, repair and replacement will be performed in accordance with the terms of PacifiCorp's interconnection agreement with such utility. If any of the inspections or tests discloses an error exceeding two percent (2%), either fast or slow, proper correction, based upon the inaccuracy found, shall be made of previous readings for the actual period during which the metering equipment rendered inaccurate measurements if that period can be ascertained. If the actual period cannot be ascertained, the proper correction shall be made to the measurements taken during the time the metering equipment was in service since last tested, but not exceeding three (3) Billing Periods, in the amount the metering equipment shall have been shown to be in error by such test. Any correction in billings or payments resulting from a correction in the meter records shall be made in the next monthly billing or payment rendered following the repair of the meter.

SECTION 9: BILLINGS, COMPUTATIONS, AND PAYMENTS

9.1 On or before the thirtieth (30th) day following the end of each Billing Period, PacifiCorp shall send to Seller payment for Seller's deliveries of Net Output to PacifiCorp, together with computations supporting such payment PacifiCorp may offset any such payment to reflect amounts owing from Seller to PacifiCorp pursuant to this Agreement, the Generation Interconnection Agreement, or any other agreement between the Parties.

9.2 Corrections. PacifiCorp shall have up to eighteen months to adjust any payment made pursuant to Section 9.1. In the event PacifiCorp determines it has overpaid Seller (for Excess Output or otherwise), PacifiCorp may adjust Seller's future payment accordingly in order to recapture any overpayment in a reasonable time.

9.3 Any amounts owing after the due date thereof shall bear interest at the Prime Rate plus two percent (2%) from the date due until paid; *provided, however*, that the interest rate shall at no time exceed the maximum rate allowed by applicable law.

SECTION 10: SECURITY

Unless Seller has adopted the creditworthiness warranties contained in Section 3.2.8, Seller must provide security (if requested by PacifiCorp) in the form of a cash escrow, letter of credit, senior lien, or step-in rights. Seller hereby elects to provide, in accordance with the applicable terms of this Section 10, the following security (Seller to initial one selection only):

_____ Cash Escrow

_____ Letter of Credit

_____ Senior Lien

_____ Step-in Rights

LF Seller has adopted the Creditworthiness Warranties of Section 3.2.8.

In the event Seller's obligation to post default security (under Section 10 or Section 11.1.4) arises solely from Seller's delinquent performance of construction-related financial obligations, upon Seller's request, PacifiCorp will excuse Seller from such obligation in the event Seller has negotiated financial arrangements with its construction lenders that mitigate Seller's financial risks to PacifiCorp's reasonable satisfaction.

[SKIP THIS SECTION 10.1 UNLESS SELLER SELECTED CASH ESCROW ALTERNATIVE]

10.1 Cash Escrow Security. Seller shall deposit in an escrow account established by PacifiCorp in a banking institution acceptable to both Parties, the Default Security. Such sum shall earn interest at the rate applicable to money market deposits at such banking institution from time to time. To the extent PacifiCorp receives payment from the Default Security, Seller shall, within fifteen (15) days, restore the Default Security as if no such deduction had occurred.

[SKIP THIS SECTION 10.2 UNLESS SELLER SELECTED LETTER OF CREDIT ALTERNATIVE]

10.2 Letter of Credit Security. Seller shall post and maintain in an amount equal to the Default Security: (a) a guaranty from a party that satisfies the Credit Requirements, in a form acceptable to PacifiCorp in its discretion, or (b) a Letter of Credit in favor of PacifiCorp. To the extent PacifiCorp receives payment from the Default Security, Seller shall, within fifteen (15) days, restore the Default Security as if no such deduction had occurred.

[SKIP THIS SECTION 10.3 UNLESS SELLER SELECTED SENIOR LIEN ALTERNATIVE]

10.3 Senior Lien. Within thirty (30) days after the Effective Date, Seller shall grant PacifiCorp a senior, unsubordinated lien on the Facility and its assets as security for performance of this Agreement by executing, acknowledging and delivering a security agreement and a deed of trust or a mortgage, in a recordable form (each in a form satisfactory to PacifiCorp in the reasonable exercise of its discretion). Pending delivery of the senior lien to PacifiCorp, Seller shall not cause or permit the Facility or its assets to be burdened by liens or other encumbrances that would be superior to PacifiCorp's, other than workers', mechanics', suppliers' or similar liens, or tax liens, in each case arising in the ordinary course of business that are either not yet due and payable or that have been released by means of a performance bond posted within eight (8) calendar days of the commencement of any proceeding to foreclose the lien.

[SKIP THIS SECTION 10.4 UNLESS SELLER SELECTED STEP-IN RIGHTS ALTERNATIVE]

10.4 Step-in Rights (Operation by PacifiCorp Following Event of Default of Seller).

- 10.4.1 Prior to any termination of this Agreement due to an Event of Default of Seller, as identified in Section 11, PacifiCorp shall have the right, but not the obligation, to possess, assume control of, and operate the Facility as agent for Seller (in accordance with Seller's rights, obligations, and interest under this Agreement) during the period provided for herein. Seller shall not grant any person, other than the lending institution providing financing to the Seller for construction of the Facility ("Facility Lender"), a right to possess, assume control of, and operate the Facility that is equal to or superior to PacifiCorp's right under this Section 10.4.
- 10.4.2 PacifiCorp shall give Seller ten (10) calendar days notice in advance of the contemplated exercise of PacifiCorp's rights under this Section 10.4. Upon such notice, Seller shall collect and have available at a convenient, central location at the Facility all documents, contracts, books, manuals, reports, and records required to construct, operate, and maintain the Facility in accordance with Prudent Electrical Practices. Upon such notice, PacifiCorp, its employees, contractors, or designated third parties shall have the unrestricted right to enter the Facility for the purpose of constructing and/or operating the Facility. Seller hereby irrevocably appoints PacifiCorp as Seller's attorney-in-fact for the exclusive purpose of executing such documents and taking such other actions as PacifiCorp may reasonably deem necessary or appropriate to exercise PacifiCorp's step-in rights under this Section 10.4.
- 10.4.3 During any period that PacifiCorp is in possession of and constructing and/or operating the Facility, no proceeds or other monies attributed to operation of the Facility shall be remitted to or otherwise provided to the account of Seller until all Events of Default of Seller have been cured.

10.4.4 During any period that PacifiCorp is in possession of and operating the Facility, Seller shall retain legal title to and ownership of the Facility and PacifiCorp shall assume possession, operation, and control solely as agent for Seller.

(a) In the event PacifiCorp is in possession and control of the Facility for an interim period, Seller shall resume operation and PacifiCorp shall relinquish its right to operate when Seller demonstrates to PacifiCorp's reasonable satisfaction that it will remove those grounds that originally gave rise to PacifiCorp's right to operate the Facility, as provided above, in that Seller (i) will resume operation of the Facility in accordance with the provisions of this Agreement, and (ii) has cured any Events of Default of Seller which allowed PacifiCorp to exercise its rights under this Section 10.4.

(b) In the event that PacifiCorp is in possession and control of the Facility for an interim period, the Facility Lender, or any nominee or transferee thereof, may foreclose and take possession of and operate the Facility and PacifiCorp shall relinquish its right to operate when the Facility Lender or any nominee or transferee thereof, requests such relinquishment.

10.4.5 PacifiCorp's exercise of its rights hereunder to possess and operate the Facility shall not be deemed an assumption by PacifiCorp of any liability attributable to Seller. If at any time after exercising its rights to take possession of and operate the Facility PacifiCorp elects to return such possession and operation to Seller, PacifiCorp shall provide Seller with at least fifteen (15) calendar days advance notice of the date PacifiCorp intends to return such possession and operation, and upon receipt of such notice Seller shall take all measures necessary to resume possession and operation of the Facility on such date.

SECTION 11: DEFAULTS AND REMEDIES

11.1 Events of Default. The following events shall constitute defaults under this Agreement:

11.1.1 Breach of Material Term. Failure of a Party to perform any material obligation imposed upon that Party by this Agreement (including but not limited to failure by Seller to meet any deadline set forth in Section 2) or breach by a Party of a representation or warranty set forth in this Agreement.

11.1.2 Default on Other Agreements. Seller's failure to cure any default under any commercial or financing agreements or instrument (including the Generation Interconnection Agreement) within the time allowed for a cure under such agreement or instrument.

11.1.3 Insolvency. A Party (a) makes an assignment for the benefit of its creditors; (b) files a petition or otherwise commences, authorizes or acquiesces in the commencement of a proceeding or cause of action under any bankruptcy or similar law for the protection of creditors, or has such a petition filed against it and such petition is not withdrawn or dismissed within sixty (60) days after such filing; (c) becomes insolvent; or (d) is unable to pay its debts when due.

11.1.4 Material Adverse Change. A Material Adverse Change has occurred with respect to Seller and Seller fails to provide such performance assurances as are reasonably requested by PacifiCorp, including without limitation the posting of additional Default Security, within thirty (30) days from the date of such request;

11.1.5 Underdelivery. If Seller's Facility has a Facility Capacity Rating of 100 kW or less, Seller's failure to satisfy the minimum delivery obligation of Section 4.3 for two (2) consecutive years; else Seller's failure to satisfy the minimum delivery obligation of Section 4.3 for one year.

11.2 Notice; Opportunity to Cure.

11.2.1 Notice. In the event of any default hereunder, the non-defaulting Party must notify the defaulting Party in writing of the circumstances indicating the default and outlining the requirements to cure the default.

11.2.2 Opportunity to Cure. A Party defaulting under Section 11.1.1 shall have thirty (30) days to cure after receipt of proper notice from the non-defaulting Party. This thirty (30) day period shall be extended by an additional ninety (90) days if (a) the failure cannot reasonably be cured within the thirty (30) day period despite diligent efforts, (b) the default is capable of being cured within the additional ninety (90) day period, and (c) the defaulting Party commences the cure within the original thirty (30) day period and is at all times thereafter diligently and continuously proceeding to cure the failure.

11.2.3 Seller Default Under Other Agreements. Seller shall cause any notices of default under any of its commercial or financing agreements or instruments to be sent by the other party to such agreements or instruments, or immediately forwarded, to PacifiCorp as a notice in accordance with Section 24.

11.2.4 Seller Delinquent on Construction-related Financial Obligations. Seller promptly shall notify PacifiCorp (or cause PacifiCorp to be notified) anytime it becomes delinquent under any construction related financing agreement or instrument related to the Facility. Such delinquency may constitute a Material Adverse Change, subject to Section 11.1.4.

11.3 Termination.

11.3.1 Notice of Termination. If a default described herein has not been cured within the prescribed time, above, the non-defaulting Party may terminate this Agreement at its sole discretion by delivering written notice to the other Party and may pursue any and all legal or equitable remedies provided by law or pursuant to this Agreement; *provided, however* that PacifiCorp shall not terminate for a default under Section 11.1.5 unless such default is material. The rights provided in Section 10 and this Section 11 are cumulative such that the exercise of one or more rights shall not constitute a waiver of any other rights. Further, the Parties may by mutual written agreement amend this Agreement in lieu of a Party's exercise of its right to terminate.

11.3.2 In the event this Agreement is terminated because of Seller's default and Seller wishes to again sell Net Output to PacifiCorp following such termination, PacifiCorp in its sole discretion may require that Seller shall do so subject to the terms of this Agreement, including but not limited to the Contract Price, until the Termination Date (as set forth in Section 2.4). At such time Seller and PacifiCorp agree to execute a written document ratifying the terms of this Agreement.

11.3.3 Damages. If this Agreement is terminated as a result of Seller's default, Seller shall pay PacifiCorp the positive difference, if any, obtained by subtracting the Contract Price from the sum of the Replacement Price for the Minimum Annual Delivery that Seller was otherwise obligated to provide for a period of twenty-four (24) months from the date of termination plus any cost incurred for transmission purchased to deliver the replacement power to the Point of Delivery, and the estimated administrative cost to the utility to acquire replacement power. Amounts owed by Seller pursuant to this paragraph shall be due within five (5) business days after any invoice from PacifiCorp for the same.

11.3.4 If this Agreement is terminated because of Seller's default, PacifiCorp may foreclose upon any security provided pursuant to Section 10 to satisfy any amounts that Seller owes PacifiCorp arising from such default.

11.4 Damages.

11.4.1 Failure to Deliver Net Output. In the event of Seller default under Subsection 11.1.5, then Seller shall pay PacifiCorp the positive difference, if any, obtained by subtracting the Contract Price from the Replacement Price for any energy and capacity that Seller was otherwise obligated (under Section 4.3) to provide during the period of default ("**Net Replacement Power Costs**"); *provided, however*, that the positive difference obtained by subtracting the Contract Price from the Replacement Price shall not exceed the Contract Price, and the period of default under this Section 11.4.1 shall not exceed one Contract Year.

11.4.2 Recoupment of Damages.

- (a) Default Security Available. If Seller has posted Default Security, PacifiCorp may draw upon that security to satisfy any damages, above.
- (b) Default Security Unavailable. If Seller has not posted Default Security, or if PacifiCorp has exhausted the Default Security, PacifiCorp may collect any remaining amount owing by partially withholding future payments to Seller over a reasonable period of time, which period shall not be less than the period over which the default occurred. PacifiCorp and Seller shall work together in good faith to establish the period, and monthly amounts, of such withholding so as to avoid Seller's default on its commercial or financing agreements necessary for its continued operation of the Facility.

SECTION 12: INDEMNIFICATION AND LIABILITY

12.1 Indemnities.

- 12.1.1 Indemnity by Seller. Seller shall release, indemnify and hold harmless PacifiCorp, its directors, officers, agents, and representatives against and from any and all loss, fines, penalties, claims, actions or suits, including costs and attorney's fees, both at trial and on appeal, resulting from, or arising out of or in any way connected with (a) the energy delivered by Seller under this Agreement to and at the Point of Delivery, (b) any facilities on Seller's side of the Point of Delivery, (c) Seller's operation and/or maintenance of the Facility, or (d) arising from this Agreement, including without limitation any loss, claim, action or suit, for or on account of injury, bodily or otherwise, to, or death of, persons, or for damage to, or destruction or economic loss of property belonging to PacifiCorp, Seller or others, excepting only such loss, claim, action or suit as may be caused solely by the fault or gross negligence of PacifiCorp, its directors, officers, employees, agents or representatives.
- 12.1.2 Indemnity by PacifiCorp. PacifiCorp shall release, indemnify and hold harmless Seller, its directors, officers, agents, Lenders and representatives against and from any and all loss, fines, penalties, claims, actions or suits, including costs and attorney's fees, both at trial and on appeal, resulting from, or arising out of or in any way connected with the energy delivered by Seller under this Agreement after the Point of Delivery, including without limitation any loss, claim, action or suit, for or on account of injury, bodily or otherwise, to, or death of, persons, or for damage to, or destruction or economic loss of property, excepting only such loss, claim, action or suit as may be caused solely by the fault or gross negligence of Seller, its directors, officers, employees, agents, Lenders or representatives.

12.2 No Dedication. Nothing in this Agreement shall be construed to create any duty to, any standard of care with reference to, or any liability to any person not a Party to this Agreement. No undertaking by one Party to the other under any provision of this Agreement shall constitute the dedication of that Party's system or any portion thereof to the other Party or to the public, nor affect the status of PacifiCorp as an independent public utility corporation or Seller as an independent individual or entity.

12.3 No Consequential Damages. EXCEPT TO THE EXTENT SUCH DAMAGES ARE INCLUDED IN THE LIQUIDATED DAMAGES, DELAY DAMAGES, COST TO COVER DAMAGES OR OTHER SPECIFIED MEASURE OF DAMAGES EXPRESSLY PROVIDED FOR IN THIS AGREEMENT, NEITHER PARTY SHALL BE LIABLE TO THE OTHER PARTY FOR SPECIAL, PUNITIVE, INDIRECT, EXEMPLARY OR CONSEQUENTIAL DAMAGES, WHETHER SUCH DAMAGES ARE ALLOWED OR PROVIDED BY CONTRACT, TORT (INCLUDING NEGLIGENCE), STRICT LIABILITY, STATUTE OR OTHERWISE.

SECTION 13: INSURANCE (FACILITIES OVER 200KW ONLY)

13.1 Certificates. No later than the Effective Date of this Agreement, Seller shall secure and continuously carry insurance in compliance with the requirements of this Section. Seller shall provide PacifiCorp insurance certificate(s) (of "ACORD Form" or the equivalent) certifying Seller's compliance with the insurance requirements hereunder. Commercial General Liability coverage written on a "claims-made" basis, if any, shall be specifically identified on the certificate. If requested by PacifiCorp, a copy of each insurance policy, certified as a true copy by an authorized representative of the issuing insurance company, shall be furnished to PacifiCorp.

13.2 Required Policies and Coverages. Without limiting any liabilities or any other obligations of Seller under this Agreement, Seller shall secure and continuously carry with an insurance company or companies rated not lower than "B+" by the A.M. Best Company the insurance coverage specified below:

13.2.1 Commercial General Liability insurance, to include contractual liability, with a minimum single limit of \$1,000,000 to protect against and from all loss by reason of injury to persons or damage to property based upon and arising out of the activity under this Agreement.

13.2.2 All Risk Property insurance providing coverage in an amount at least equal to the full replacement value of the Facility against "all risks" of physical loss or damage, including coverage for earth movement, flood, and boiler and machinery. The Risk policy may contain separate sub-limits and deductibles subject to insurance company underwriting guidelines. The Risk Policy will be maintained in accordance with terms available in the insurance market for similar facilities.

13.3 The Commercial General Liability policy required herein shall include i) provisions or endorsements naming PacifiCorp, its Board of Directors, Officers and employees as additional insureds, and ii) cross liability coverage so that the insurance applies separately to each

insured against whom claim is made or suit is brought, even in instances where one insured claims against or sues another insured.

13.4 All liability policies required by this Agreement shall include provisions that such insurance is primary insurance with respect to the interests of PacifiCorp and that any other insurance maintained by PacifiCorp is excess and not contributory insurance with the insurance required hereunder, and provisions that such policies shall not be canceled or their limits of liability reduced without 1) ten (10) days prior written notice to PacifiCorp if canceled for nonpayment of premium, or 2) thirty (30) days prior written notice to PacifiCorp if canceled for any other reason.

13.5 Insurance coverage provided on a "claims-made" basis shall be maintained by Seller for a minimum period of five (5) years after the completion of this Agreement and for such other length of time necessary to cover liabilities arising out of the activities under this Agreement.

SECTION 14: FORCE MAJEURE

14.1 As used in this Agreement, “**Force Majeure**” or “**an event of Force Majeure**” means any cause beyond the reasonable control of the Seller or of PacifiCorp which, despite the exercise of due diligence, such Party is unable to prevent or overcome. By way of example, Force Majeure may include but is not limited to acts of God, fire, flood, storms, wars, hostilities, civil strife, strikes, and other labor disturbances, earthquakes, fires, lightning, epidemics, sabotage, restraint by court order or other delay or failure in the performance as a result of any action or inaction on behalf of a public authority which by the exercise of reasonable foresight such Party could not reasonably have been expected to avoid and by the exercise of due diligence, it shall be unable to overcome, subject, in each case, to the requirements of the first sentence of this paragraph. Force Majeure, however, specifically excludes the cost or availability of fuel or motive force resources to operate the Facility or changes in market conditions that affect the price of energy or transmission. If either Party is rendered wholly or in part unable to perform its obligation under this Agreement because of an event of Force Majeure, that Party shall be excused from whatever performance is affected by the event of Force Majeure to the extent and for the duration of the event of Force Majeure, after which such Party shall recommence performance of such obligation, provided that:

14.1.1 the non-performing Party, shall, within two (2) weeks after the occurrence of the Force Majeure, give the other Party written notice describing the particulars of the occurrence; and

14.1.2 the suspension of performance shall be of no greater scope and of no longer duration than is required by the event of Force Majeure; and

14.1.3 the non-performing Party uses its best efforts to remedy its inability to perform.

14.2 No obligations of either Party which arose before the Force Majeure causing the suspension of performance shall be excused as a result of the event of Force Majeure.

14.3 Neither Party shall be required to settle any strike, walkout, lockout or other labor dispute on terms which, in the sole judgment of the Party involved in the dispute, are contrary to the Party's best interests.

14.4 PacifiCorp may terminate the Agreement if Seller fails to remedy Seller's inability to perform, due to an event of Force Majeure, within six months after the occurrence of the event.

SECTION 15: SEVERAL OBLIGATIONS

Nothing contained in this Agreement shall ever be construed to create an association, trust, partnership or joint venture or to impose a trust or partnership duty, obligation or liability between the Parties. If Seller includes two or more parties, each such party shall be jointly and severally liable for Seller's obligations under this Agreement.

SECTION 16: CHOICE OF LAW

This Agreement shall be interpreted and enforced in accordance with the laws of the State of Oregon, excluding any choice of law rules which may direct the application of the laws of another jurisdiction.

SECTION 17: PARTIAL INVALIDITY

It is not the intention of the Parties to violate any laws governing the subject matter of this Agreement. If any of the terms of the Agreement are finally held or determined to be invalid, illegal or void as being contrary to any applicable law or public policy, all other terms of the Agreement shall remain in effect. If any terms are finally held or determined to be invalid, illegal or void, the Parties shall enter into negotiations concerning the terms affected by such decision for the purpose of achieving conformity with requirements of any applicable law and the intent of the Parties to this Agreement.

SECTION 18: WAIVER

Any waiver at any time by either Party of its rights with respect to a default under this Agreement or with respect to any other matters arising in connection with this Agreement must be in writing, and such waiver shall not be deemed a waiver with respect to any subsequent default or other matter.

SECTION 19: GOVERNMENTAL JURISDICTIONS AND AUTHORIZATIONS

This Agreement is subject to the jurisdiction of those governmental agencies having control over either Party or this Agreement. Seller shall at all times maintain in effect all local, state and federal licenses, permits and other approvals as then may be required by law for the construction, operation and maintenance of the Facility, and shall provide upon request copies of the same to PacifiCorp.

SECTION 20: REPEAL OF PURPA

This Agreement shall not terminate upon the repeal of the PURPA, unless such termination is mandated by federal or state law.

SECTION 21: SUCCESSORS AND ASSIGNS

This Agreement and all of the terms hereof shall be binding upon and inure to the benefit of the respective successors and assigns of the Parties. No assignment hereof by either Party shall become effective without the written consent of the other Party being first obtained and such consent shall not be unreasonably withheld, conditioned or delayed. Notwithstanding the foregoing, either Party may assign this Agreement without the other Party's consent to a lender as part of a financing transaction or as part of (a) a sale of all or substantially all of the assigning Party's assets, or (b) a merger, consolidation or other reorganization of the assigning Party.

SECTION 22: ENTIRE AGREEMENT

22.1 Upon the Effective Date, this Agreement supersedes all prior agreements, proposals, representations, negotiations, discussions or letters, whether oral or in writing, regarding PacifiCorp's purchase of Net Output from the Facility. No modification of this Agreement shall be effective unless it is in writing and signed by both Parties.

22.2 By executing this Agreement, Seller releases PacifiCorp from any claims, known or unknown, that may have arisen prior to the Effective Date.

SECTION 23: JURY TRIAL WAIVER

TO THE FULLEST EXTENT PERMITTED BY LAW, EACH OF THE PARTIES HERETO WAIVES ANY RIGHT IT MAY HAVE TO A TRIAL BY JURY IN RESPECT OF LITIGATION DIRECTLY OR INDIRECTLY ARISING OUT OF, UNDER OR IN CONNECTION WITH THIS AGREEMENT. EACH PARTY FURTHER WAIVES ANY RIGHT TO CONSOLIDATE ANY ACTION IN WHICH A JURY TRIAL HAS BEEN WAIVED WITH ANY OTHER ACTION IN WHICH A JURY TRIAL CANNOT BE OR HAS NOT BEEN WAIVED

SECTION 24: NOTICES

24.1 All notices except as otherwise provided in this Agreement shall be in writing, shall be directed as follows and shall be considered delivered if delivered in person or when deposited in the U.S. Mail, postage prepaid by certified or registered mail and return receipt requested.

Notices	PacifiCorp	Seller
All Notices	PacifiCorp 825 NE Multnomah Street Portland, OR 97232 Attn: Contract Administration, Suite 600 Phone: (503) 813 - 5954 Facsimile: (503) 813 - 6291 Duns: 00-790-9013 Federal Tax ID Number: 93-0246090	Loyd Fery 11022 Rainwater Lane S.E. Aumsville, OR 97325 Phone: (503) 769-6110 Cellphone: (503) 559-4874 Eric Fery Cell: (503) 949-6124 Facsimile: (503) 769-4092
All Invoices:	(same as street address above) Attn: Back Office, Suite 700 Phone: (503) 813 - 5578 Facsimile: (503) 813 - 5580	(same as above)
Scheduling:	(same as street address above) Attn: Resource Planning, Suite 600 Phone: (503) 813 - 6090 Facsimile: (503) 813 - 6265	(same as above)
Payments:	(same as street address above) Attn: Back Office, Suite 700 Phone: (503) 813 - 5578 Facsimile: (503) 813 - 5580	(same as above)
Wire Transfer:	Bank One N.A. ABA: ACCT: NAME: PacifiCorp Wholesale	(same as above)
Credit and Collections:	(same as street address above) Attn: Credit Manager, Suite 1900 Phone: (503) 813 - 5684 Facsimile: (503) 813 - 5609	(same as above)
With Additional Notices of an Event of Default or Potential Event of Default to:	(same as street address above) Attn: PacifiCorp General Counsel Phone: (503) 813-5029 Facsimile: (503) 813-7252	(same as above)

24.2 The Parties may change the person to whom such notices are addressed, or their addresses, by providing written notices thereof in accordance with this Section 24.

IN WITNESS WHEREOF, the Parties hereto have caused this Agreement to be executed in their respective names as of the date first above written.

PacifiCorp

By: _____

Name: Bruce Griswold

Title: Director Short Term Origination
and QF Contracts

Seller

By: _____

Name: Lloyd Feryn

Title: Owner

EXHIBIT A
DESCRIPTION OF SELLER'S FACILITY
[Seller to Complete]




EXHIBIT B

SELLER'S INTERCONNECTION FACILITIES

[Seller to provide its own diagram and description]

POINT OF DELIVERY / SELLER'S INTERCONNECTION FACILITIES

Instructions to Seller:

1. Include description of point of metering, and Point of Delivery
2. Provide interconnection single line drawing of Facility including any transmission facilities on Seller's side of the Point of Delivery.

1. Point of Delivery is at the PacifiCorp meter located at 11028 Stayton Rd. Southeast in Aumsville, Oregon
2. A single line diagram of the Facility is attached.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment 2

One-line Diagram Depicting the Generating Facility, Interconnection Facilities, Metering Equipment, and Upgrades

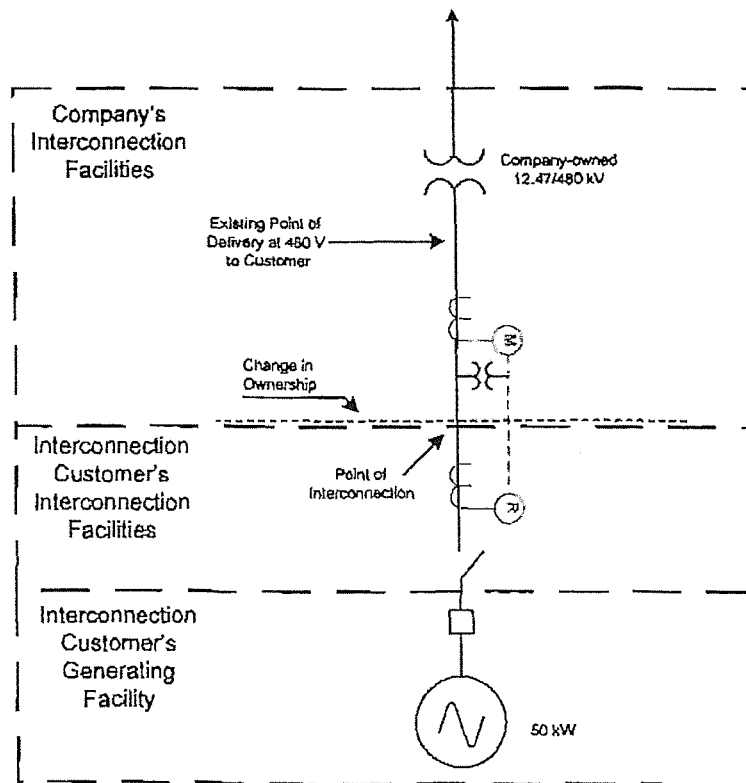


EXHIBIT C
REQUIRED FACILITY DOCUMENTS

Interconnection Agreement, Wheeling Agreement [if applicable], and [others to be identified]


QF Certification: Not required for projects less than 1,000 KW

Executed Interconnection Agreement: Provided October 29, 2013

Water Rights: HE 260 Issued February 20, 2001

FERC License or Exemption: Not required project is pre-FERC and grandfathered

EXHIBIT D-1



**EXHIBIT D-2
ENGINEER'S CERTIFICATION
OF
MOTIVE FORCE PLAN**

Seller provide a written declaration from a Licensed Professional Engineer to PacifiCorp that the Facility is likely capable under average conditions foreseeable during the term of this Agreement of meeting Seller's estimated average, maximum, and minimum Net Output.

The Motive Force Plan comprising **Exhibit D-1** was provided to PacifiCorp by Seller. Based upon Seller's demonstrated delivery of Net Output to PacifiCorp under Previous PPAs and representations made by Seller PacifiCorp will not require an engineer's certificate at this time. PacifiCorp reserves the right in its discretion to require the Seller to provide the following from a Licensed Professional Engineer:

1. A certificate addressed to PacifiCorp from a Licensed Professional Engineer stating (a) the Facility Capacity Rating of the Facility at the date of the request from PacifiCorp; and (b) that the Facility is able to generate electric power reliably in amounts required by this Agreement and in accordance with all other terms and conditions of this Agreement.
2. A certificate addressed to PacifiCorp from a Licensed Professional Engineer stating that, (a), in accordance with the Generation Interconnection Agreement, all required interconnection facilities have been constructed, all required interconnection tests have been completed and the Facility is physically interconnected with PacifiCorp's electric system, or (b) if the Facility is interconnected with another electric utility that will wheel Net Output to PacifiCorp, all required interconnection facilities have been completed and tested and are in place to allow for such wheeling.
3. A certificate addressed to PacifiCorp stating that Seller has obtained all Required Facility Documents and if requested by PacifiCorp, in writing, has provided copies of any or all such requested Required Facility Documents.

Such documents shall be provided to PacifiCorp within 30 days of a request by PacifiCorp.

EXHIBIT E
Seller Authorization to Release Generation Data to PacifiCorp

See Attached Letter


Seller Authorization to Release Generation Data to PacifiCorp
[Interconnection Customer Letterhead]


Transmission Services
Attn: Director, Transmission Services
825 NE Multnomah, Suite 1600
Portland, OR 97232

RE: Loyd Fery Interconnection Request

Dear Sir:

Loyd Fery hereby voluntarily authorizes PacifiCorp's Transmission business unit to share Loyd Fery's generator interconnection information and generator meter data with Marketing Affiliate employees of PacifiCorp Energy, including, but not limited to those in the Commercial and Trading group. Loyd Fery acknowledges that PacifiCorp did not provide it any preferences, either operational or rate-related, in exchange for this voluntary consent.

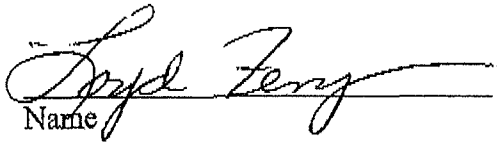
Name


Title


Date

EXHIBIT F
SCHEDULE 37 and PRICING SUMMARY TABLE

Calendar Year	On-Peak Contract Price in £/kWh	Off-Peak Contract Price in £/kWh
2014	4.13	2.80

**AVOIDED COST PURCHASES FROM
QUALIFYING FACILITIES OF 10,000 KW OR LESS**

Available

To owners of Qualifying Facilities making sales of electricity to the Company in the State of Oregon.

Applicable

For power purchased from Qualifying Facilities with a nameplate capacity of 10,000 kW or less or that, together with any other electric generating facility using the same motive force, owned or controlled by the same person(s) or affiliated person(s), and located at the same site, has a nameplate capacity of 10,000 kW or less. Owners of these Qualifying Facilities will be required to enter into a written power sales contract with the Company.

Definitions

Cogeneration Facility

A facility which produces electric energy together with steam or other form of useful energy (such as heat) which are used for industrial, commercial, heating or cooling purposes through the sequential use of energy.

Qualifying Facilities

Qualifying cogeneration facilities or qualifying small power production facilities within the meaning of section 201 and 210 of the Public Utility Regulatory Policies Act of 1978 (PURPA), 16 U.S.C. 796 and 824a-3.

Small Power Production Facility

A facility which produces electric energy using as a primary energy source biomass, waste, renewable resources or any combination thereof and has a power production capacity which, together with other facilities located at the same site, is not greater than 80 megawatts.

On-Peak Hours or Peak Hours

On-peak hours are defined as 6:00 a.m. to 10:00 p.m. Pacific Prevailing Time Monday through Saturday, excluding NERC holidays.

Due to the expansions of Daylight Saving Time (DST) as adopted under Section 110 of the U.S. Energy Policy Act of 2005, the time periods shown above will begin and end one hour later for the period between the second Sunday in March and the first Sunday in April and for the period between the last Sunday in October and the first Sunday in November.

Off-Peak Hours

All hours other than On-Peak.

West Side Gas Market Index

The monthly indexed gas price shall be the average of the price indexes published by Platts in "Inside FERC's Gas Market Report" monthly price report for Northwest Pipeline Corp. Rock Mountains, Northwest Pipeline Corp. Canadian Border, and Rockies/Northwest Stanfield, OR.

Excess Output

Excess output shall mean any increment of Net Output delivered at a rate, on an hourly basis, exceeding the Facility Nameplate Capacity. PacifiCorp shall pay Seller the Off-peak Price as described and calculated under pricing option 5 for all Excess Output.

(continued)

Same Site

Generating facilities are considered to be located at the same site as the QF for which qualification for the standard rates and standard contract is sought if they are located within a five-mile radius of any generating facilities or equipment providing fuel or motive force associated with the QF for which qualification for the standard rates and standard contract is sought.

Person(s) or Affiliated Person(s)

A natural person or persons or any legal entity or entities sharing common ownership, management or acting jointly or in concert with or exercising influence over the policies or actions of another person or entity. Two facilities will not be held to be owned or controlled by the same person(s) or affiliated person(s) solely because they are developed by a single entity. Two facilities will not be held to be owned or controlled by the same person(s) or affiliated person(s) if such common person or persons is a "passive investor" whose ownership interest in the QF is primarily related to utilizing production tax credits, green tag values and MACRS depreciation as the primary ownership benefit. A unit of Oregon local government may also be a "passive investor" if the local governmental unit demonstrates that it will not have an equity ownership interest in or exercise any control over the management of the QF and that its only interest is a share of the cash flow from the QF, which share will not exceed 20%. The 20% cash flow share limit may only be exceeded for good cause shown and only with the prior approval of the Commission.

Shared Interconnection and Infrastructure

QFs otherwise meeting the separate ownership test and thereby qualified for entitlement to the standard rates and standard contract will not be disqualified by utilizing an interconnection or other infrastructure not providing motive force or fuel that is shared with other QFs qualifying for the standard rates and standard contract so long as the use of the shared interconnection complies with the interconnecting utility's safety and reliability standards, interconnection contract requirements and Prudent Electrical Practices as that term is defined in the interconnecting utility's approved standard contract.

Dispute Resolution

Upon request, the QF will provide the purchasing utility with documentation verifying the ownership, management and financial structure of the QF in reasonably sufficient detail to allow the utility to make an initial determination of whether or not the QF meets the above-described criteria for entitlement to the standard rates and standard contract. Any dispute concerning a QF's entitlement to the standard rates and standard contract shall be presented to the Commission for resolution.

Self Supply Option

Owner shall elect to sell all Net Output to PacifiCorp and purchase its full electric requirements from PacifiCorp or sell Net Output surplus to its needs at the Facility site to PacifiCorp and purchase partial electric requirements service from PacifiCorp, in accordance with the terms and conditions of the power purchase agreement and the appropriate retail service.

(continued)

Pricing Options**1. Fixed Avoided Cost Prices**

Prices are fixed at the time that the contract is signed by both the Qualifying Facility and the Company and will not change during the term of the contract. Fixed Avoided Cost Prices are available for a contract term of up to 15 years and prices under a longer term contract (up to 20 years) will thereafter be under either the Firm Market Indexed, the Banded Gas Market Indexed or the Gas Market Indexed Avoided Cost pricing option.

2. Gas Market Indexed Avoided Cost Prices

Fixed prices apply during the resource sufficiency period (2012 through 2015), thereafter a portion of avoided cost prices are indexed to actual monthly West Side Gas Market Index prices. The remaining portion of avoided cost prices will be fixed at the time that the contract is signed by both the Qualifying Facility and the Company and will not change during the term of the contract. Prices are available for a term of up to 20 years.

3. Banded Gas Market Indexed Avoided Cost Prices

Fixed prices apply during the resource sufficiency period (2012 through 2015), thereafter a portion of avoided cost prices are indexed to actual monthly West Side Gas Market Index prices. The remaining portion of avoided cost prices will be fixed at the time that the contract is signed by both the Qualifying Facility and the Company and will not change during the term of the contract. The gas indexed portion of the avoided cost prices are banded to limit the amount that prices can vary with changes in gas prices. Prices are available for a term of up to 20 years.

4. Firm Market Indexed Avoided Cost Prices

Firm market index avoided cost prices are available to Qualifying Facilities that contract to deliver firm power. Monthly on-peak / off-peak prices paid are a blending of Intercontinental Exchange (ICE) Day Ahead Power Price Report at market hubs for on-peak and off-peak prices. The monthly blending matrix is available upon request.

5. Non-firm Market Index Avoided Cost Prices

Non- Firm market index avoided cost prices are available to Qualifying Facilities that do not elect to provide firm power. Qualifying Facilities taking this option will have contracts that do not include minimum delivery requirements, default damages for construction delay, for under delivery or early termination, or default security for these purposes. Monthly On-Peak / Off-Peak prices paid are a blending of ICE Day Ahead Power Price Report at market hubs for on-peak and off-peak prices. The monthly blending matrix is available upon request.

(continued)

Monthly Payments

A Qualifying Facility shall select the option of payment at the time of signing the contract under one of three Pricing Options as specified above. Once an option is selected the option will remain in effect for the duration of the Facility's contract.

Fixed Avoided Cost Prices

In accordance with the terms of a contract with a Qualifying Facility, the Company shall pay for all separately metered kilowatt-hours of On-Peak and Off-Peak generation at the fixed prices as provided in this tariff. The definition of On-Peak and Off-Peak is as defined in the definitions section of this tariff.

Gas Market Indexed Avoided Cost Prices

In accordance with the terms of a contract with a Qualifying Facility, the Company shall pay for all separately metered kilowatt-hours of On-Peak and Off-Peak generation at On-Peak and Off-Peak prices calculated each month.

To calculate the Off-Peak price, multiply the West Side Gas Market Index price in \$/MMBtu by 0.696 to get actual gas price in cents/kWh. The Off-Peak Energy Adder is added to the actual gas price to get the Off-Peak Price.

The On-Peak price is the Off-Peak price plus the On-Peak Capacity Adder.

Banded Gas Indexed Avoided Cost Prices

In accordance with the terms of a contract with a Qualifying Facility, the Company shall pay for all separately metered kilowatt-hours of On-Peak and Off-Peak generation at On-Peak and Off-Peak prices calculated each month.

To calculate the Off-Peak price, multiply the West Side Gas Market Index price in \$/MMBtu by 0.696 to get actual gas price in cents/kWh. This price is banded such that the actual gas price shall be no lower than the Gas Market Index Floor nor greater than the Gas Market Index Ceiling as listed in the price section of this tariff. The Off-Peak Energy Adder is added to the actual gas price to get the Off-Peak Price.

The On-Peak price is the Off-Peak price plus the On-Peak Capacity Adder.

Firm Market Indexed and Non-firm Market Index Avoided Cost Prices

In accordance with the terms of a contract with a Qualifying Facility, the Company shall pay for all separately metered kilowatt-hours of On-Peak and Off-Peak generation at the market prices calculated at the time of delivery. The definition of On-Peak and Off-Peak is as defined in the definitions section of this tariff.

(continued)

**AVOIDED COST PURCHASES FROM
 QUALIFYING FACILITIES OF 10,000 KW OR LESS**
Avoided Cost Prices
Pricing Option 1 – Fixed Avoided cost Prices ¢/kWh

Deliveries During Calendar Year	On-Peak Energy Price	Off-Peak Energy Price
	(a)	(b)
2012	3.09	2.32
2013	3.72	2.62
2014	4.13	2.80
2015	4.39	2.99
2016	6.04	3.69
2017	6.32	3.91
2018	6.66	4.21
2019	6.99	4.50
2020	6.94	4.41
2021	7.23	4.65
2022	7.67	5.04
2023	7.92	5.24
2024	7.89	5.16
2025	8.09	5.32
2026	8.39	5.57
2027	8.66	5.78
2028	8.88	5.95
2029	9.07	6.09
2030	9.20	6.16

(continued)

**AVOIDED COST PURCHASES FROM
QUALIFYING FACILITIES OF 10,000 KW OR LESS**
Avoided Cost Prices (Continued)
Pricing Option 2 – Gas Market Indexed Avoided Cost Prices ¢/kWh

Deliveries During Calendar Year	Fixed Prices		Gas Market Index		Forecast West Side Gas Market Index Price (2) \$/MMBtu	Estimated Prices (3)	
	On-Peak Energy Price (a)	Off-Peak Energy Price (b)	On-Peak Capacity Adder (1) (c) Avoided Firm Capacity Costs / (0.876 * 88.6% * 57%)	Off-Peak Energy Adder (d) Total Avoided Energy Costs - ((e) * 0.696)		On- Peak Energy Price (f) (g) + (c)	Off-Peak Energy Price (g) ((e) * 0.696) + (d)
2012	3.09	2.32					
2013	3.72	2.62	Market Based Prices				
2014	4.13	2.80	2012 through 2015				
2015	4.39	2.99					
2016			2.36	0.44	\$4.66	6.042	3.685
2017			2.40	0.47	\$4.95	6.316	3.914
2018			2.45	0.47	\$5.38	6.660	4.212
2019			2.49	0.47	\$5.79	6.988	4.496
2020			2.53	0.47	\$5.66	6.943	4.409
2021			2.58	0.48	\$5.98	7.225	4.645
2022			2.63	0.50	\$6.53	7.667	5.041
2023			2.67	0.52	\$6.78	7.916	5.242
2024			2.72	0.53	\$6.66	7.885	5.163
2025			2.77	0.54	\$6.87	8.093	5.322
2026			2.82	0.55	\$7.21	8.385	5.565
2027			2.87	0.57	\$7.49	8.655	5.781
2028			2.93	0.60	\$7.69	8.877	5.948
2029			2.98	0.62	\$7.85	9.070	6.086
2030			3.04	0.64	\$7.92	9.197	6.156
2031			3.10	0.64	\$8.06	9.348	6.246
2032			3.16	0.65	\$8.21	9.526	6.365
2033			3.22	0.66	\$8.37	9.705	6.484
2034			3.29	0.68	\$8.53	9.902	6.616

(1) Avoided Firm Capacity Costs are equal to the fixed costs of a SCCT as identified in the Company's 2011 IRP.

(2) A heat rate of 0.696 is used to adjust gas prices from \$/MMBtu to ¢/kWh

(3) Estimated avoided cost prices based upon forecast West Side Gas Market Index prices.

Actual prices will be calculated each month using actual index gas prices.

(continued)

**AVOIDED COST PURCHASES FROM
QUALIFYING FACILITIES OF 10,000 KW OR LESS**
Avoided Cost Prices (Continued)
Pricing Option 3 – Banded Gas Market Indexed Avoided Cost Prices ¢/kWh

Deliveries During Calendar Year	Fixed Prices		Banded Gas Market Index				Forecast West Side Gas Market Index Price (2) \$/MMBtu	Estimated Prices (3)	
	On-Peak	Off-Peak	On-Peak	Off-Peak	Gas Market Index			On-Peak	Off-Peak
	Energy Price	Energy Price	Capacity Adder (1)	Energy Adder	Floor 90%	Ceiling 110%		Energy Price	Energy Price
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	
			Avoided Firm Capacity Costs / (0.876 * 88.6% * 57%)	Total Avoided Energy Costs - ((e) * 0.696)	(g) * 0.696 * 90%	(g) * 0.696 * 110%		(i) + (c)	MIN(MAX((g) * 0.696), (e)), (f) + (d)
2012	3.09	2.32							
2013	3.72	2.62							
2014	4.13	2.80							
2015	4.39	2.99							
					Market Based Prices 2010 through 2013				
2016			2.36	0.44	2.92	3.57	\$4.66	6.04	3.69
2017			2.40	0.47	3.10	3.79	\$4.95	6.32	3.91
2018			2.45	0.47	3.37	4.12	\$5.38	6.66	4.21
2019			2.49	0.47	3.63	4.43	\$5.79	6.99	4.50
2020			2.53	0.47	3.55	4.33	\$5.66	6.94	4.41
2021			2.58	0.48	3.75	4.58	\$5.98	7.23	4.65
2022			2.63	0.50	4.09	5.00	\$6.53	7.67	5.04
2023			2.67	0.52	4.25	5.19	\$6.78	7.92	5.24
2024			2.72	0.53	4.17	5.10	\$6.66	7.89	5.16
2025			2.77	0.54	4.30	5.26	\$6.87	8.09	5.32
2026			2.82	0.55	4.52	5.52	\$7.21	8.39	5.57
2027			2.87	0.57	4.69	5.73	\$7.49	8.66	5.78
2028			2.93	0.60	4.82	5.89	\$7.69	8.88	5.95
2029			2.98	0.62	4.92	6.01	\$7.85	9.07	6.09
2030			3.04	0.64	4.96	6.06	\$7.92	9.20	6.16
2031			3.10	0.64	5.05	6.17	\$8.06	9.35	6.25
2032			3.16	0.65	5.14	6.29	\$8.21	9.53	6.37
2033			3.22	0.66	5.24	6.41	\$8.37	9.71	6.48
2034			3.29	0.68	5.34	6.53	\$8.53	9.90	6.62

- (1) Avoided Firm Capacity Costs are equal to the fixed costs of a SCCT as identified in the Company's 2011 IRP.
 (2) A heat rate of 0.696 is used to adjust gas prices from \$/MMBtu to ¢/kWh
 (3) Estimated avoided cost prices based upon forecast West Side Gas Market Index prices.
 Actual prices will be calculated each month using actual index gas prices.

(continued)

Example of Gas Pricing Options available to the Qualifying Facility

An example of the two gas pricing options using different assumed gas prices is provided at the end of this tariff.

Qualifying Facilities Contracting Procedure

Interconnection and power purchase agreements are handled by different functions within the Company. Interconnection agreements (both transmission and distribution level voltages) are handled by the Company's transmission function (PacifiCorp Transmission Services) while power purchase agreements are handled by the Company's merchant function (PacifiCorp Commercial and Trading).

It is recommended that the owner initiate its request for interconnection 18 months ahead of the anticipated in-service date to allow time for studies, negotiation of agreements, engineering, procurement, and construction of the required interconnection facilities. Early application for interconnection will help ensure that necessary interconnection arrangements proceed in a timely manner on a parallel track with negotiation of the power purchase agreement.

1. Qualifying Facilities up to 10,000 kW

APPLICATION: To owners of existing or proposed QFs with a design capacity less than or equal to 10,000 kW who desire to make sales to the Company in the state of Oregon. Such owners will be required to enter into a written power purchase agreement with the Company pursuant to the procedures set forth below.

I. Process for Completing a Power Purchase Agreement**A. Communications**

Unless otherwise directed by the Company, all communications to the Company regarding QF power purchase agreements should be directed in writing as follows:

PacifiCorp
Manager-QF Contracts
825 NE Multnomah St, Suite 600
Portland, Oregon 97232

The Company will respond to all such communications in a timely manner. If the Company is unable to respond on the basis of incomplete or missing information from the QF owner, the Company shall indicate what additional information is required. Thereafter, the Company will respond in a timely manner following receipt of all required information.

(continued)

B. Procedures

1. The Company's approved generic or standard form power purchase agreements may be obtained from the Company's website at www.pacificorp.com, or if the owner is unable to obtain it from the website, the Company will send a copy within seven days of a written request.
2. In order to obtain a project specific draft power purchase agreement the owner must provide in writing to the Company, general project information required for the completion of a power purchase agreement, including, but not limited to:
 - (a) demonstration of ability to obtain QF status;
 - (b) design capacity (MW), station service requirements, and net amount of power to be delivered to the Company's electric system;
 - (c) generation technology and other related technology applicable to the site;
 - (d) proposed site location;
 - (e) schedule of monthly power deliveries;
 - (f) calculation or determination of minimum and maximum annual deliveries;
 - (g) motive force or fuel plan;
 - (h) proposed on-line date and other significant dates required to complete the milestones;
 - (i) proposed contract term and pricing provisions (i.e., fixed, deadband, gas indexed);
 - (j) status of interconnection or transmission arrangements;
 - (k) point of delivery or interconnection;
3. The Company shall provide a draft power purchase agreement when all information described in Paragraph 2 above has been received in writing from the QF owner. Within 15 business days following receipt of all information required in Paragraph 2, the Company will provide the owner with a draft power purchase agreement including current standard avoided cost prices and/or other optional pricing mechanisms as approved by the Oregon Public Utilities Commission in this Schedule 37.
4. If the owner desires to proceed with the power purchase agreement after reviewing the Company's draft power purchase agreement, it may request in writing that the Company prepare a final draft power purchase agreement. In connection with such request, the owner must provide the Company with any additional or clarified project information that the Company reasonably determines to be necessary for the preparation of a final draft power purchase agreement. Within 15 business days following receipt of all information requested by the Company in this paragraph 4, the Company will provide the owner with a final draft power purchase agreement.

(continued)

B. Procedures (continued)

- 5 After reviewing the final draft power purchase agreement, the owner may either prepare another set of written comments and proposals or approve the final draft power purchase agreement. If the owner prepares written comments and proposals the Company will respond in 15 business days to those comments and proposals.

6. When both parties are in full agreement as to all terms and conditions of the draft power purchase agreement, the Company will prepare and forward to the owner within 15 business days, a final executable version of the agreement. Following the Company's execution a completely executed copy will be returned to the owner. Prices and other terms and conditions in the power purchase agreement will not be final and binding until the power purchase agreement has been executed by both parties.

II. Process for Negotiating Interconnection Agreements

[NOTE: Section II applies only to QFs connecting directly to PacifiCorp's electrical system. An off-system QF should contact its local utility or transmission provider to determine the interconnection requirements and wheeling arrangement necessary to move the power to PacifiCorp's system.]

In addition to negotiating a power purchase agreement, QFs intending to make sales to the Company are also required to enter into an interconnection agreement that governs the physical interconnection of the project to the Company's transmission or distribution system. The Company's obligation to make purchases from a QF is conditioned upon the QF completing all necessary interconnection arrangements. It is recommended that the owner initiate its request for interconnection 18 months ahead of the anticipated in-service date to help ensure that necessary interconnection arrangements proceed in a timely manner on a parallel track with negotiation of the power purchase agreement.

Because of functional separation requirements mandated by the Federal Energy Regulatory Commission, interconnection and power purchase agreements are handled by different functions within the Company. Interconnection agreements (both transmission and distribution level voltages) are handled by the Company's transmission function (including but not limited to PacifiCorp Transmission Services) while power purchase agreements are handled by the Company's merchant function (including but not limited to PacifiCorp's Commercial and Trading Group).

(continued)

II. Process for Negotiating Interconnection Agreements (continued)

A. Communications

Initial communications regarding interconnection agreements should be directed to the Company in writing as follows:

PacifiCorp
Director – Transmission Services
825 NE Multnomah St, Suite 1600
Portland, Oregon 97232

Based on the project size and other characteristics, the Company will direct the QF owner to the appropriate individual within the Company's transmission function who will be responsible for negotiating the interconnection agreement with the QF owner. Thereafter, the QF owner should direct all communications regarding interconnection agreements to the designated individual, with a copy of any written communications to the address set forth above.

B. Procedures

Generally, the interconnection process involves (1) initiating a request for interconnection, (2) undertaking studies to determine the system impacts associated with the interconnection and the design, cost, and schedules for constructing any necessary interconnection facilities, and (3) executing an interconnection agreement to address facility construction, testing, acceptance, ownership, operation and maintenance issues. Consistent with PURPA and Oregon Public Utility Commission regulations, the owner is responsible for all interconnection costs assessed by the Company on a nondiscriminatory basis. For interconnections impacting the Company's Transmission and Distribution System, the Company will process the interconnection application through PacifiCorp Transmission Services.

(continued)

**AVOIDED COST PURCHASES FROM
QUALIFYING FACILITIES OF 10,000 KW OR LESS**
Example of Gas Pricing Options given Assumed Gas Prices ¢/kWh

Banded Gas Market Index												
Year	Prices Listed in the Tariff				Example using assumed Gas Prices						Compared to Fixed Prices	
	On-Peak Capacity Adder	Off-Peak Energy Adder	Gas Market Index		Assumed Gas Price \$/MMBtu	Fuel Index			Price Paid to QF		Off-Peak Price	On-Peak Price
			Floor 90%	Ceiling 110%		Actual Energy Price	Floor / Ceiling Component	Type of Price	Off-Peak Price	On-Peak Price		
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	
					(e) x 0.696				(b) + (g)	(a) + (i)		
2016	2.36	0.44	2.92	3.57	\$2.00	1.39	2.92	Floor	3.36	5.72	3.69	6.04
					\$4.00	2.78	2.92	Floor	3.36	5.72		
					\$5.00	3.48	3.48	Actual	3.92	6.28		
					\$7.00	4.87	3.57	Ceiling	4.01	6.37		
					\$10.00	6.96	3.57	Ceiling	4.01	6.37		

Gas Market Method												
Year	Prices Listed in the Tariff				Example using assumed Gas Prices						Compared to Fixed Prices	
	On-Peak Capacity Adder	Off-Peak Energy Adder	Fuel Index		Assumed Gas Price \$/MMBtu	Fuel Index			Price Paid to QF		Off-Peak Price	On-Peak Price
			Floor 90%	Ceiling 110%		Actual Energy Price	Floor / Ceiling Component	Type of Price	Off-Peak Price	On-Peak Price		
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	
					(e) x 0.696				(b) + (i)	(a) + (j)		
2016	2.36	0.44	Not Relevant		\$2.00	1.39			1.83	4.19	3.69	6.04
					\$4.00	2.78			3.22	5.58		
					\$5.00	3.48	Not Relevant		3.92	6.28		
					\$7.00	4.87			5.31	7.67		
					\$10.00	6.96			7.40	9.76		

EXHIBIT B

Interconnection Agreement for Small Generator Facility
Between PacifiCorp and Loyd Fery Farms, LLC



January 10, 2013

Loyd Fery
1022 Rainwater LNSE
Aumsville, OR 97325

Dear Mr. Fery:

RE: Loyd Fery – Fery Hydro / DGIQ0169 - Fully Executed Interconnection Agreement for Small Generator Facility

Dear Mr. Fery:

Enclosed for your file is a fully executed Interconnection Agreement for Small Generator Facility.

If you have any questions please contact Nathan Ortega at (503) 813-5191.

Sincerely,

A handwritten signature in black ink, appearing to read "Rick Vail".

Rick Vail
Vice President, Transmission

Enclosure



JAN 10 2013

Form 8

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

This Interconnection Agreement for Small Generator Facility ("Agreement") is made and entered into this 11th day of January, 2013, by and between Loyd Fery Farms, LLC, a limited liability company organized and existing under the laws of the State of Oregon, ("Interconnection Customer") and PacifiCorp, a Corporation, existing under the laws of the State of Oregon, ("Public Utility"). The Interconnection Customer and Public Utility may be referred to hereinafter singly as a "Party" or collectively as the "Parties."

Recitals:

Whereas, the Interconnection Customer is proposing to maintain the interconnection of an existing Small Generator Facility, consistent with the Application completed on December 17, 2007;

Whereas, the Interconnection Customer desires to interconnect the Small Generator Facility with Public Utility's Transmission System and/or Distribution System ("T&D System") in the State of Oregon; and

Whereas, the interconnection of the Small Generator Facility and the Public Utility's T&D System is subject to the jurisdiction of the Public Utility Commission of Oregon ("Commission") and governed by OPUC Rule OAR 860, Division 082 (the "Rule").

Now, therefore, in consideration of and subject to the mutual covenants contained herein, the Parties agree as follows:

Article 1. Scope and Limitations of Agreement

1.1 Scope

This Agreement establishes the standard terms and conditions under which the Small Generator Facility with a Nameplate Capacity of no more than 10 megawatts ("MW") will interconnect to, and operate in Parallel with, the Public Utility's T&D System. The Commission has approved standard terms and conditions governing this class of interconnection. Any additions, deletions or changes to the standard terms and conditions of interconnection approved by the Commission must be mutually agreed by the Parties or, if required by the Rule, any such changes must be approved by the Commission. Terms with initial capitalization, when used in this Agreement, shall have the meanings given in the Rule. This Agreement shall be construed where possible to be consistent with the Rules; to the extent this Agreement conflicts with the Rule, the Rule shall take precedence.

1.2 No Agreement Regarding Power Purchase, Transmission, or Delivery

This Agreement does not constitute an agreement to purchase, transmit, or deliver any power or capacity from the interconnected Small Generating Facility nor does it constitute

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

an electric service agreement.

1.3 Other Agreements

Nothing in this Agreement is intended to affect any other agreement between the Public Utility and the Interconnection Customer or any other interconnected entity. If the provisions of this Agreement conflict with the provisions of any other Public Utility tariff, the Public Utility tariff shall control.

1.4 Responsibilities of the Parties

1.4.1 The Parties shall perform all obligations of this Agreement in accordance with all applicable laws.

1.4.2 The Interconnection Customer will construct, own, operate, and maintain its Small Generator Facility in accordance with this Agreement, IEEE Standard 1547 (2003 ed), IEEE Standard 1547.1 (2005 ed), the National Electrical Code (2005 ed) and applicable standards required by the Commission.

1.4.3 Each Party shall be responsible for the safe installation, maintenance, repair and condition of their respective lines and appurtenances on their respective sides of the Point of Interconnection. Each Party shall provide Interconnection Facilities that adequately protect the other Parties' facilities, personnel, and other persons from damage and injury. The allocation of responsibility for the design, installation, operation, maintenance and ownership of Interconnection Facilities is prescribed in the Rule and this Agreement and the attachments to this Agreement.

1.4 Parallel Operation and Maintenance Obligations

Once the Small Generator Facility has been authorized to commence Parallel Operation by execution of this Agreement and satisfaction of Article 2.1 of this Agreement, the Interconnection Customer will abide by all written provisions for operating and maintenance as required by this Agreement and any attachments to this Agreement as well as by the Rule and as detailed by the Public Utility in Form 7, title "Interconnection Equipment As-Built Specifications, Initial Settings and Operating Requirements".

1.5 Metering & Monitoring

The Interconnection Customer will be responsible for metering and monitoring as required by OAR 860-082-0070 and as may be detailed in any attachments to this Agreement.

Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)

1.7 Power Quality

The Interconnection Customer will design its Small Generator Facility to maintain a composite power delivery at continuous rated power output at the Point of Interconnection that meets the requirements set forth in IEEE 1547. The Public Utility may, in some circumstances, also require the Interconnection Customer to follow voltage or VAR schedules used by similarly situated, comparable generators in the control area. Any special operating requirements will be detailed in Form 7 and completed by the Public Utility as required by the Rule. The Public Utility shall not impose additional requirements for voltage or reactive power support outside of what may be required to mitigate impacts caused by interconnection of the Small Generator Facility to the Public Utility's system.

Article 2. Inspection, Testing, Authorization, and Right of Access

2.1 Equipment Testing and Inspection

The Interconnection Customer will test and inspect its Small Generator Facility and Interconnection Facilities prior to interconnection in accordance with IEEE 1547 Standards as provided for in the Rule. The Interconnection will not be final and the Small Generator Facility shall not be authorized to operate in parallel with the Public Utility's T&D System until the Witness Test and Certificate of Completion provisions in the Rule have been satisfied. The Interconnection Customer shall pay or reimburse the Public Utility for its costs to participate in the Witness Test. Operation of the Small Generator Facility requires an effective Interconnection Agreement; electricity sales require a Power Purchase Agreement.

To the extent that the Interconnection Customer decides to conduct interim testing of the Small Generator Facility prior to the Witness Test, it may request that the Public Utility observe these tests. If the Public Utility agrees to send qualified personnel to observe any interim testing proposed by the Interconnection Customer, the Interconnection Customer shall pay or reimburse the Public Utility for its cost to participate in the interim testing. If the Interconnection Customer conducts interim testing and such testing is observed by the Public Utility and the results of such interim testing are deemed acceptable by the Public Utility (hereinafter a "Public Utility-approved interim test"), then the Interconnection Customer may request that such Public Utility-approved interim test be deleted from the final Witness Testing. If the Public Utility elects to repeat any Public Utility-approved interim test as part of the final Witness Test, the Public Utility will bear its own expenses associated with participation in the repeated Public Utility-approved interim test.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

2.2 Right of Access

As provided in OAR 860-082-0030(5), the Public Utility will have access to the Interconnection Customer's premises for any reasonable purpose in connection with the Interconnection Application or any Interconnection Agreement that is entered in to pursuant to the Rule or if necessary to meet the legal obligation to provide service to its customers. Access will be requested at reasonable hours and upon reasonable notice, or at any time without notice in the event of an emergency or hazardous condition.

Article 3. Effective Date, Term, Termination, and Disconnection

3.1 Effective Date

The Agreement shall become effective upon execution by the Parties.

3.2 Term of Agreement

The Agreement will be effective on the Effective Date and will remain in effect for a period of twenty (20) years or the life of the Power Purchase agreement, whichever is shorter or a period mutually agreed to by the Parties, unless terminated earlier by the default or voluntary termination by the Interconnection Customer or by action of the Commission.

3.3 Termination

No termination will become effective until the Parties have complied with all provisions of OAR 860-082-0080 and this Agreement that apply to such termination.

- 3.3.1 The Interconnection Customer may terminate this Agreement at any time by giving the Public Utility twenty (20) Business Days written notice.
- 3.3.2 Either Party may terminate this Agreement after default pursuant to Article 5.6 of this Agreement.
- 3.3.3 The Commission may order termination of this Agreement.
- 3.3.4 Upon termination of this Agreement, the Small Generator Facility will be disconnected from the Public Utility's T&D System at the Interconnection Customer's expense. The termination of this Agreement will not relieve either Party of its liabilities and obligations, owed or continuing at the time of the termination.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

3.3.4 The provisions of this Article 3.3 shall survive termination or expiration of this Agreement.

3.4 Temporary Disconnection

The Public Utility or Interconnection Customer may temporarily disconnect the Small Generator Facility from the Public Utility's T&D System for so long as reasonably necessary, as provided in OAR 860-082-0075 of the Rule, in the event one or more of the following conditions or events occurs:

- 3.4.1 Under emergency conditions, the Public Utility or the Interconnection Customer may immediately suspend interconnection service and temporarily disconnect the Small Generator Facility without advance notice to the other Party. The Public Utility shall notify the Interconnection Customer promptly when it becomes aware of an emergency condition that may reasonably be expected to affect the Small Generator Facility operation. The Interconnection Customer will notify the Public Utility promptly when it becomes aware of an emergency condition that may reasonably be expected to affect the Public Utility's T&D System. To the extent information is known, the notification shall describe the emergency condition, the extent of the damage or deficiency, the expected effect on the operation of both Parties' facilities and operations, its anticipated duration, and the necessary corrective action.
- 3.4.2 For routine Maintenance, Parties will make reasonable efforts to provide five Business Days notice prior to interruption caused by routine maintenance or construction and repair to the Small Generator Facility or Public Utility's T&D system and shall use reasonable efforts to coordinate such interruption.
- 3.4.3 The Public Utility shall use reasonable efforts to provide the Interconnection Customer with prior notice of forced outages of the T&D System. If prior notice is not given, the Public Utility shall, upon request, provide the Interconnection Customer written documentation after the fact explaining the circumstances of the disconnection.
- 3.4.4 For disruption or deterioration of service, where the Public Utility determines that operation of the Small Generator Facility will likely cause disruption or deterioration of service to other customers served from the same electric system, or if operating the Small Generator Facility could cause damage to the Public Utility's T&D System, the Public Utility may disconnect the Small Generator Facility. The Public Utility will provide the Interconnection Customer upon request all supporting documentation used to reach the decision to disconnect. The Public Utility may disconnect the Small Generator Facility if, after receipt of the notice, the Interconnection Customer fails to remedy the adverse operating effect within a

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

reasonable time which shall be at least five Business Days from the date the Interconnection Customer receives the Public Utility's written notice supporting the decision to disconnect, unless emergency conditions exist, in which case the provisions of 3.4.1 of the agreement apply.

3.4.5 If the Interconnection Customer makes any change to the Small Generating Facility, the Interconnection Equipment, the Interconnection Facilities, or to any other aspect of the interconnection, other than Minor Equipment Modifications, without prior written authorization of the Public Utility, the Public Utility will have the right to disconnect the Small Generator Facility until such time as the impact of the change has been studied by the Public Utility and any reasonable requirements or additional equipment or facilities required by the Public Utility to address any impacts from the changes have been implemented by the Parties and approved in writing by the Public Utility. The requirement to apply to the Public Utility for study and approve of modifications is governed by OAR 860-082-0005 (b).

3.5 Restoration of interconnection

The Parties shall cooperate with each other to restore the Small Generator Facility, Interconnection Facilities, and Public Utility's T&D System to their normal operating state as soon as reasonably practicable following any disconnection pursuant to Article 3.4.

Article 4. Cost Responsibility and Billing

As provided in OAR 860-082-0035, the Interconnection Customer is responsible for the cost of all facilities, equipment, modifications and upgrades needed to facilitate the interconnection of the Small Generator Facility to the Public Utility's T&D System.

4.1 Minor T&D System Modifications

As provided in the Rule addressing Tier 2 review (OAR 860-082-0050) and in the Rule addressing Tier 3 review (OAR 860-082-0055), it may be necessary for the Parties to construct certain Minor Modifications in order to interconnect under Tier 2 or Tier 3 review. The Public Utility has itemize any required Minor Modifications in the attachments to this Agreement, including a good-faith estimate of the cost of such Minor Modifications and the time required to build and install such Minor Modifications. The Interconnection Customer agrees to pay the costs of such Minor Modifications.

4.2 Interconnection Facilities

The Public Utility has identified under the review procedures of a Tier 2 review or under a Tier 4 Facilities Study, the Interconnection Facilities necessary to safely interconnect the Small Generator Facility with the Public Utility. The Public Utility has itemized the

Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)

required Interconnection Facilities in the attachments to this Agreement, including a good-faith estimate of the cost of the facilities and the time required to build and install those facilities. The Interconnection Customer is responsible for the cost of the Interconnection Facilities.

4.3 Interconnection Equipment

The Interconnection Customer is responsible for all reasonable expenses, including overheads, associated with owning, operating, maintaining, repairing, and replacing its Interconnection Equipment.

4.4 System Upgrades

The Public Utility will design, procure, construct, install, and own any System Upgrades. The actual cost of the System Upgrades, including overheads, will be directly assigned to the Interconnection Customer. An Interconnection Customer may be entitled to financial compensation from other Public Utility Interconnection Customers who, in the future, benefit from the System Upgrades paid for by the Interconnection Customer. Such compensation will be governed by separate rules promulgated by the Commission or by terms of a tariff filed and approved by the Commission. Such compensation will only be available to the extent provided for in the separate rules or tariff.

4.5 Adverse System Impact

The Public Utility is responsible for identifying the possible Affected Systems and coordinating with those identified Affected Systems, to the extent reasonably practicable, to allow the Affected System owner an opportunity to identify Adverse System Impacts on its Affected System, and to identify what mitigation activities or upgrades may be required on the Public Utility's system or on the Affected System to address impacts on Affected Systems and accommodate a Small Generator Facility. Such coordination with Affected System owners shall include inviting Affected System owners to scoping meetings between the Public Utility and the Interconnection Customer and providing the Affected System owner with study results and other information reasonably required and requested by the Affected System owner to allow the Affected System owner to assess impacts to its system and determine required mitigation, if any, for such impacts. The Parties acknowledge that the Public Utility cannot compel the participation of the Affected System owner and that the Public Utility is not itself responsible for identifying impacts or mitigation associated with an Affected System. The actual cost of any actions taken to address the Adverse System Impacts, including overheads, shall be directly assigned to the Interconnection Customer. The Interconnection Customer may be entitled to financial compensation from other Public Utilities or other Interconnection Customers who, in the future, utilize the upgrades paid for by the Interconnection Customer, to the extent allowed or required by the Commission. Such compensation will only be available to the extent

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

provided for in the separate rules, Commission order or tariff. If the Parties have actual knowledge of an Adverse System Impact on an Affected System, the Interconnection Customer shall not interconnect and operate its Small Generator Facility in parallel with the Public Utility's system, and the Public Utility shall not authorize or allow the continued interconnection or parallel operation of the Small Generator Facility, unless and until such Adverse System Impact has been addressed to the reasonable satisfaction of the Affected System owner.

4.6 Deposit and Billings

The Interconnection Customer agrees to pay to the Public Utility a deposit toward the cost to construct and install any required Interconnection Facilities and/or System Upgrades. The amount of the deposit shall be (select one of the following):

The Parties have not agreed to a schedule of progress payments and the Interconnection Customer shall pay a deposit equal to 100 percent of the estimated cost of the Interconnection Facilities and System Upgrades – the amount of the deposit shall be \$N/A;
or

The Parties have agreed to progress payments and final payment under the schedule of payments attached to this Agreement; the Interconnection Customer shall pay a deposit equal to the lesser of (a) 25 percent of the estimated cost of the Interconnection Facilities and System Upgrades, or (b) \$10,000 – the amount of the deposit shall be \$N/A.

If the actual costs of Interconnection Facilities and/or System Upgrades are different than the deposit amounts and/or progress and final payments provided for above, then the Interconnection Customer shall pay the Public Utility any balance owing or the Public Utility shall refund any excess deposit or progress payment within 20 days of the date actual costs are determined

Article 5. Assignment, Liability, Indemnity, Force Majeure, Consequential Damages, and Default

5.1 Assignment

The Interconnection Agreement may be assigned by either Party upon fifteen (15) Business Days prior written notice. Except as provided in Articles 5.1.1 and 5.1.2, said assignment shall only be valid upon the prior written consent of the non-assigning Party, which consent shall not be unreasonably withheld.

5.1.1 Either Party may assign the Agreement without the consent of the other Party to any affiliate (which shall include a merger of the Party with another entity), of the assigning Party with an equal or greater credit rating and with the legal authority

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

and operational ability to satisfy the obligations of the assigning Party under this Agreement;

- 5.1.2 The Interconnection Customer shall have the right to assign the Agreement, without the consent of the Public Utility, for collateral security purposes to aid in providing financing for the Small Generator Facility. For Small Generator systems that are integrated into a building facility, the sale of the building or property will result in an automatic transfer of this agreement to the new owner who shall be responsible for complying with the terms and conditions of this Agreement.
- 5.1.3 Any attempted assignment that violates this Article is void and ineffective. Assignment shall not relieve a Party of its obligations, nor shall a Party's obligations be enlarged, in whole or in part, by reason thereof. An assignee is responsible for meeting the same obligations as the assigning Interconnection Customer.

5.2 Limitation of Liability and Consequential Damages

A Party is liable for any loss, cost claim, injury, or expense including reasonable attorney's fees related to or arising from any act or omission in its performance of the provisions of this Agreement entered into pursuant to the Rule except as provided for in ORS 757.300(4) (c). Neither Party will seek redress from the other Party in an amount greater than the amount of direct damage actually incurred.

5.3 Indemnity

- 5.3.1 Liability under this Article 5.3 is exempt from the general limitations on liability found in Article 5.2.
- 5.3.2 The Parties shall at all times indemnify, defend, and hold the other Party harmless from, any and all damages, losses, claims, including claims and actions relating to injury to or death of any person or damage to property, demand, suits, recoveries, costs and expenses, court costs, attorney fees, and all other obligations by or to third parties, arising out of or resulting from the other Party's action or failure to meet its obligations under this Agreement on behalf of the indemnifying Party, except in cases of gross negligence or intentional wrongdoing by the indemnified Party.
- 5.3.3 If an indemnified person is entitled to indemnification under this Article 5.3 as a result of a claim by a third party, and the indemnifying Party fails, after notice and reasonable opportunity to proceed under this Article 5.3, to assume the defense of such a claim, such indemnified person may at the expense of the indemnifying

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Party contest, settle or consent to the entry of any judgment with respect to, or pay in full, such claim.

- 5.3.4 If an indemnifying party is obligated to indemnify and hold any indemnified person harmless under this Article 5.3, the amount owing to the indemnified person shall be the amount of such indemnified person's actual loss, net of any insurance or other recovery.
- 5.3.5 Promptly after receipt by an indemnified person of any claim or notice of the commencement of any action or administrative or legal proceeding or investigation as to which the indemnity provided for in this Article 5.3 may apply, the indemnified person shall notify the indemnifying party of such fact. Any failure of or delay in such notification shall not affect a Party's indemnification obligation unless such failure or delay is materially prejudicial to the indemnifying party.
- 5.3.6 The indemnifying Party shall have the right to assume the defense thereof with counsel designated by such indemnifying Party and reasonably satisfactory to the indemnified person. If the defendants in any such action include one or more indemnified persons and the indemnifying Party and if the indemnified person reasonably concludes that there may be legal defenses available to it and/or other indemnified persons which are different from or additional to those available to the indemnifying Party, the indemnified person shall have the right to select separate counsel to assert such legal defenses and to otherwise participate in the defense of such action on its own behalf. In such instances, the indemnifying Party shall only be required to pay the fees and expenses of one additional attorney to represent an indemnified person or indemnified persons having such differing or additional legal defenses.
- 5.3.7 The indemnified person shall be entitled, at its expense, to participate in any such action, suit or proceeding, the defense of which has been assumed by the indemnifying Party. Notwithstanding the foregoing, the indemnifying Party (i) shall not be entitled to assume and control the defense of any such action, suit or proceedings if and to the extent that, in the opinion of the indemnified person and its counsel, such action, suit or proceeding involves the potential imposition of criminal liability on the indemnified person, or there exists a conflict or adversity of interest between the indemnified person and the indemnifying Party, in such event the indemnifying Party shall pay the reasonable expenses of the indemnified person, and (ii) shall not settle or consent to the entry of any judgment in any action, suit or proceeding without the consent of the indemnified person, which shall not be reasonably withheld, conditioned or delayed.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

5.4 Consequential Damages

Neither Party shall be liable to the other Party, under any provision of this Agreement, for any losses, damages, costs or expenses for any special, indirect, incidental, consequential, or punitive damages, including but not limited to loss of profit or revenue, loss of the use of equipment, cost of capital, cost of temporary equipment or services, whether based in whole or in part in contract, in tort, including negligence, strict liability, or any other theory of liability; provided, however, that damages for which a Party may be liable to the other Party under another agreement will not be considered to be special, indirect, incidental, or consequential damages hereunder.

5.5 Force Majeure

5.5.1 As used in this Agreement, a Force Majeure Event shall mean “any act of God, labor disturbance, act of the public enemy, war, acts of terrorism, insurrection, riot, fire, storm or flood, explosion, breakage or accident to machinery or equipment through no direct, indirect, or contributory act of a Party, any order, regulation or restriction imposed by governmental, military or lawfully established civilian authorities, or any other cause beyond a Party’s control. A Force Majeure Event does not include an act of negligence or intentional wrongdoing.”

5.5.2 If a Force Majeure Event prevents a Party from fulfilling any obligations under this Agreement, the Party affected by the Force Majeure Event (Affected Party) shall promptly notify the other Party of the existence of the Force Majeure Event. The notification must specify in reasonable detail the circumstances of the Force Majeure Event, its expected duration, and the steps that the Affected Party is taking to mitigate the effects of the event on its performance, and if the initial notification was verbal, it should be promptly followed up with a written notification. The Affected Party shall keep the other Party informed on a continuing basis of developments relating to the Force Majeure Event. Until the Force Majeure Event ends the Affected Party will be entitled to suspend or modify its performance of obligations under this Agreement (other than the obligation to make payments) only to the extent that the effect of the Force Majeure Event cannot be reasonably mitigated. The Affected Party will use reasonable efforts to resume its performance as soon as possible. The Parties shall immediately report to the Commission should a Force Majeure Event prevent performance of an action required by the Rule that the Rule does not permit the Parties to mutually waive.

5.6 Default

5.6.1 No default shall exist where such failure to discharge an obligation (other than the payment of money) is the result of a Force Majeure Event as defined in this Agreement, or the result of an act or omission of the other Party. Upon a breach,

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

the non-breaching Party shall give written notice of such breach to the breaching Party. Except as provided in Article 5.6.2, the breaching Party shall have sixty (60) Calendar Days from receipt of the beach notice within which to cure such breach; provided however, if such breach is not capable of cure within 60 Calendar Days, the breaching Party shall commence such cure within twenty (20) Calendar Days after notice and continuously and diligently complete such cure within six months from receipt of the breach notice; and, if cured within such time, the breach specified in such notice shall cease to exist.

- 5.6.2 If a breach is not cured as provided for in this Article 5.6, or if a breach is not capable of being cured within the period provided for herein, the non-breaching Party shall have the right to declare a default and terminate this Agreement by written notice at any time until cure occurs, and be relieved of any further obligation hereunder and, whether or not that Party terminates this Agreement, to recover from the breaching Party all amounts due hereunder, plus all other damages and remedies to which it is entitled at law or in equity. Alternatively, the non-breaching Party shall have the right to seek dispute resolution with the Commission in lieu of default. The provisions of this Article 5.6 will survive termination of the Agreement.

Article 6. Insurance

- 6.1 Pursuant to the Rule adopted by the Commission, the Public Utility may not require the Interconnection Customer to maintain general liability insurance in relation to the interconnection of a Small Generator Facility with an Electric Nameplate Capacity of 200 KW or less. With regard to the interconnection of a Small Generator Facility with an Electric Nameplate Capacity equal to or less than 10 MW but in excess of 200 KW, the Interconnection Customer shall, at its own expense, maintain in force throughout the period of this Agreement general liability insurance sufficient to protect any person (including the Public Utility) who may be affected by the Interconnection Customer's Small Generation Facility and its operation and such insurance shall be sufficient to satisfy the Interconnection Customer's indemnification responsibilities under Article 5.3 of this Agreement.
- 6.2 Within ten (10) days following execution of this Agreement, and as soon as practicable after the end of each fiscal year or at the renewal of the insurance policy and in any event within ninety (90) days thereafter, the Interconnection Customer shall provide the Public Utility with certification of all insurance required in this Agreement, executed by each insurer or by an authorized representative of each insurer.
- 6.3 All insurance required by this Article 6 shall name the Public, its parent, associated and Affiliate companies and their respective directors, officers, agents, servants and employees

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

("Other Party Group") as additional insured. All policies shall contain provisions whereby the insurers waive all rights of subrogation against the Other Party Group and provide thirty (30) Calendar Days advance written notice to the Other Party Group prior to anniversary date of cancellation or any material change in coverage or condition. The Interconnection Customer's insurance shall contain provisions that specify that the policies are primary and shall apply to such extent without consideration for other policies separately carried and shall state that each insured is provided coverage as though a separate policy had been issued to each, except the insurer's liability shall not be increased beyond the amount for which the insurer would have been liable had only one insured been covered. The insurance policies, if written on a Claims First Made Basis, shall be maintained in full force and effect for two (2) years after termination of this Agreement, which coverage may be in the form of tail coverage or extended reporting period coverage if agreed by the Parties.

- 6.4 The Parties agree to report to each other in writing as soon as practical all accidents or occurrences resulting in injuries to any person, including death, and any property damage arising out of this Agreement.
- 6.5 The requirements contained herein as to insurance are not intended to and shall not in any manner, limit or qualify the liabilities and obligations assumed by the Parties under this Agreement.

Article 7. Dispute Resolution

Parties will adhere to the dispute resolution provisions in OAR 860-082-0080.

Article 8. Miscellaneous

8.1 Governing Law, Regulatory Authority, and Rules

The validity, interpretation and enforcement of the Agreement and each of its provisions shall be governed by the laws of the State of Oregon, without regard to its conflicts of law principles. The Agreement is subject to all applicable laws. Each Party expressly reserves the right to seek changes in, appeal, or otherwise contest any laws, orders, or regulations of a governmental authority.

8.2 Amendment

The Parties may mutually agree to amend the Agreement by a written instrument duly executed by both Parties in accordance with provisions of the Rule and applicable Commission Orders and provisions of the laws if the State of Oregon.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

8.3 No Third-Party Beneficiaries

The Agreement is not intended to and does not create rights, remedies, or benefits of any character whatsoever in favor of any persons, corporations, associations, or entities other than the Parties, and the obligations herein assumed are solely for the use and benefit of the Parties, their successors in interest and where permitted, their assigns.

8.4 Waiver

8.4.1 The failure of a Party to the Agreement to insist, on any occasion, upon strict performance of any provision of the Agreement will not be considered a waiver of any obligation, right, or duty of, or imposed upon, such Party.

8.4.2 The Parties may agree to mutually waive a section of this Agreement so long as prior Commission approval of the waiver is not required by the Rule.

8.4.3 Any waiver at any time by either Party of its rights with respect to the Agreement shall not be deemed a continuing waiver or a waiver with respect to any other failure to comply with any other obligation, right, duty of the Agreement. Any waiver of the Agreement shall, if requested, be provided in writing.

8.5 Entire Agreement

This Agreement, including any supplementary Form attachments that may be necessary, constitutes the entire agreement between the Parties with reference to the subject matter hereof, and supersedes all prior and contemporaneous understandings or agreements, oral or written, between the Parties with respect to the subject matter of the Agreement. There are no other agreements, representations, warranties, or covenants that constitute any part of the consideration for or any condition to, either Party's compliance with its obligations under this Agreement.

8.6 Multiple Counterparts

This Agreement may be executed in two or more counterparts, each of which is deemed an original but all constitute one and the same instrument.

8.7 No Partnership

This Agreement will not be interpreted or construed to create an association, joint venture, agency relationship, or partnership between the Parties or to impose any partnership obligation or partnership liability upon either Party. Neither Party shall have any right, power or authority to enter into any agreement or undertaking for, or act on behalf of, or to act as or be an agent or representative of, or to otherwise bind, the other Party.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

8.8 Severability

If any provision or portion of this Agreement shall for any reason be held or adjudged to be invalid or illegal or unenforceable by any court of competent jurisdiction or other governmental authority; (1) such portion or provision shall be deemed separate and independent; (2) the Parties shall negotiate in good faith to restore insofar as practicable the benefits to each Party that were affected by such ruling; and (3) the remainder of this Agreement shall remain in full force and effect.

8.9 Subcontractors

Nothing in this Agreement shall prevent a Party from utilizing the services of any subcontractor, or designating a third party agent as one responsible for a specific obligation or act required in this Agreement (collectively subcontractors), as it deems appropriate to perform its obligations under this Agreement; provided, however, that each Party will require its subcontractors to comply with all applicable terms and conditions of this Agreement in providing such services and each Party will remain primarily liable to the other Party for the performance of such subcontractor.

8.9.1 The creation of any subcontract relationship shall not relieve the hiring Party of any of its obligations under this Agreement. The hiring Party shall be fully responsible to the other Party for the acts or omissions of any subcontractor the hiring Party hires as if no subcontract had been made. Any applicable obligation imposed by this Agreement upon the hiring Party shall be equally binding upon, and will be construed as having application to, any subcontractor of such Party.

8.9.2 The obligations under this Article 8.9 will not be limited in any way by any limitation of subcontractor's insurance.

8.10 Reservation of Rights

Either Party will have the right to make a unilateral filing with the Commission to modify this Agreement. This reservation of rights provision will include but is not limited to modifications with respect to any rates terms and conditions, charges, classification of service, rule or regulation under tariff rates or any applicable State or Federal law or regulation. Each Party shall have the right to protest any such filing and to participate fully in any proceeding before the Commission in which such modifications may be considered.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Article 9. Notices and Records

9.1 General

Unless otherwise provided in this Agreement, any written notice, demand, or request required or authorized in connection with this Agreement shall be deemed properly given if delivered in person, delivered by recognized national courier service, or sent by first class mail, postage prepaid, to the person specified below.

9.2 Records

The Public Utility will maintain a record of all Interconnection Agreements and related Form attachments for as long as the interconnection is in place as required by OAR 860-082-0065. The Public Utility will provide a copy of these records to the Interconnection Customer within 15 Business Days if a request is made in writing.

If to the Interconnection Customer:

Interconnection Customer: Loyd Fery Farms, LLC
Attention: Loyd Fery
Address: 11022 Rainwater Lane S.E.
City: Aumsville State: Oregon Zip: 97325
Phone: (503) 769 – 6110 Fax: (503) 769 – 4092

If to Public Utility:

Public Utility: PacifiCorp
Attention: Director, Transmission Services
Address: 825 N.E. Multnomah Street, Suite 1600
City: Portland State: OR Zip: 97232
Phone: (503) 813-6079 Fax: (503) 813-6893

9.3 Billing and Payment

Billings and payments shall be sent to the addresses set out below: (complete if different than article 9.2 above)

If to the Interconnection Customer

Interconnection Customer: Loyd Fery Farms, LLC
Attention: Loyd Fery
Address: 11022 Rainwater Lane S.E.
City: Aumsville State: Oregon Zip: 97325

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

If to Public Utility

Public Utility: PacifiCorp Transmission
Attention: Central Cashiers
Address: P.O. Box 2757
City: Portland State: OR Zip: 97232

9.3 Designated Operating Representative

The Parties will designate operating representatives to conduct the communications which may be necessary or convenient for the administration of the operations provisions of this Agreement. This person will also serve as the point of contact with respect to operations and maintenance of the Party's facilities (complete if different than article 9.2 above)

Interconnection Customer's Operating Representative:

Interconnection Customer: Loyd Fery Farms, LLC
Attention: Loyd Fery
Address: 11022 Rainwater Lane S.E.
City: Aumsville State: Oregon Zip: 97325
Phone: (503) 769 – 6110 Fax: (503) 769 – 4092

Public Utility's Operating Representative:

PacifiCorp
Attention: Grid Operations
Address: 9915 S.E. Ankeny Street
City: Portland State: OR Zip: 97216
Phone: (503) 251-5197 Fax: (503) 251-5228

9.5 Changes to the Notice Information

Either Party may change this notice information by giving five (5) Business Days written notice prior to the effective date of the change.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Article 10. Signatures

IN WITNESS WHEREOF, the Parties have caused this Agreement to be executed by their respective duly authorized representatives.

For Public Utility:

Name: Paul Val

Title: VP - Transmission

Date: 01/11/13

For the Interconnection Customer:

Name: Lloyd Ferry

Title: Owner C.E.O.

Date: 01/09/13

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment I

**Description of Interconnection Facilities
And Metering Equipment Operated or Maintained by the Public Utility**

Description of Small Generator Facility: Interconnection Customer has an existing .050 MW hydro Small Generator Facility located at its facility in Marion County, Oregon. The Small Generator Facility is comprised of one (1) Sterling, 50 kW, 208-230 / 480 V, induction generator. Interconnection Customer will operate this generator as a Qualifying Facility as defined by the Public Utility Regulatory Policies Act of 1978 (PURPA). The point of interconnection is the existing service point located at 11028 Stayton Road Southeast in Aumsville, Oregon.

Itemized Cost Estimate (Public Utility's responsibility):


Metering Modifications	\$ 1,088
<u>Project Management</u>	<u>\$ 900</u>
Estimated Project Totals	\$ 1,988

The Public Utility's interconnection facilities on the Interconnection Customer's side of the Point of Interconnection include the bi-directional metering package complete with cell phone communications required for the Small Generator Facility.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment 2

One-line Diagram Depicting the Generating Facility, Interconnection Facilities, Metering Equipment, and Upgrades

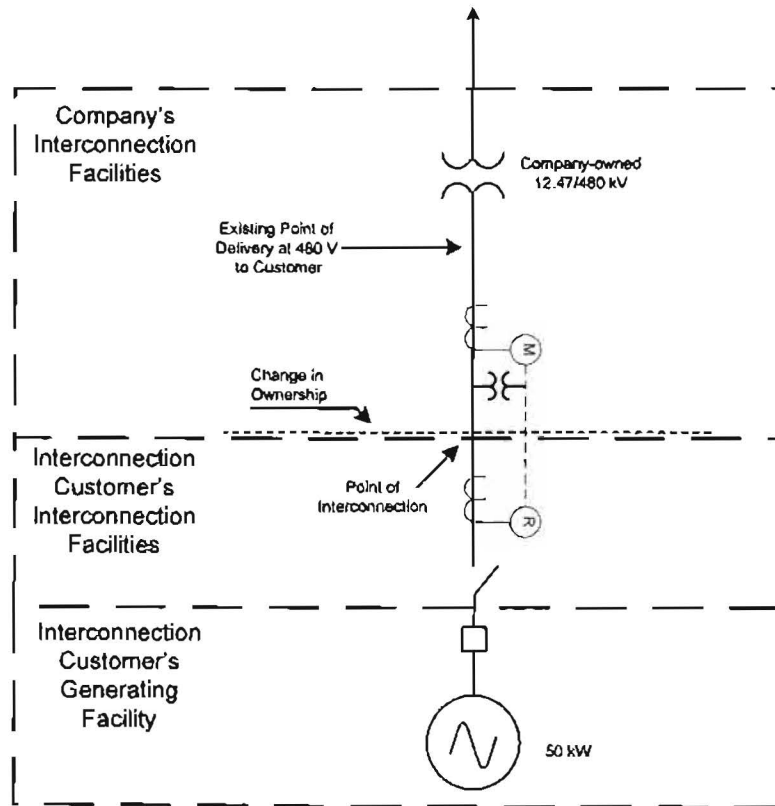

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment 3

Milestones

Estimated Completion Date:

Public Utility shall complete the design, procurement and installation of the required interconnection facilities within six (6) months of the Effective Date of this Interconnection Agreement. Interconnection Customer shall coordinate with the Public Utility and provide an outage time for the Generating Facility to allow for the installation of the interconnection facilities during time period.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment 4

**Additional Operating Requirements for the Public Utility's
Transmission System and/or Distribution System and Affected Systems Needed to Support the
Interconnection Customer's Needs**

The interconnection of the Small Generator Facility is subject to the rules contained within OAR 860 division 82. The interconnection of the Small Generator Facility to the Public Utility's Distribution System shall be subject to, and the Interconnection Customer shall operate the Small Generating Facility in accordance with, the Public Utility's policies governing interconnection of generation facilities to the distribution system entitled "Facility Connection (Interconnection) Requirements for Distribution Systems (34.5 kV and below)" which policy document is available upon request from the Public Utility and is incorporated by this reference as part of the Interconnection Agreement between the Parties. In the event of a conflict between any aspect of this Attachment 4 (including without limitation the Public Utility's policies governing interconnection of generation facilities to the distribution system or the transmission system) and the rules contained in OAR 860, division 82, the rules shall prevail.

Parallel Operation. Interconnection Customer may operate the Generating Facility in parallel with the Public Utility's Transmission System or Distribution System (collectively the "T&D System"), but subject at all times to any operating instructions that the Public Utility's dispatch operators may issue and in accordance with all the provisions of this Interconnection Agreement and Good Utility Practice, and any other conditions imposed by the Public Utility in its sole discretion.

Generating Facility Operation Shall Not Adversely Affect the Public Utility's T&D System. Interconnection Customer shall operate the Generating Facility in such a manner as not to adversely affect the Public Utility's T&D System or any other element of the Public Utility's electrical system. Interconnection Customer's Generating Facility shall deliver not more than the Design Capacity of 50 kW. Except as otherwise required by this Interconnection Agreement, Interconnection Customer shall operate the Generating Facility in a manner compatible with the Public Utility's applicable voltage level and fluctuating voltage guidelines, entitled Facility Connection (Interconnection) Requirements for Distribution Systems (34.5 kV and below), as it may be amended or superseded from time to time in the Public Utility's reasonable discretion, at the Point of Interconnection during all times that the Generating Facility is connected and operating in parallel with the Public Utility's T&D System. In its sole discretion, the Public Utility may specify rates of change in Interconnection Customer's deliveries to the Public Utility's T&D System during any start-up of the Generating Facility, during reconnection to the Public Utility's T&D System, and during normal operations to assure that such rates of change are compatible with the operation of the Public Utility's voltage regulation equipment.

Maximum Authorized Power Flow. The Generating Facility shall not be operated in a manner that results in the flow of electric power onto the Public Utility's T&D System during any fifteen (15) minute interval at levels in excess of 50 kW from the Generating Facility. If this provision is violated, the Public Utility may terminate this Interconnection Agreement or lock the Interconnection Customer Disconnect Switch in the open position until such time as: (a) the Public Utility has studied the impact of additional

Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)

generation on the T&D System (at Interconnection Customer's cost and pursuant to a new study agreement between the Public Utility and Interconnection Customer) and the interconnection has been upgraded (at Interconnection Customer's cost and pursuant to a new or amended Facilities Construction Agreement and a new or amended Interconnection Agreement if deemed necessary by the Public Utility) in any manner necessary to accommodate the additional generation; or (b) the Interconnection Customer has modified the Generating Facility or Interconnection Customer's Interconnection Facilities in such manner as to insure to the Public Utility's satisfaction that the Generating Facility will no longer cause electric power to flow onto the Public Utility's T&D System at a level in excess of 50 kW.

Harmonic Distortion or Voltage Flicker. Notwithstanding the Study Results, upon notice from the Public Utility that operation of the Generating Facility is producing unacceptable harmonic distortions or voltage flicker on the Public Utility's T&D System, Interconnection Customer shall at its sole cost remedy such harmonic distortions or voltage flicker within a reasonable time.

Reactive Power. Interconnection Customer shall at all times control the flow of reactive power between the Generating Facility and the Public Utility's T&D System within limits established by the Public Utility. The Public Utility shall not be obligated to pay Interconnection Customer for any KVAR or KVAR Hours flowing into the Public Utility's T&D System.

Islanding. If at any time during the term of this Interconnection Agreement the interconnection of the Generating Facility to the Public Utility's T&D System results in a risk of electrical islanding, or actual occurrences of electrical islanding, which the Public Utility reasonably concludes are incompatible with Good Utility Practice, the Parties shall (as necessary) study the issue and implement a solution that will eliminate or mitigate the risk of electrical islanding to a level deemed acceptable by the Public Utility. All costs associated with addressing any electrical islanding problems as required by this paragraph shall be paid by the Interconnection Customer, including without limitation any study costs, engineering costs, design costs, or costs to procure, install, operate and/or maintain required interconnection facilities or protective devices.

Voltage Regulation. The Interconnection Customer agrees to operate at a \pm 95% leading or lagging power factor. Prior to installation, Interconnection Customer shall provide the Public Utility with written notice of the device and/or operational constraints selected to satisfy this requirement and shall obtain the Public Utility's written approval of such device and/or operational constraints, which approval shall not be unreasonably withheld. In the event Interconnection Customer fails to operate the Generating Facility within the voltage regulation constraints of this requirement, the Public Utility may disconnect the Generating Facility.

Modification of Nominal Operating Voltage Level. By providing Interconnection Customer with a one hundred and eighty (180) day notice, the Public Utility may at its sole discretion change the Public Utility's nominal operating voltage level at the Point of Interconnection. In the event of such change in voltage level Interconnection Customer shall, at Interconnection Customer's sole expense, modify Interconnection Customer's Interconnection Facilities as necessary to accommodate the modified nominal operating voltage level. Interconnection Customer has been informed that initial use of a dual voltage

Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)

Interconnection Customer may ameliorate the cost of accommodating a change in nominal operating voltage level.

Equipment Failure. Interconnection Customer acknowledges that it is responsible for repair or replacement of Interconnection Customer's primary transformer and for any and all other components of the Generating Facility and the Interconnection Customer's Interconnection Facilities. Interconnection Customer is aware that its inability to timely repair or replace its transformer or any other component of the Generating Facility or Interconnection Customer's Interconnection Facility could result in Interconnection Customer's inability to comply with its responsibilities under this Interconnection Agreement and could lead to disconnection of the Generating Facility from the Public Utility's T&D System and/or termination of this Interconnection Agreement pursuant to the terms of this Interconnection Agreement. Interconnection Customer acknowledges that the risk of this result is born solely by Interconnection Customer and may be substantially ameliorated by Interconnection Customer's elective maintenance of adequate reserve or spare components including but not limited to the Interconnection Customer's primary transformer.

Operation and Maintenance of Facilities Not Owned by the Public Utility. Interconnection Customer shall maintain, test, repair, keep accounts current on, or provide for the proper operation of any and all interconnection facilities, including but not limited to telemetry and communication equipment, not owned by the Public Utility.

Metering and Telemetry Communications Equipment. Notwithstanding any language of OAR 860-082-0070, Public Utility shall not require Interconnection Customer to install a redundant or back-up meter or other telemetry communications equipment. However, Transmission Provider reserves the right to request that the Oregon Public Utility Commission authorize Public Utility to require Interconnection Customer to be responsible for all reasonable costs associated with redundant metering and communications equipment installed at the Small Generating Facility, upon a determination by Public Utility that such equipment is necessary to maintain compliance with the mandatory reliability standards enforced by the North American Electric Reliability Corporation and the Western Electricity Coordinating Council.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment 5

Public Utility's Description of its Upgrades and Best Estimate of Upgrade Costs

There are no System Upgrades required to maintain the interconnection of this Small Generator Facility.

**Interconnection Agreement for Small Generator Facility
Tier 1, Tier 2, Tier 3 or Tier 4 Interconnection
(Small Generator Facilities with Electric Nameplate Capacities of 10MW or less)**

Attachment 6

Scope of Work

This attachment details who will design, procure, install and own the equipment required to maintain the interconnection of the Small Generator Facility to the Public Utility's T&D System. The Public Utility is responsible for the cost to design purchase and install the required interconnection facilities.

Point of Interconnection

The Point of Interconnection is the existing service point located at ~~14022~~ ^{11028 Stayton Rd SE,} Rainwater Lane.

Metering Requirements

The current metering at Interconnection Customer's Small Generator Facility consists of two uni-directional meters. The first meter measures KWh for the customers retail load and will not need to be replaced. The second meter measures KW and KWh for the customer generation and will need to be replaced with a multifunction meter that is equipped with an under-glass digital cell phone so that Public Utility's MV-90 data acquisition system can download interval data and register reads for back office billing.

The following outlines the design, procurement, installation, and ownership of equipment required for the metering to be installed at the Interconnection Customer's Small Generator Facility.

Public Utility shall be responsible for:

- Design, procurement, installation, and ownership of a multifunction meter with an integrated cell phone to allow for remote interrogation of the Small Generator Facility.
- Design, procurement, installation, and ownership of the associated test switches and secondary meter wire needed to interconnect meter into the existing meter cabinet for the Small Generator Facility.

EXHIBIT C

Letter from PacifiCorp to Loyd Fery Farms, LLC
Dated September 23, 2013



Pacific Power |
Rocky Mountain Power
825 NE Multnomah
Portland, Oregon 97232

September 23, 2013

Loyd Fery
Loyd Fery Hydro
11022 Rainwater Lane SE
Aumsville, OR 97325

RE: Loyd Fery Hydro / Q0169 – Notice to request account set up for generation metering

Dear Mr. Fery:

PacifiCorp recently installed a new meter at your hydroelectric generation facility. As part of this new meter set up, PacifiCorp has the ability to read the meter remotely via cell-phone signal. However in order to use this capability, you will need to call into our customer care center in order to create a new meter account to associate this new meter with your existing account(s) for your retail loads. The number is 1 (800) 640-2212. The relevant information for you new meter is:

Site ID:	374844559
Old Meter Number:	1636782
New Meter Number:	35824747

This meter will also operate in a bi-directional manner. This way of operations means the meter will read power both from your generation as well as any power absorbed by the generator when not operating. The previous generator meter did not have this capability, meaning that from a billing perspective you were not billed for any back-fed load into your generator. In order to meet current interconnection standards you will now see charges for this power flow.

John Younie with PacifiCorp's Merchant group has also contacted you in order to negotiate a new Power Purchase Agreement (PPA). As part of this PPA the charges and revenue rates will be explained in greater detail.

If you have any questions, feel free to contact me at (503) 813-6126.

Thank you,

Graham Retzlaff
Project Manager
PacifiCorp Transmission