

**BEFORE THE PUBLIC UTILITY COMMISSION
OF OREGON**

UM 1004

In the Matter of

PORTLAND GENERAL ELECTRIC
COMPANY

Service Quality Measures Performance
Reporting for calendar year 2008.

ORDER

**DISPOSITION: SERVICE QUALITY MEASURES PERFORMANCE
FOR CALENDAR YEAR 2008 ACKNOWLEDGED AND
ACCEPTED**

At its Public Meeting on July 28, 2009, the Public Utility Commission of Oregon (Commission) adopted Portland General Electric Company's (PGE) and Staff's joint recommendation to acknowledge PGE's report of calendar year 2008 performance as satisfying the requirements of Order No. 97-196. PGE's performance in the C1, R1, R2, and R3 measure categories was acceptable, and no penalty levels were reached or exceeded. Staff's recommendation is attached as Appendix A and is incorporated by reference.

ORDER

IT IS ORDERED that Portland General Electric Company's Service Quality Measures Performance Report for calendar year 2008 satisfies the requirements of Order No. 97-196. Relative to the performance lines set by the Commission for calendar year 2008, all performance evaluated was acceptable and no penalties are appropriate.

Made, entered and effective JUL 30 2009.



BY THE COMMISSION:

Becky L. Beier

Becky L. Beier
Commission Secretary

A party may request rehearing or reconsideration of this order pursuant to ORS 756.561. A request for rehearing or reconsideration must be filed with the Commission within 60 days of the date of service of this order. The request must comply with the requirements in OAR 860-014-0095. A copy of any such request must also be served on each party to the proceeding as provided by OAR 860-013-0070(2). A party may appeal this order by filing a petition for review with the Court of Appeals in compliance with ORS 183.480-183.484.

ITEM NO. CA10

**PUBLIC UTILITY COMMISSION OF OREGON
STAFF REPORT
PUBLIC MEETING DATE: July 28, 2009**

REGULAR CONSENT EFFECTIVE DATE _____ N/A

DATE: July 14, 2009

TO: Public Utility Commission

FROM: Jerry Murray *JM*

THROUGH: Lee Sparling, and JR Gonzalez *JR*

SUBJECT: PORTLAND GENERAL ELECTRIC: (Docket No. UM 1004) Service Quality Measures Performance Reporting for calendar year 2008.

STAFF RECOMMENDATION:

Staff and Portland General Electric (PGE) jointly recommend that the Commission acknowledge PGE's 2008 Service Quality Measures (SQMs) report related to customer service and electric reliability. This report satisfies the requirements of Oregon Public Utility Commission (OPUC) Order No. 97-196. PGE's performance in measures C1, R1, R2, and R3 was acceptable and no penalty levels were reached or exceeded.

DISCUSSION:

Overview: SQMs were adopted by the Commission in 1997 as measurement tools related to safety programs and reliability monitoring activities conducted by the Safety Program Staff. SQMs are intended ". . . to provide a mechanism to ensure service quality is maintained at current levels or improved . . ." (see UM 814 – PGE/Enron Merger, Order No. 97-196). OPUC Safety and Reliability Program Staff believe that the SQMs have proven to be an excellent regulatory tool.

There are eight separate measures included in PGE's UM 814 SQMs, of which the first four are the subject of this report.

1. C1 - At Fault Customer Complaints
2. R1 - Average Interruption Duration
3. R2 - Average Interruption Frequency
4. R3 - Average Momentary Interruption Frequency
5. S1 - Major Safety Violations

PGE 2008 SQMs Report, UM 1004
 July 14, 2009
 Page 2

6. X1 - Annual Review Vegetative Management
7. X2 - Annual Review Basic Inspection & Maintenance Programs
8. X3 - Annual Review Special Programs


SQMs C1, R1, R2, and R3 have three performance levels each (a goal and two penalty levels). The performance levels for PGE's 2008 calendar year were set by the Commission at its December 4, 2007, public meeting (see Order 07-543). PGE's 2008 SQM performance results are the subject of this memo.

SQM C1: The first measure evaluated is C1, or customer at-fault complaint frequency. This is expressed as the number of PUC customer complaints where PGE has been determined to be at-fault, having violated a tariff, rule or business practice standard. The C1 statistic is presented as the number of at-fault complaints per 1000 customers.

For 2008, the performance levels were set as follows:

- Goal - less than .07
- Penalty 1 level (\$100,000) - .10
- Penalty 2 level (\$1,000,000) - .13

Actual PGE performance for the 2008 was 0.005 "at-fault" complaints per thousand customers. The following graph shows C1 performance since 1997:

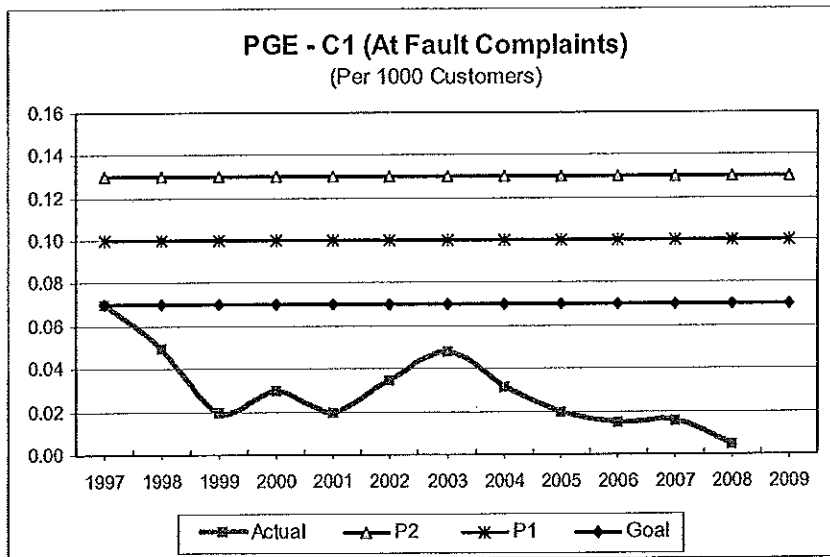


The next three measures (R1, R2, and R3) relate to service reliability.

PGE 2008 SQMs Report, UM 1004
 July 14, 2009
 Page 3

SQM R1: The R1 measure is an averaged customer interruption duration (annual time without power) that utilizes a three-year weighted averaging formula. This is similar to the System Average Interruption Duration Index (SAIDI), calculated with the target year weighted at 50 percent, the previous year weighted at 30 percent, and the next previous year weighted at 20 percent. Certain "major events" can be excluded from these statistics when specific requirements have been met (based on OAR 860-023-0080 through 0160). The 2008 performance levels set by the Commission were:

- Goal - 1.33 hours
- Penalty 1 level (\$100,000) - 1.5 hours
- Penalty 2 level (\$1,000,000) - 1.7 hours

Actual 2008 performance for R1 was 1.4 hours out. The following graph shows historical performance:

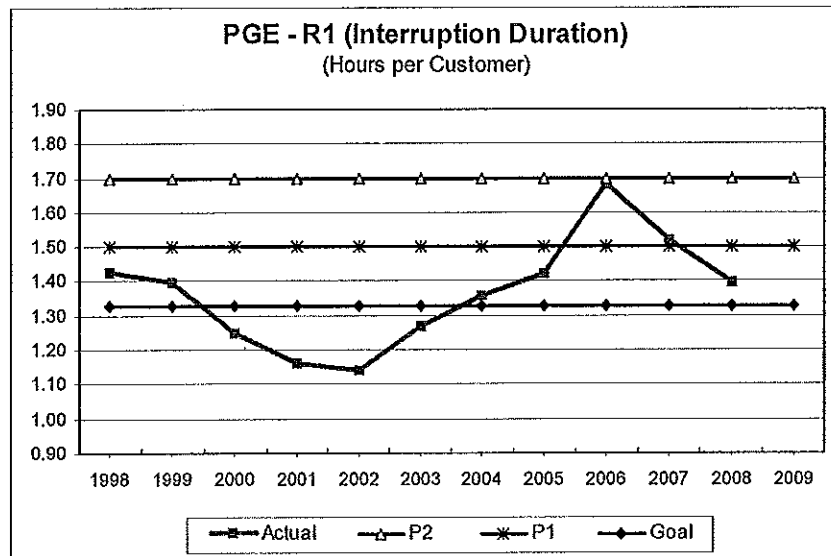

In 2006, several moderate wind storms resulted in the R1 measure exceeding its goal and first penalty level. Given the unusual weather circumstances, Staff did not initiate a formal complaint regarding the company exceeding the 2006 R1 penalty level. The 2007 R1 3-year weighted average is 1.52 hours, which slightly exceeds the first penalty level, but is the result of the mathematical averaging and not poor performance by PGE (PGE's 2007 R1 measure without 3-year weighting was 1.28 hours). Therefore, Staff believed a formal complaint was not justified.


SQM R2: The R2 measure is an averaged customer interruption frequency (annual number of times service is interrupted for five minutes or more) that, like R1, utilizes a

PGE 2008 SQMs Report, UM 1004
 July 14, 2009
 Page 4

weighted three-year formula. This is, in essence, a three-year weighted System Average Interruption Frequency Index (SAIFI). The 2008 R2 performance levels set by the Commission were:

- Goal - 1.0 occurrences
- Penalty 1 level (\$100,000) - 1.2 occurrences
- Penalty 2 level (\$1,000,000) - 1.4 occurrences

Actual 2008 performance for R2 was .79 occurrences. The following graph lists historical performance:

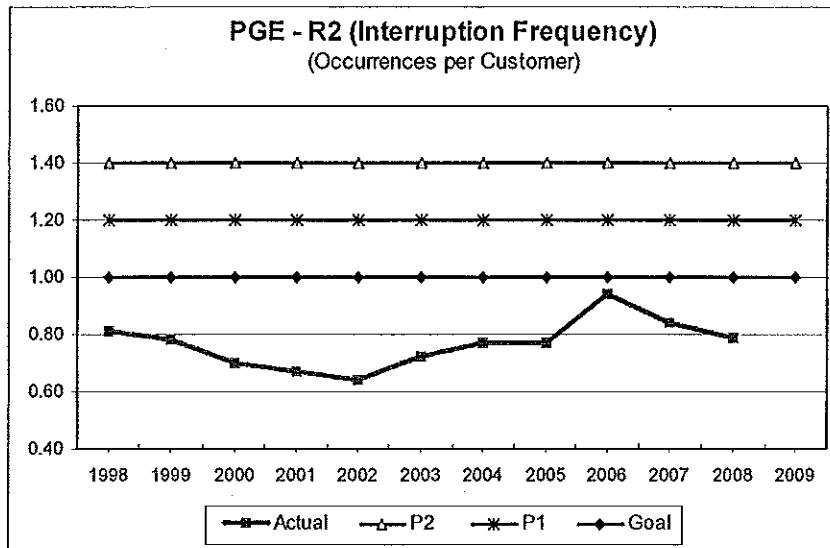


SQM R3: The R3 (averaged customer momentary interruption event frequency) measure has been phased in by PGE over the last few years. A trial run was performed for 1999, and the measure's first fully implemented year was 2000. Momentary outages are primarily the quick blinks that occur on an electrical system when automatic switches perform their protective function in response to a fault on the line.

PGE's 2008 R3 levels were set as follows:

- Goal – 3 occurrences
- Penalty 1 level (\$100,000) – 5 occurrences
- Penalty 2 level (\$1,000,000) – 7 occurrences

PGE 2008 SQMs Report, UM 1004
 July 14, 2009
 Page 5

Actual 2008 performance for R3 was 1.3 occurrences per customer. Historical performance is shown in the following graph:

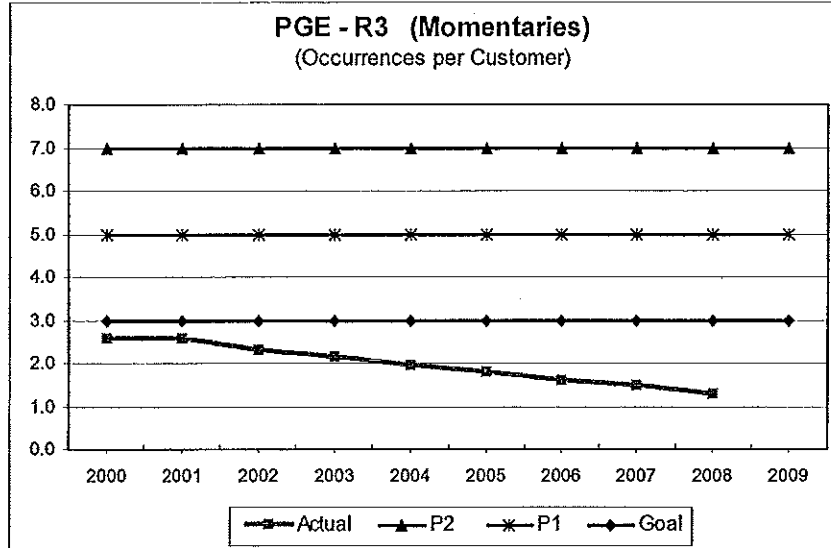

On July 8, 2009, PGE briefed Staff on operational, customer service, safety, and security issues, including SQMs. Staff's conclusion from this meeting, as well as field reviews, is that the Company is meeting the SQM requirements for C1, R1, R2, and R3.

Staff notes that the existing SQMs extend through 2016, pursuant to the Commission's December 14, 2005, order approving PGE's Stock Distribution (*Order No. 05-1250*).

PROPOSED COMMISSION MOTION:

For calendar year 2008, PGE's performance for Service Quality Measures C1, R1, R2, and R3 was acceptable, and no penalties are appropriate.

PGE 2008 SQM Report UM1004.doc